



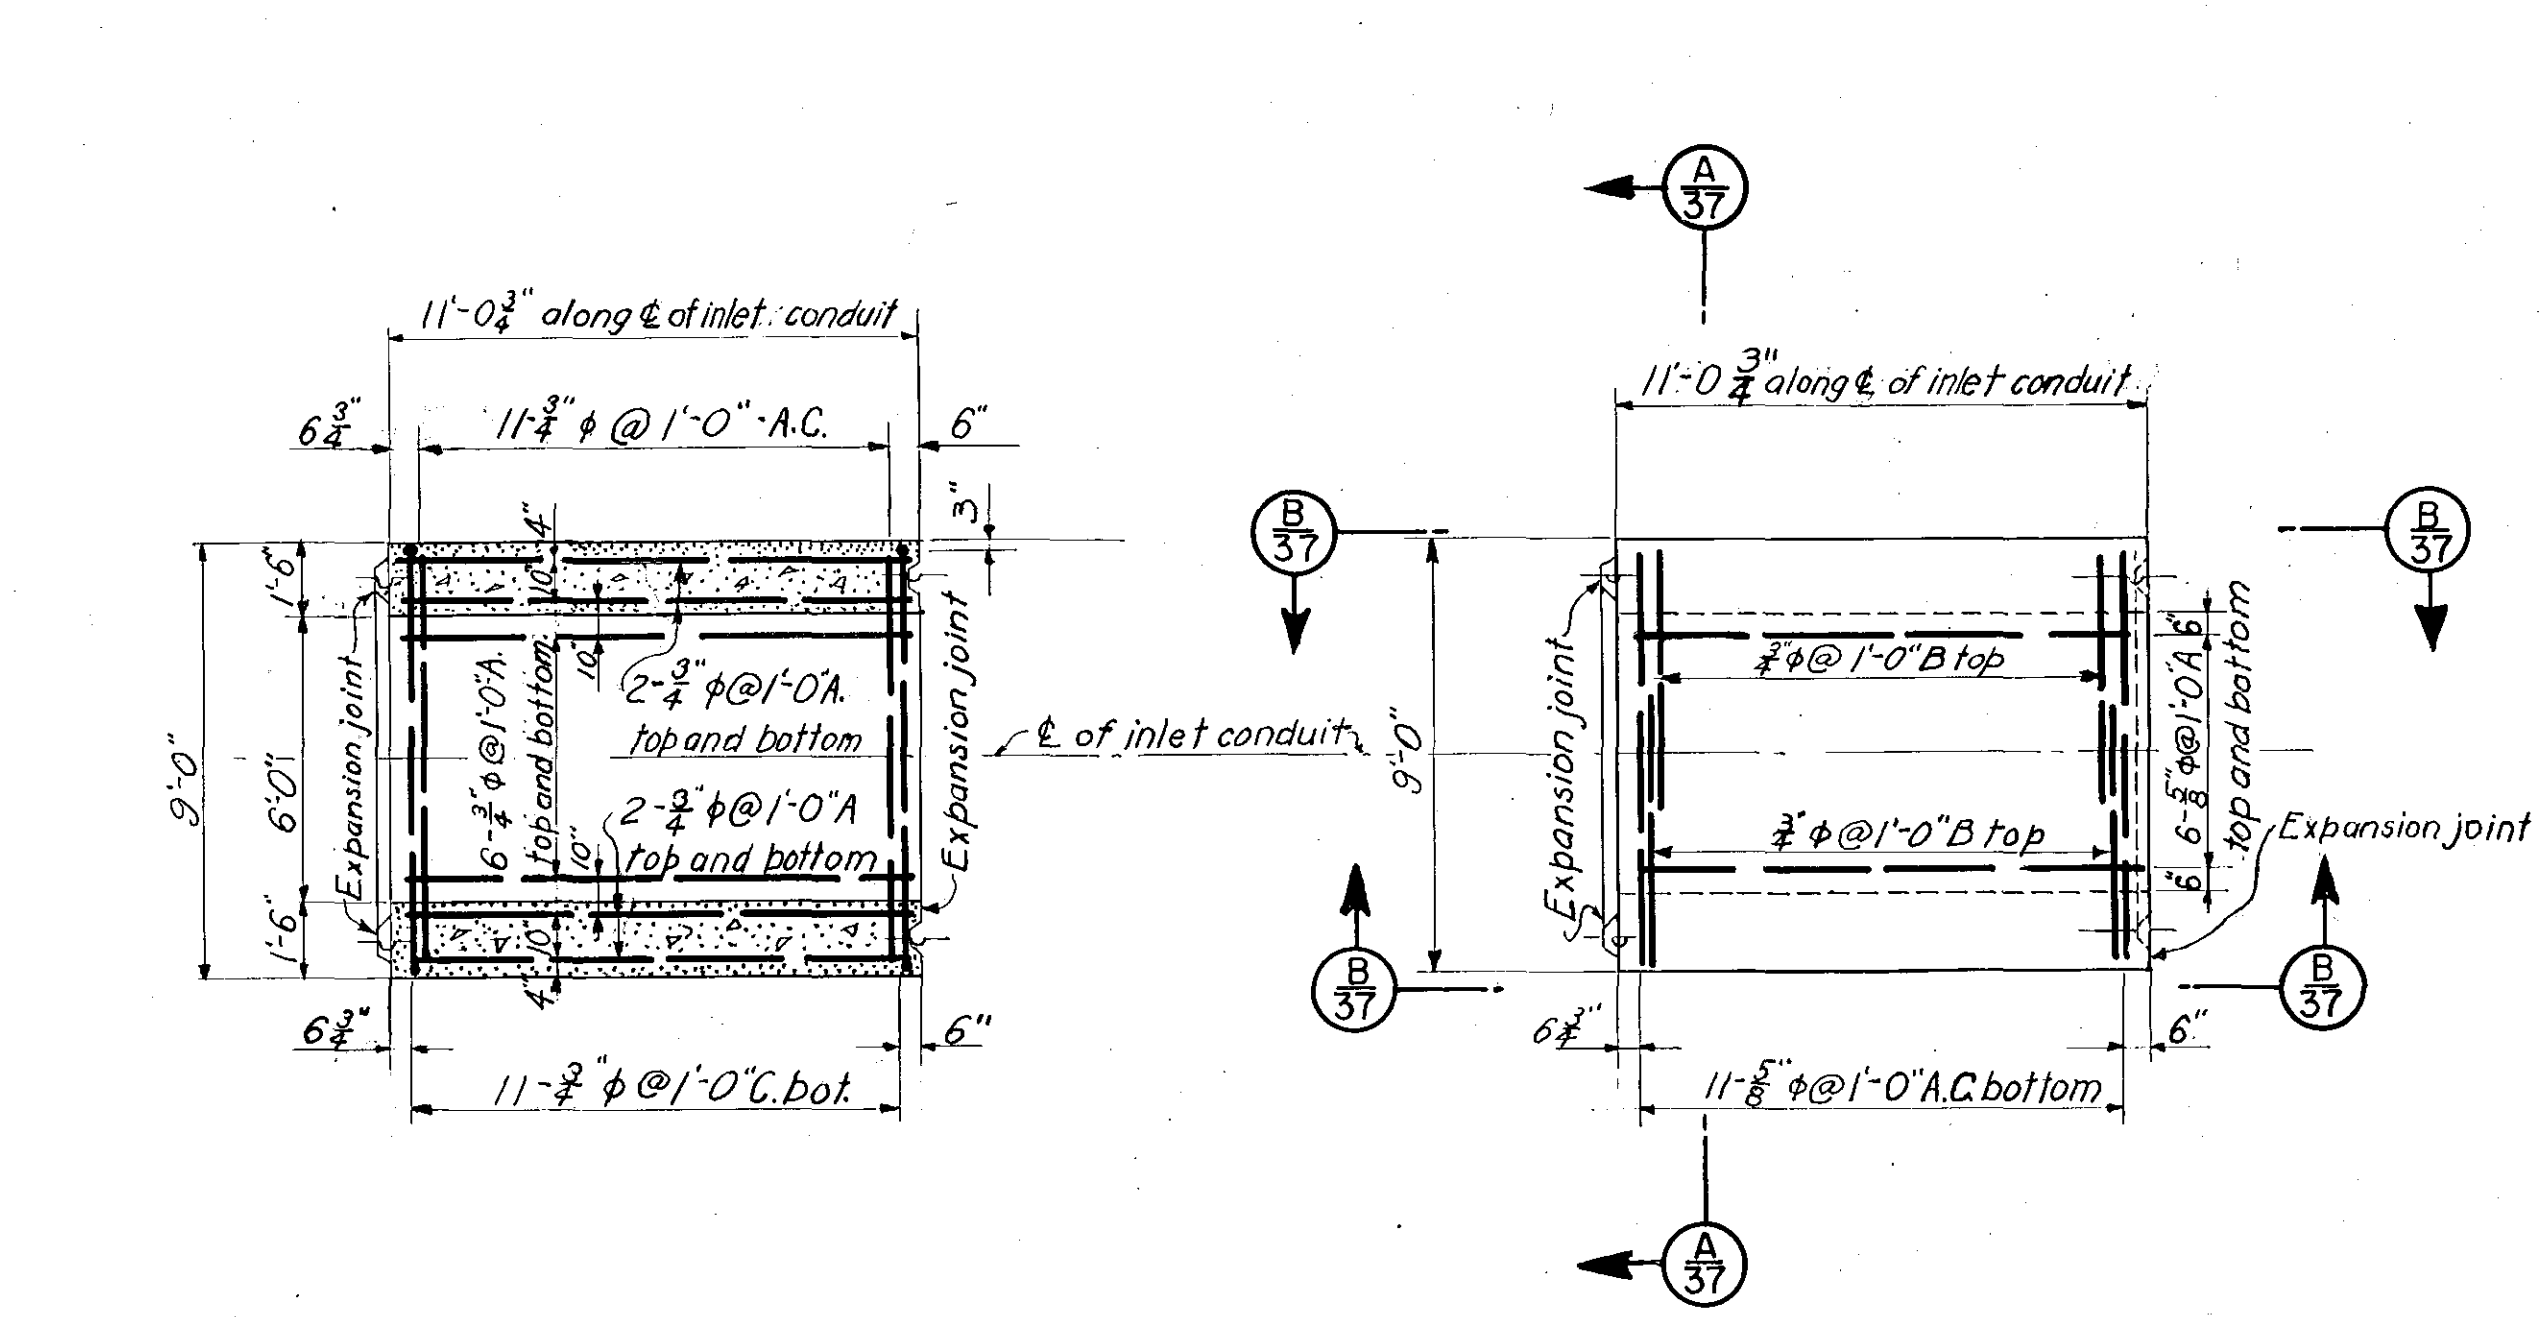


BASE SLAB

ROOF SLAB


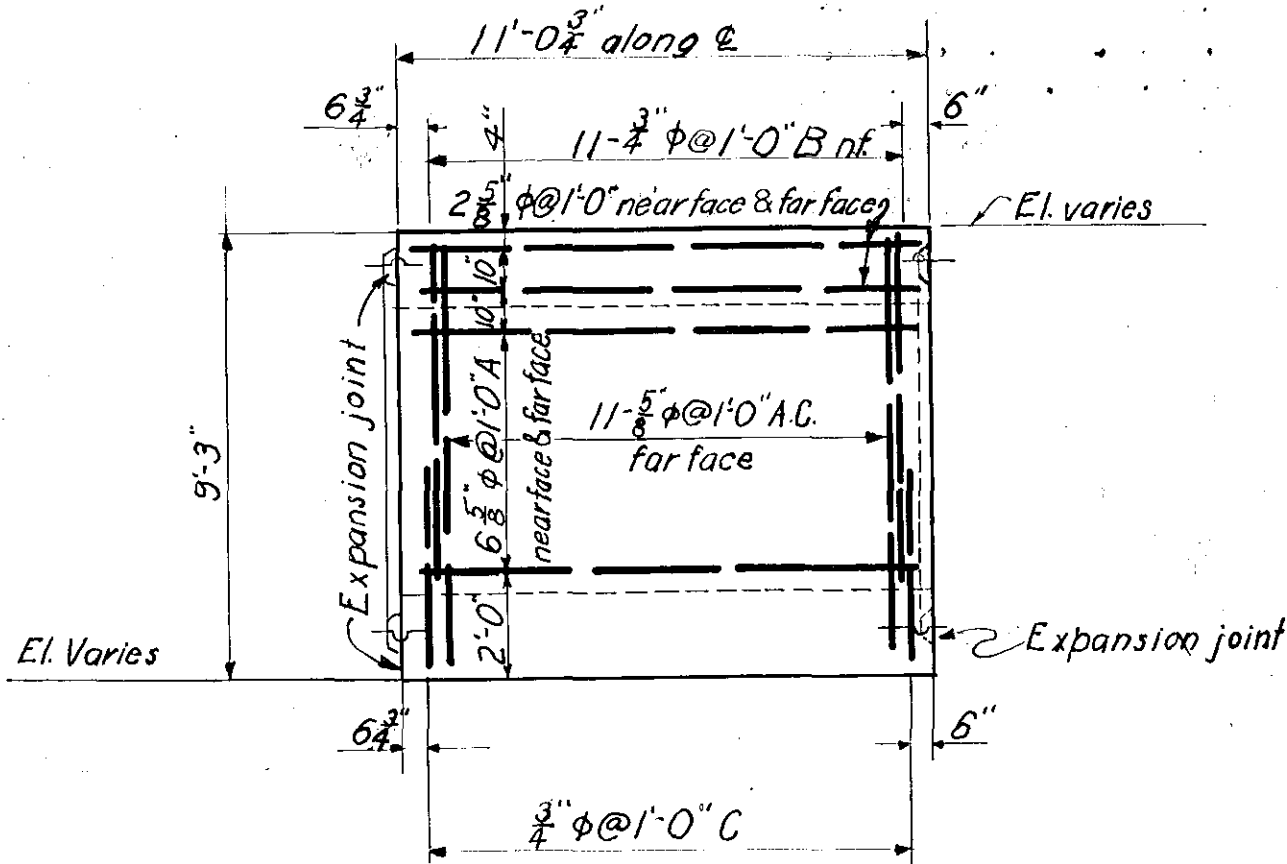


SECTION B 37

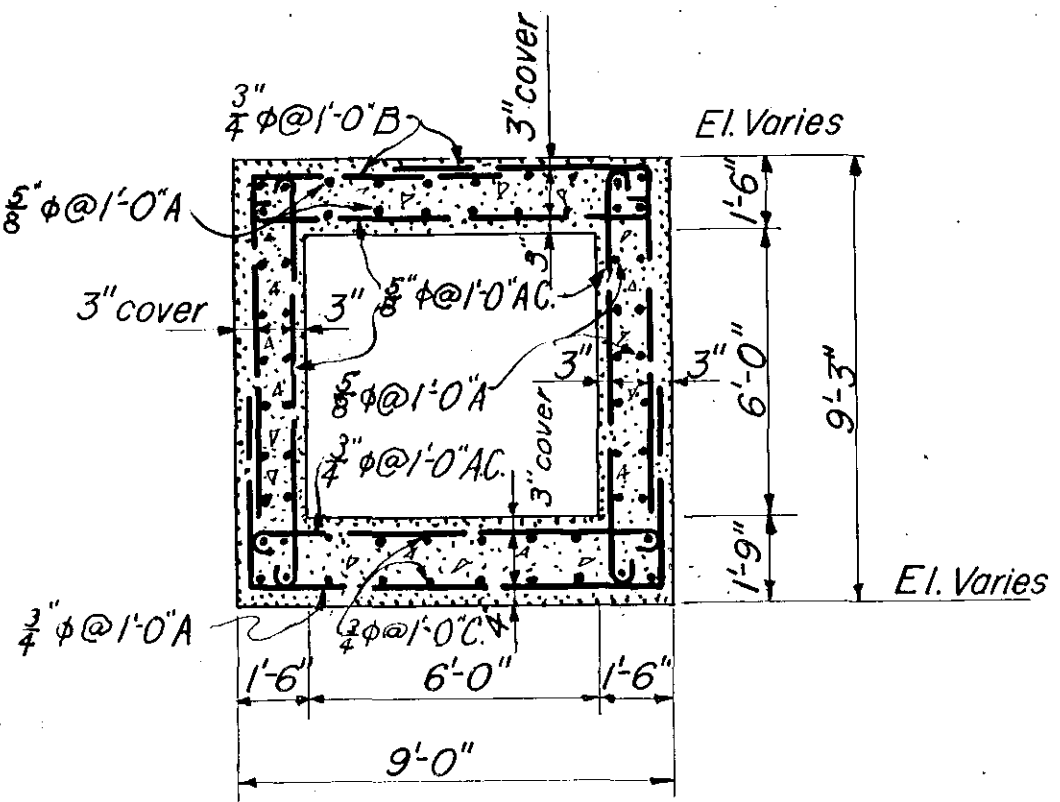


SECTION A 37



INTAKE CONDUIT

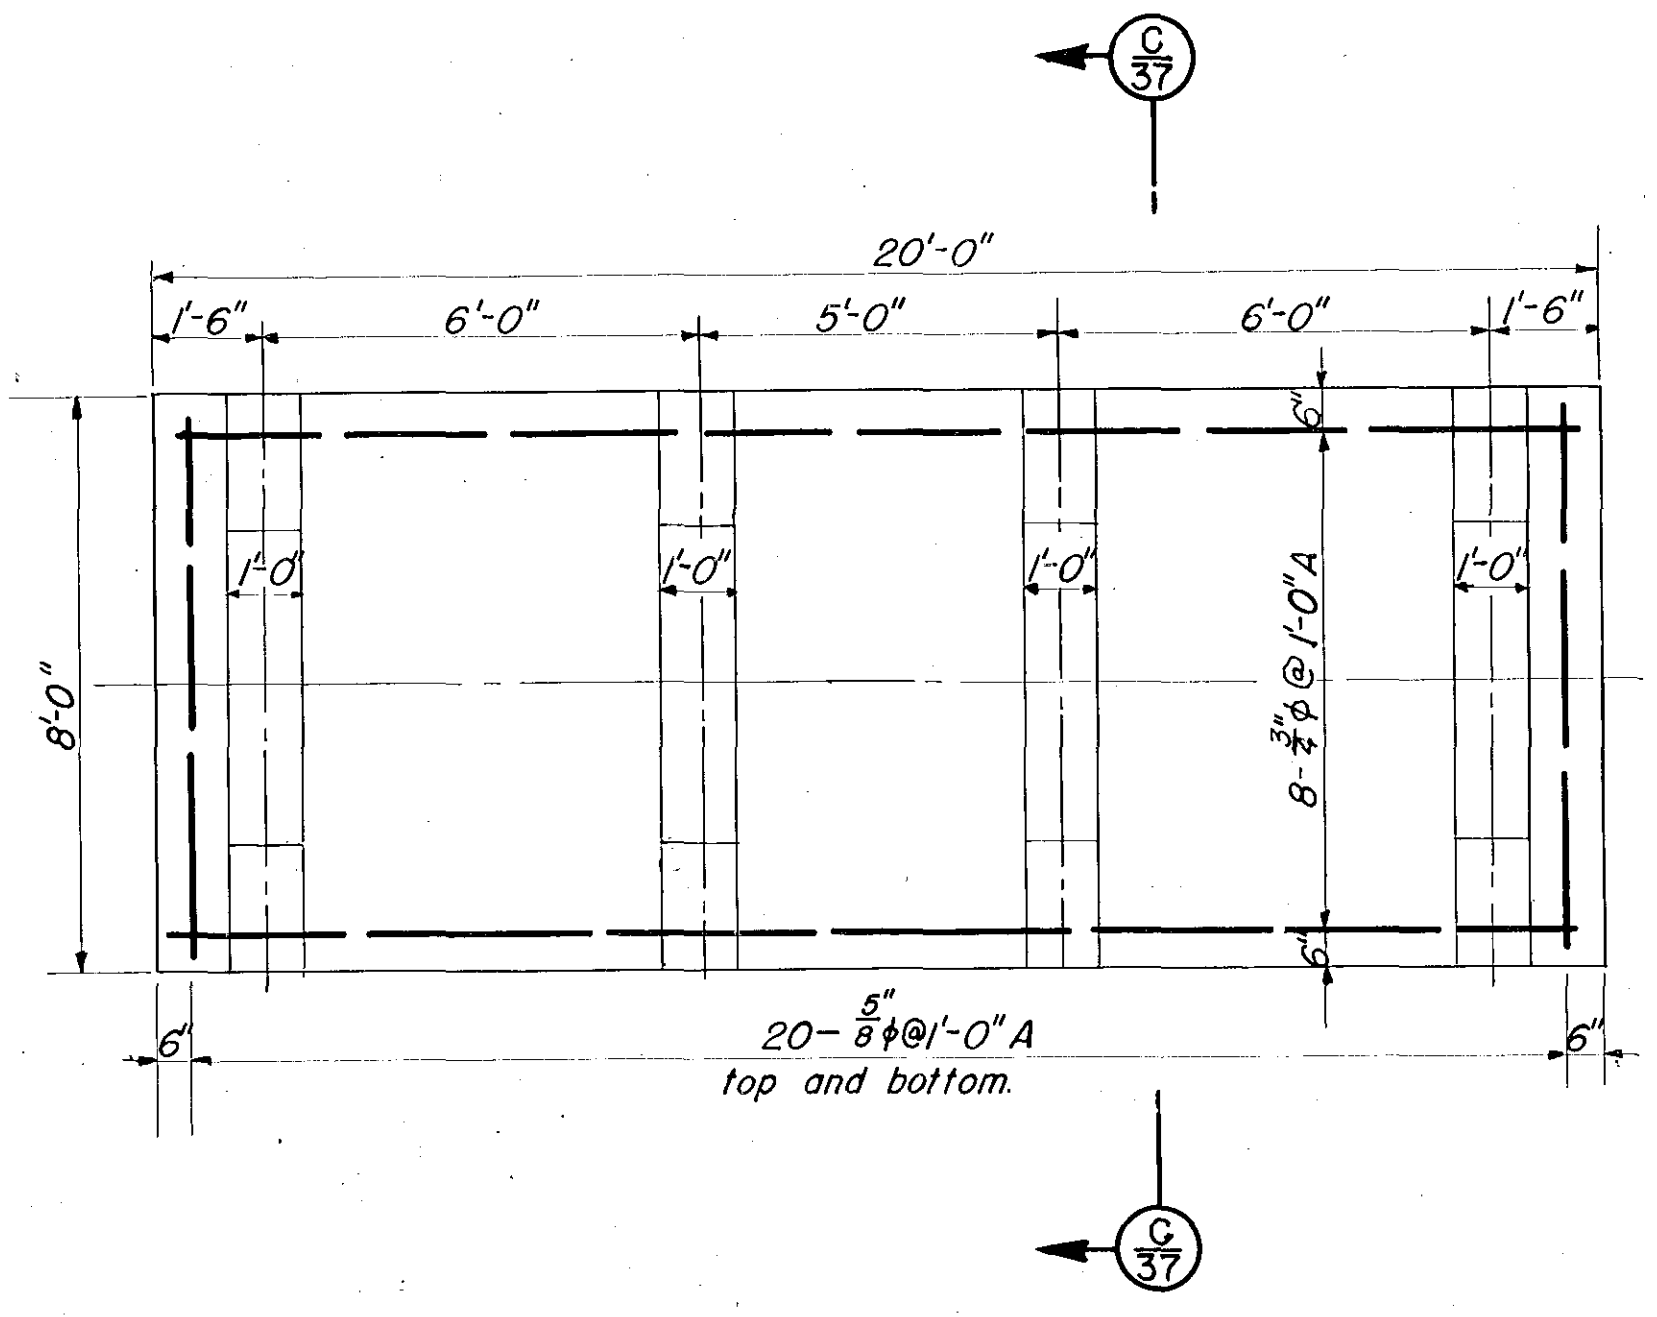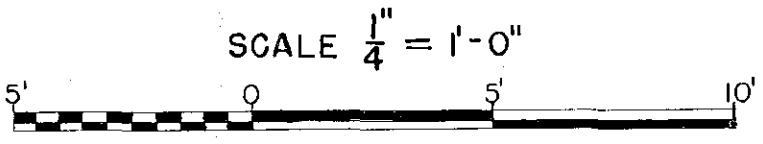

GASOLINE STORAGE TANK BASE-3000 GAL. CAPACITY

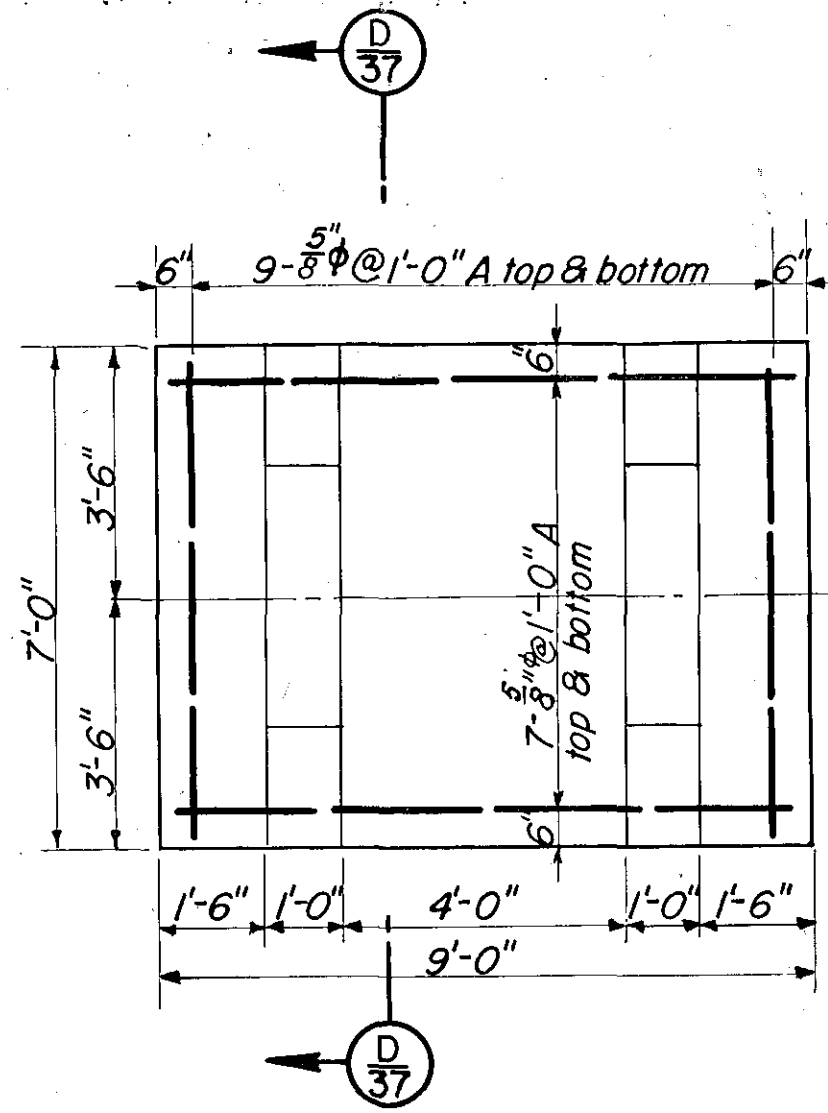

HEATING FUEL OIL STORAGE TANK BASE - 1000 GAL. CAPACITY

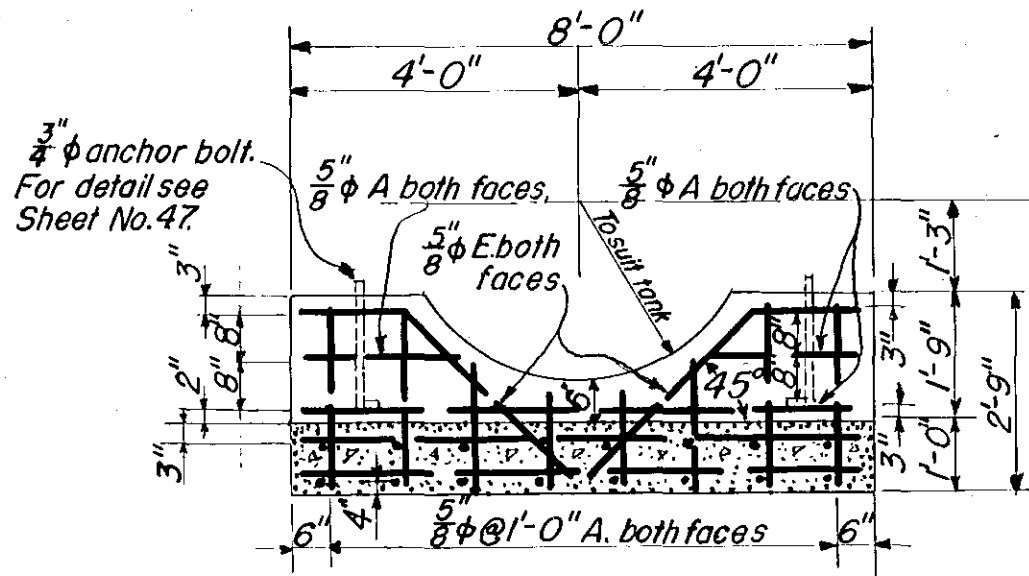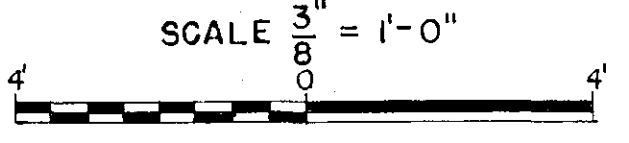

SECTION C 37

SECTION D 37

NOTES

For general notes applying to this sheet, see Sheet No. 22.
For steel reinforcement bending key, see Sheet No. 27.

CONNECTICUT RIVER FLOOD CONTROL			
KEENEY LANE PUMPING STATION			
HARTFORD CONN.			
INTAKE CONDUIT AND TANK BASE DETAILS			
CONNECTICUT RIVER		CONNECTICUT	
IN 60 SHEETS		SCALE 3/8 IN. = 1 FT.	
SHEET NO. 37		SHEET NO. 37	
U. S. ENGINEER OFFICE, PROVIDENCE, R.I., JUNE 1944			
SUBMITTED: E. M. Viner		APPROVED: J. M. Burns	
SENIOR ENGINEER		HEAD ENGINEER	
HEAD, STRUCTURAL SECTION		CHIEF, ENGINEERING DIV.	
PREPARED: H. C. Whittemore		DRAWN: A. L. K.	
STRUCTURAL SUBSECTION		TRACED: G. M. K.	
		CHECKED: C. J. H.	
		FILE NO. CT 4-3251	