
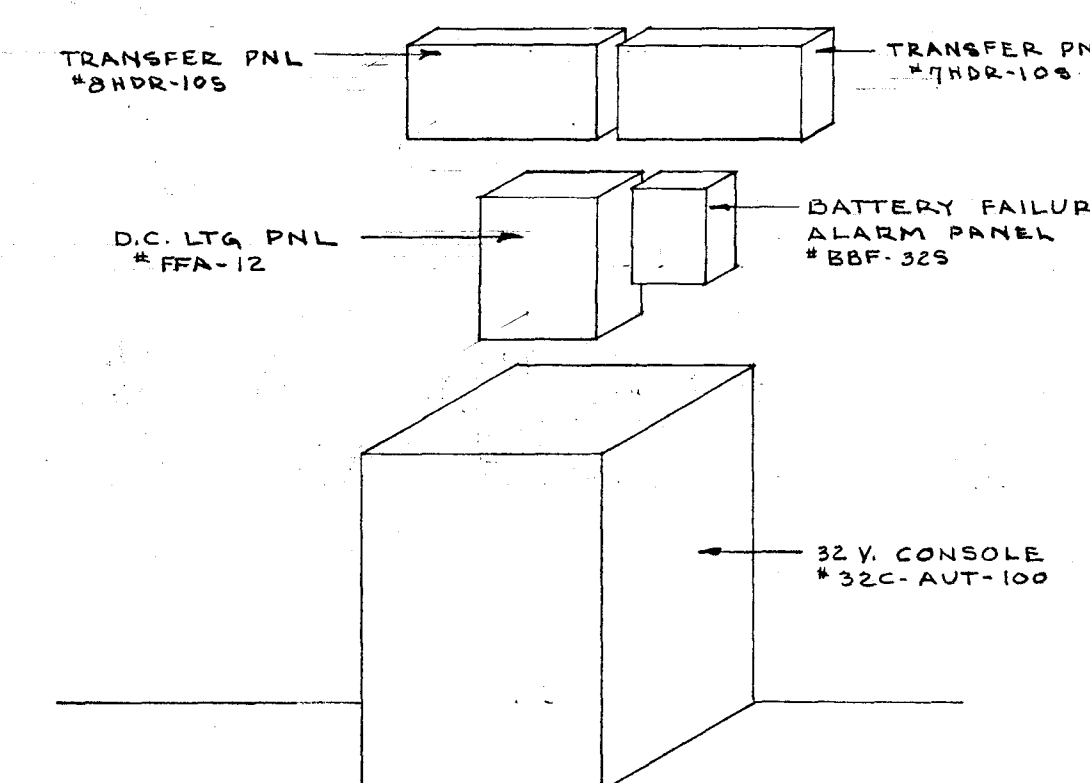


FIXTURE SCHEDULE		
TYPE	MANUFACTURER & CATALOG NO.	LAMPS
A-1	DUAL-LITE *EXT-1245	2-15 CP
B	" *EXT-121	2-32 CP
C-1	" *EXT-124R	2-15 CP
D-1	" *EXT-05	2-15 CP
E	" *EXT-125	2-25 WATT AC. & 3-15 CP.
E-H	" *EXT-125H	" "
E-L	" *EXT-125L	" "
EI	" *EXT-125	" 1-15 CP & 2-32 CP
EI-H	" *EXT-125H	" 1-15 CP & 2-32 CP
EI-L	" *EXT-125L	" " "
EI-R	" *EXT-125R	" " "
EI-WG	" *EXT-125 WG	" " "
E2-RLH	" *EXT-127 RLH	" 3-15 CP

SYMBOL LIST	
SYMBOL	DESCRIPTION
○	EXISTING OUTLET
○	CEILING FIXTURE
○	WALL BRACKET
⊗	EXIT LITE
□	AUX. ALARMS FOR BFA & D.C. LTA PNL'S

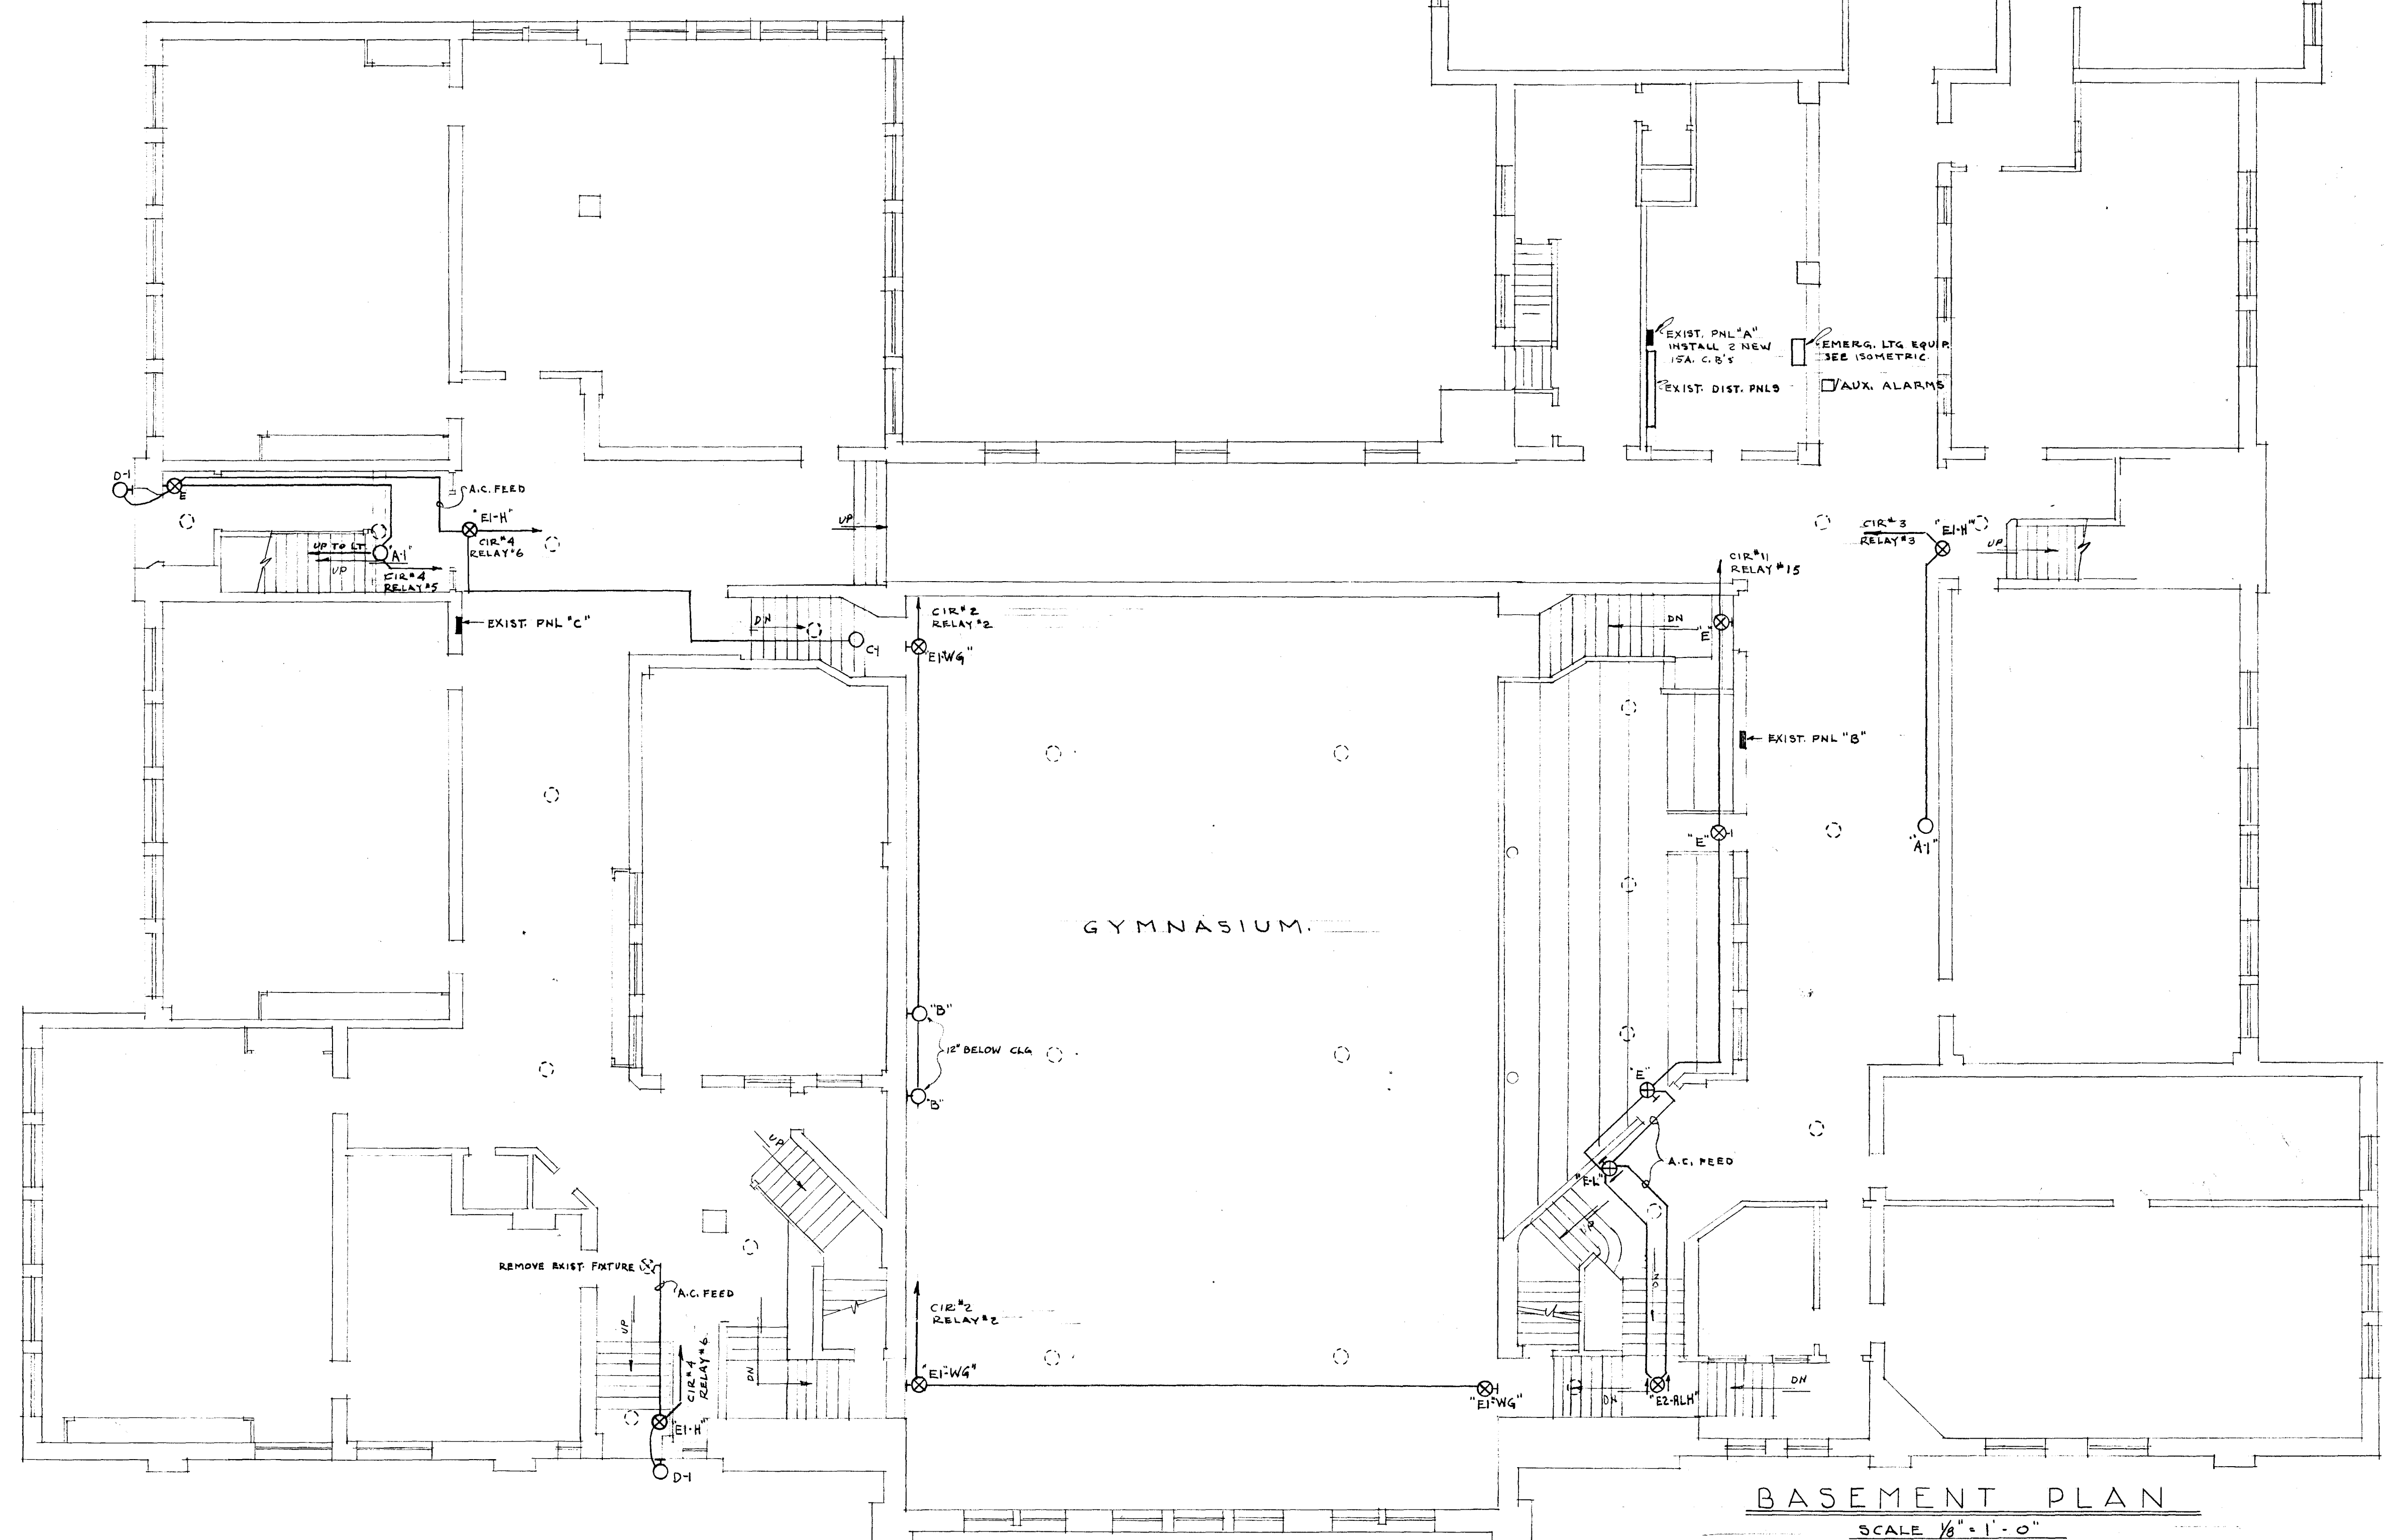

GYMNASIUM		
CITY OF HARTFORD, CONNECTICUT DEPARTMENT OF ENGINEERING		
EMERGENCY LIGHTING FOR		
SARAH J. RAWSON SCHOOL 260 HOLCOMB ST., HARTFORD CONN.		
SUBMITTED David A. Brown	RECOMMENDED David A. Brown	APPROVED David A. Brown
DESIGN R.A.B.	DRAWN R.A.B.	DATE MARCH 10, 1960
TRACED	CHECK	DAYBOOK NO. 09611-D

VERIFY EXISTING
CONDITIONS AND
DIMENSIONS AT
BUILDING

1

58