
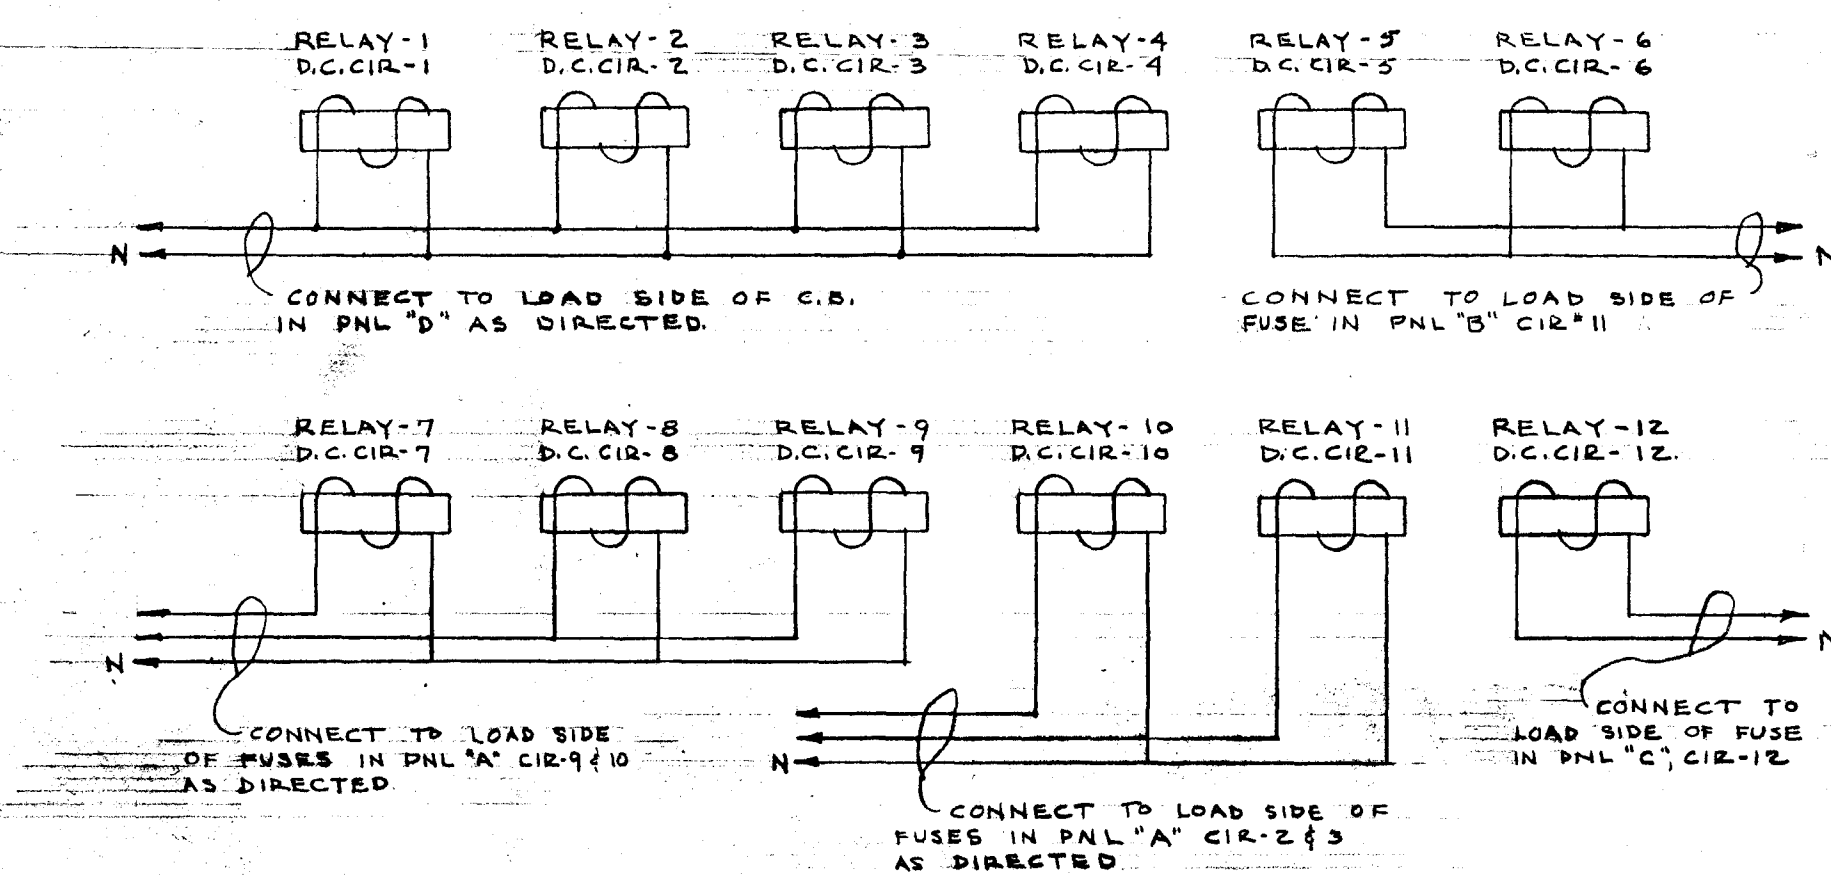
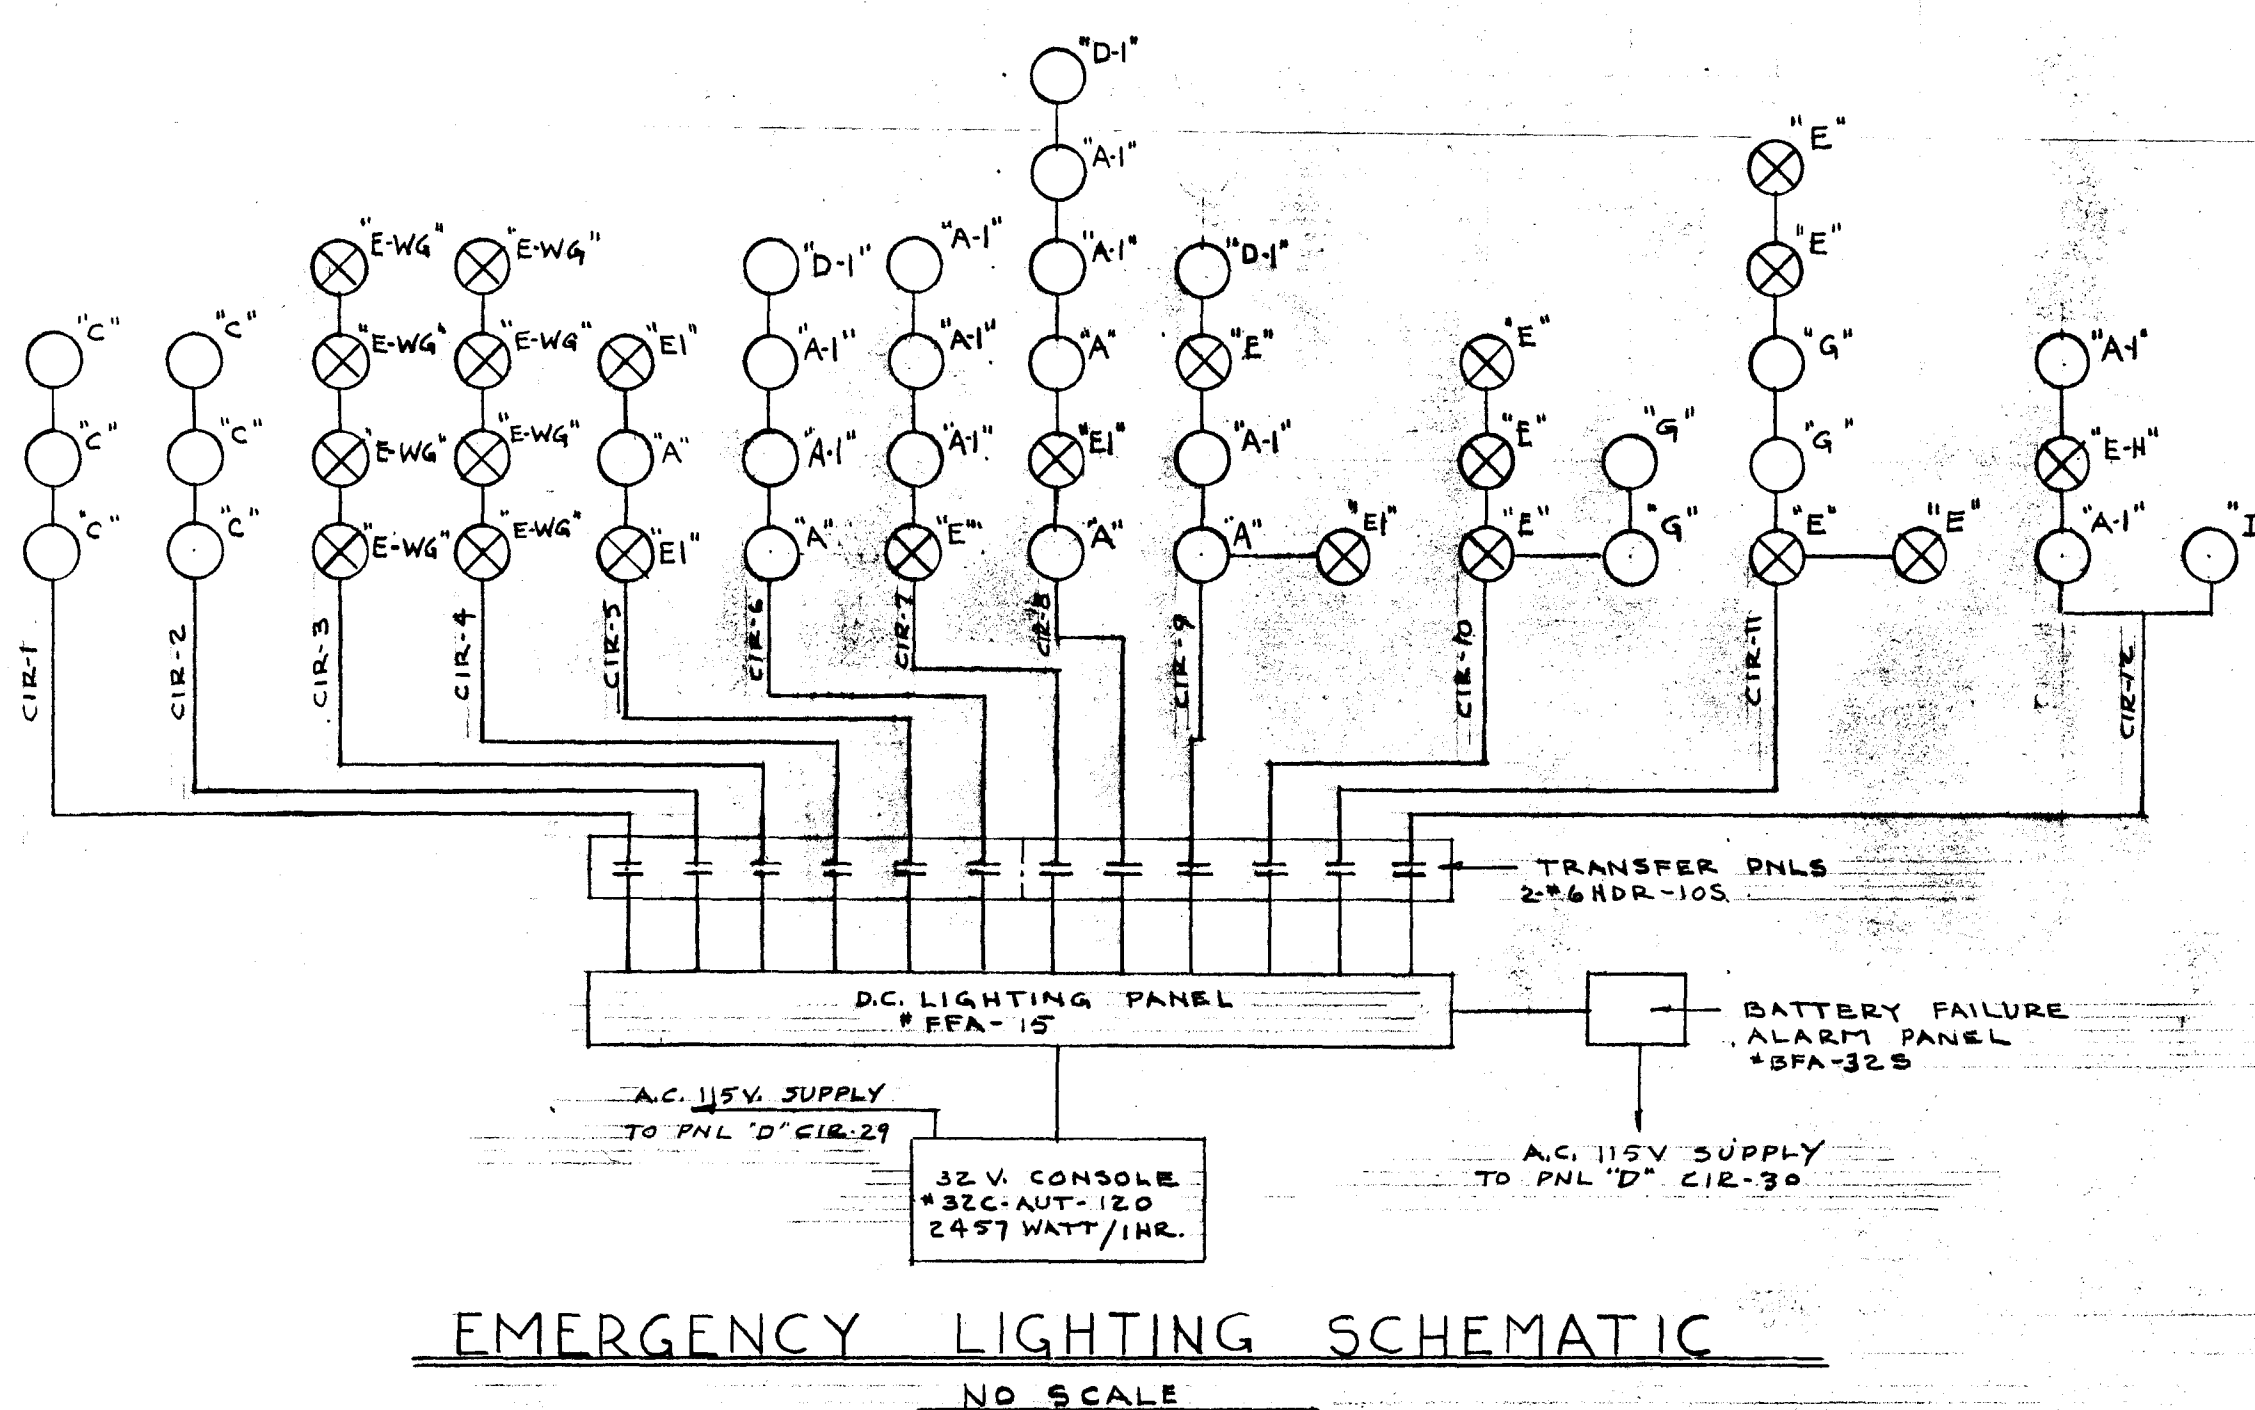
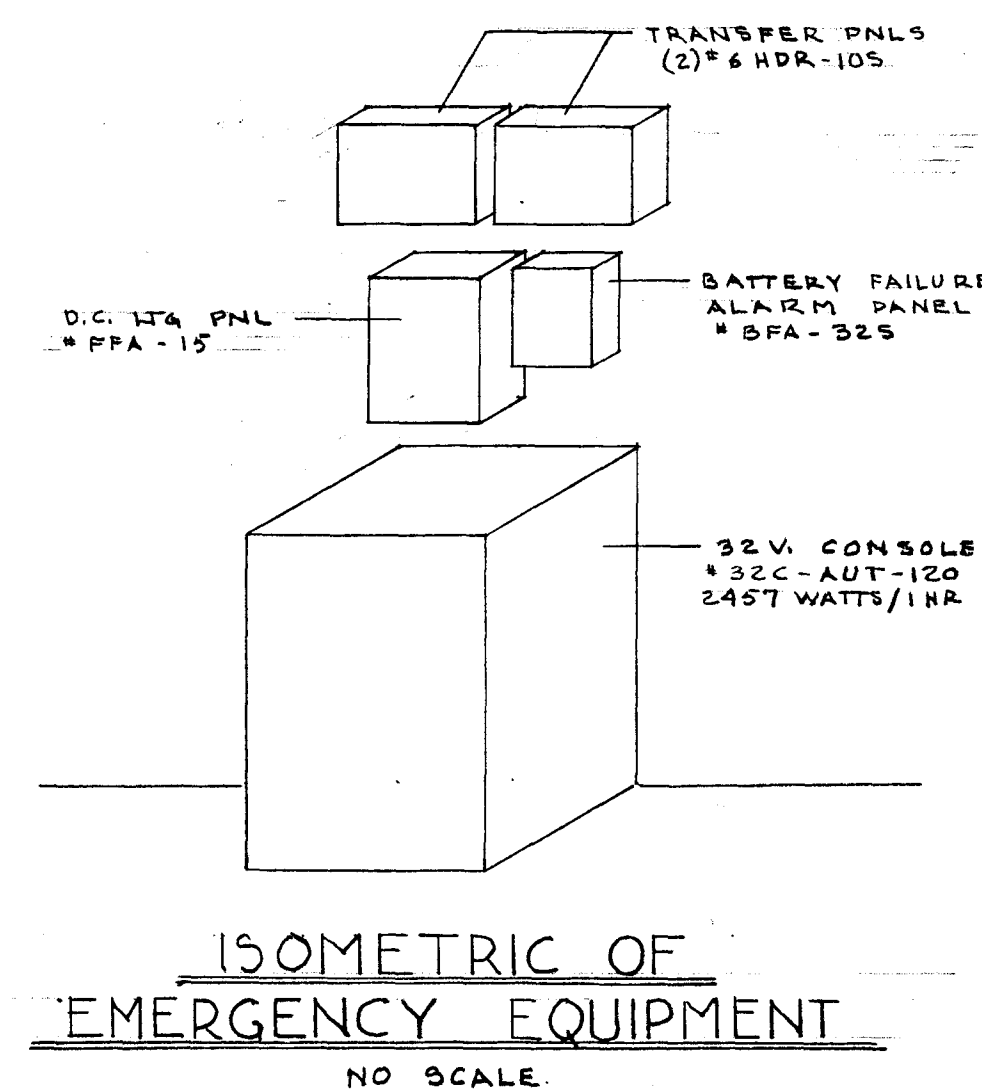
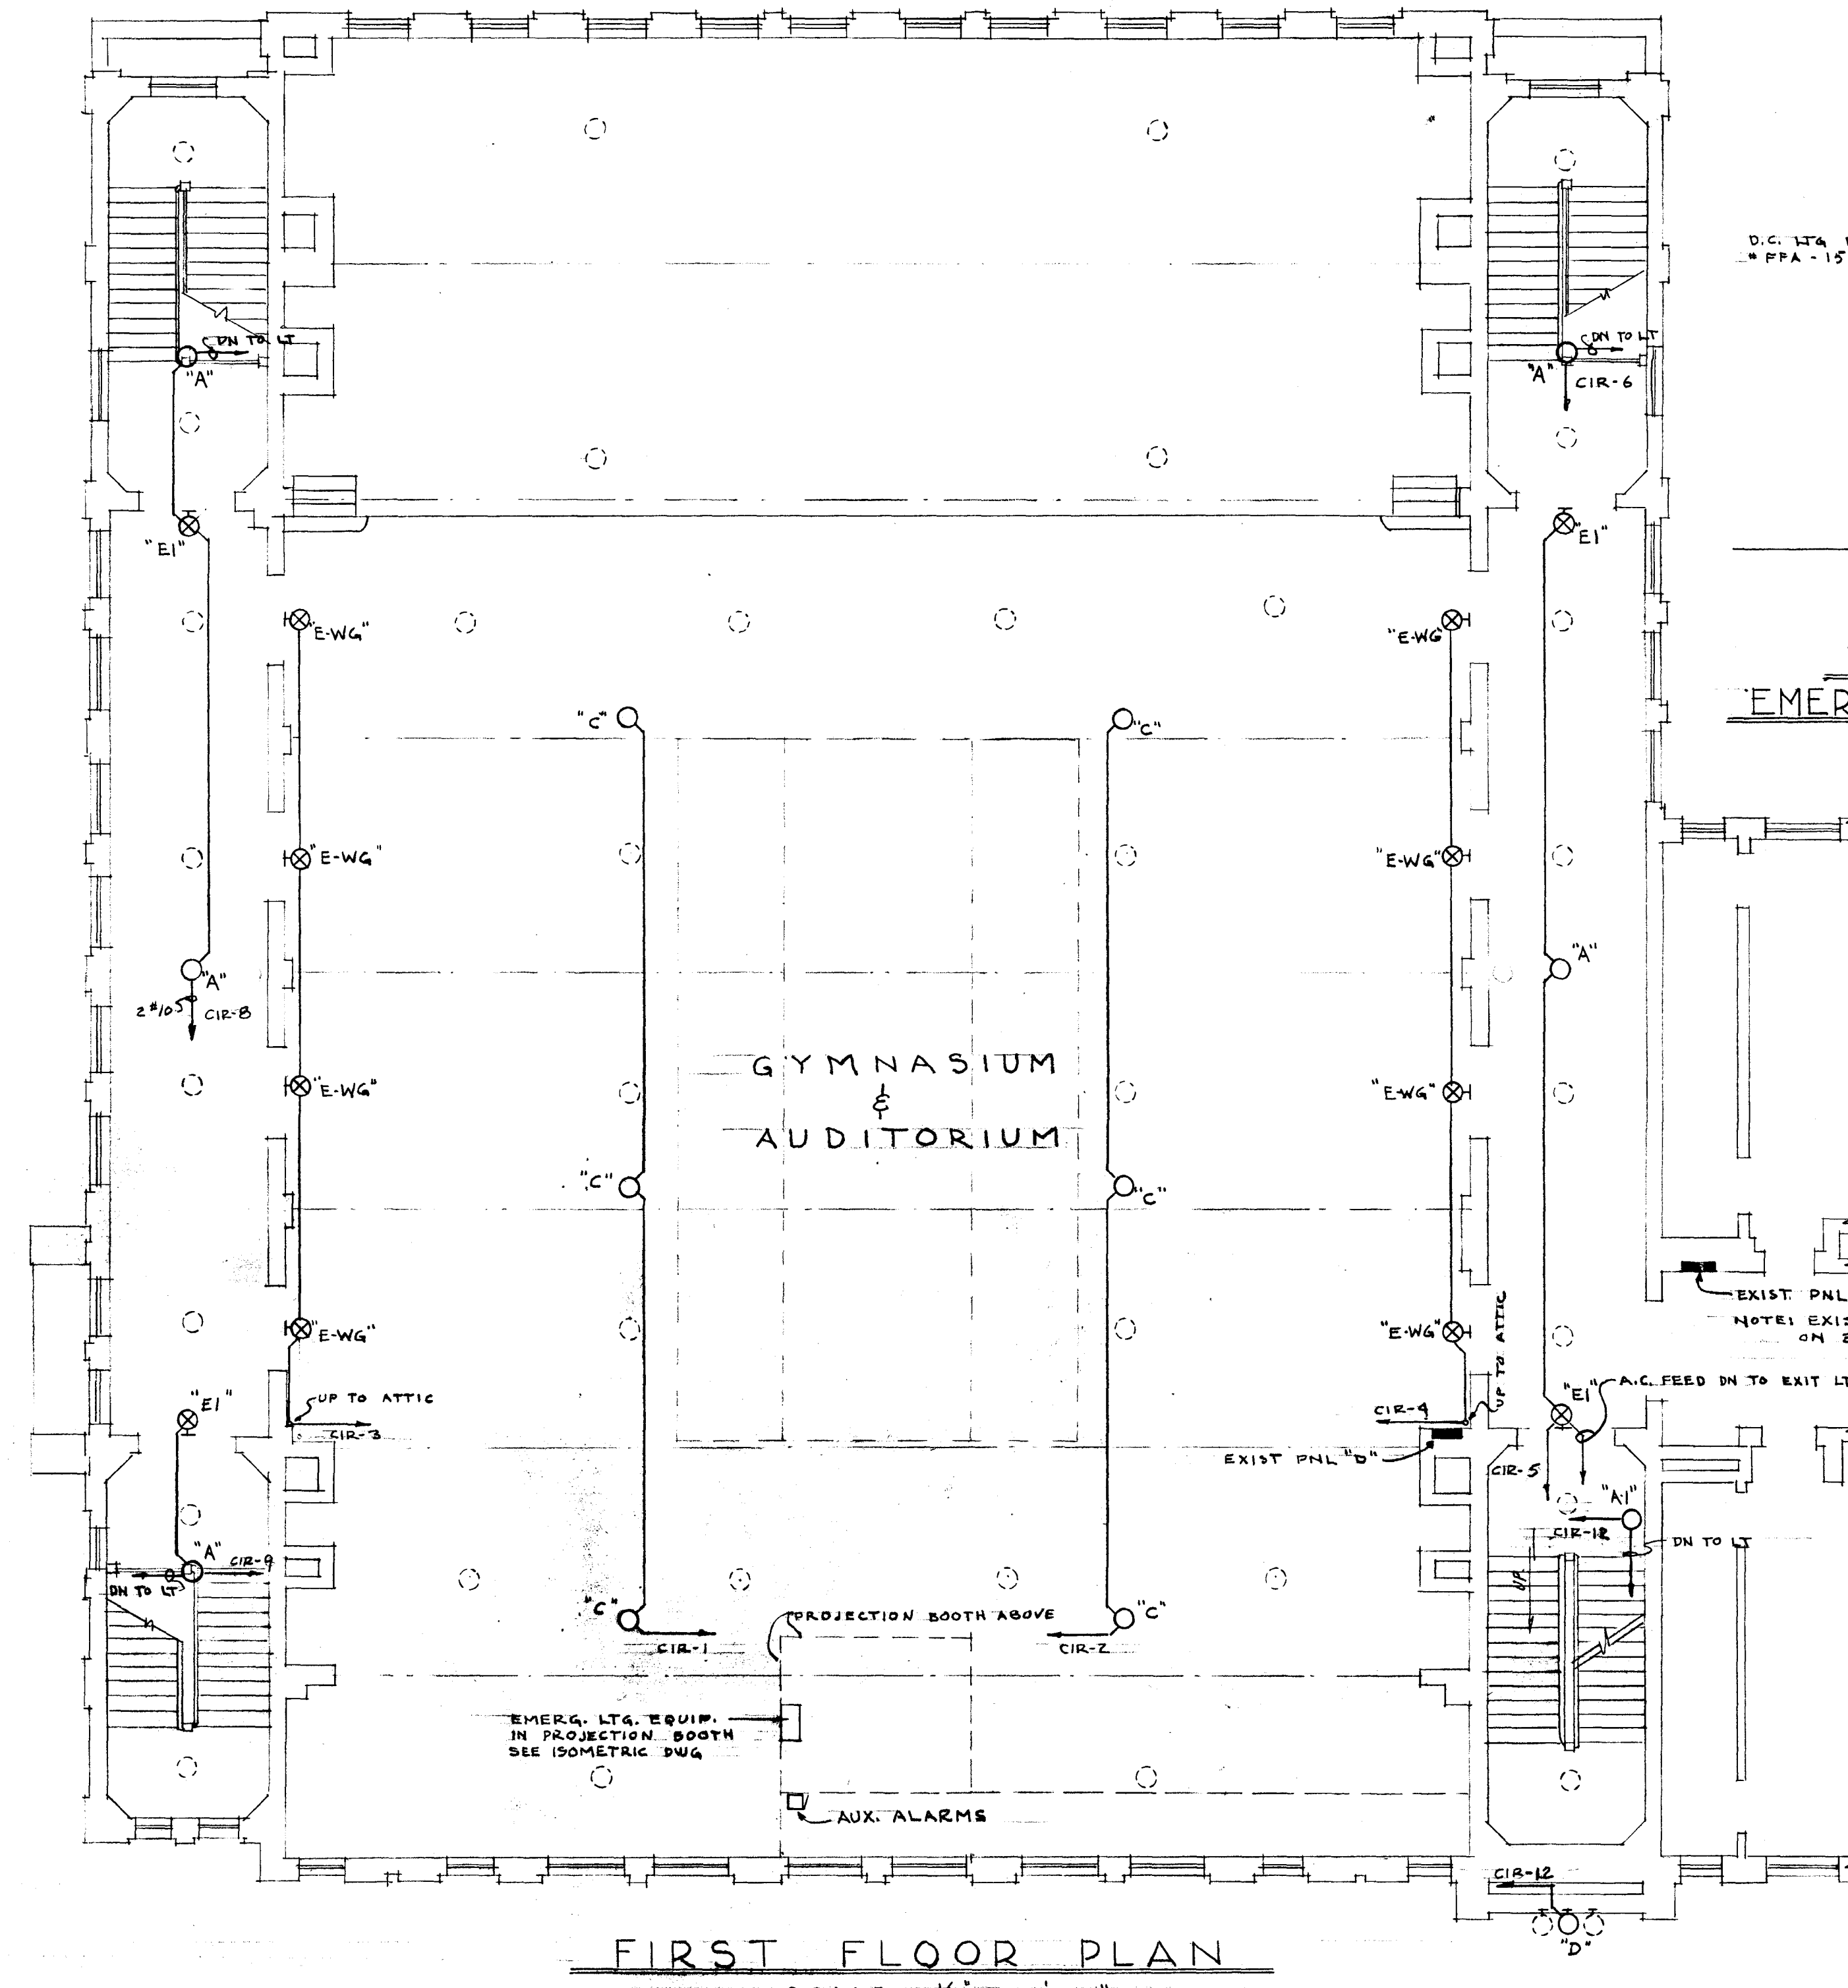


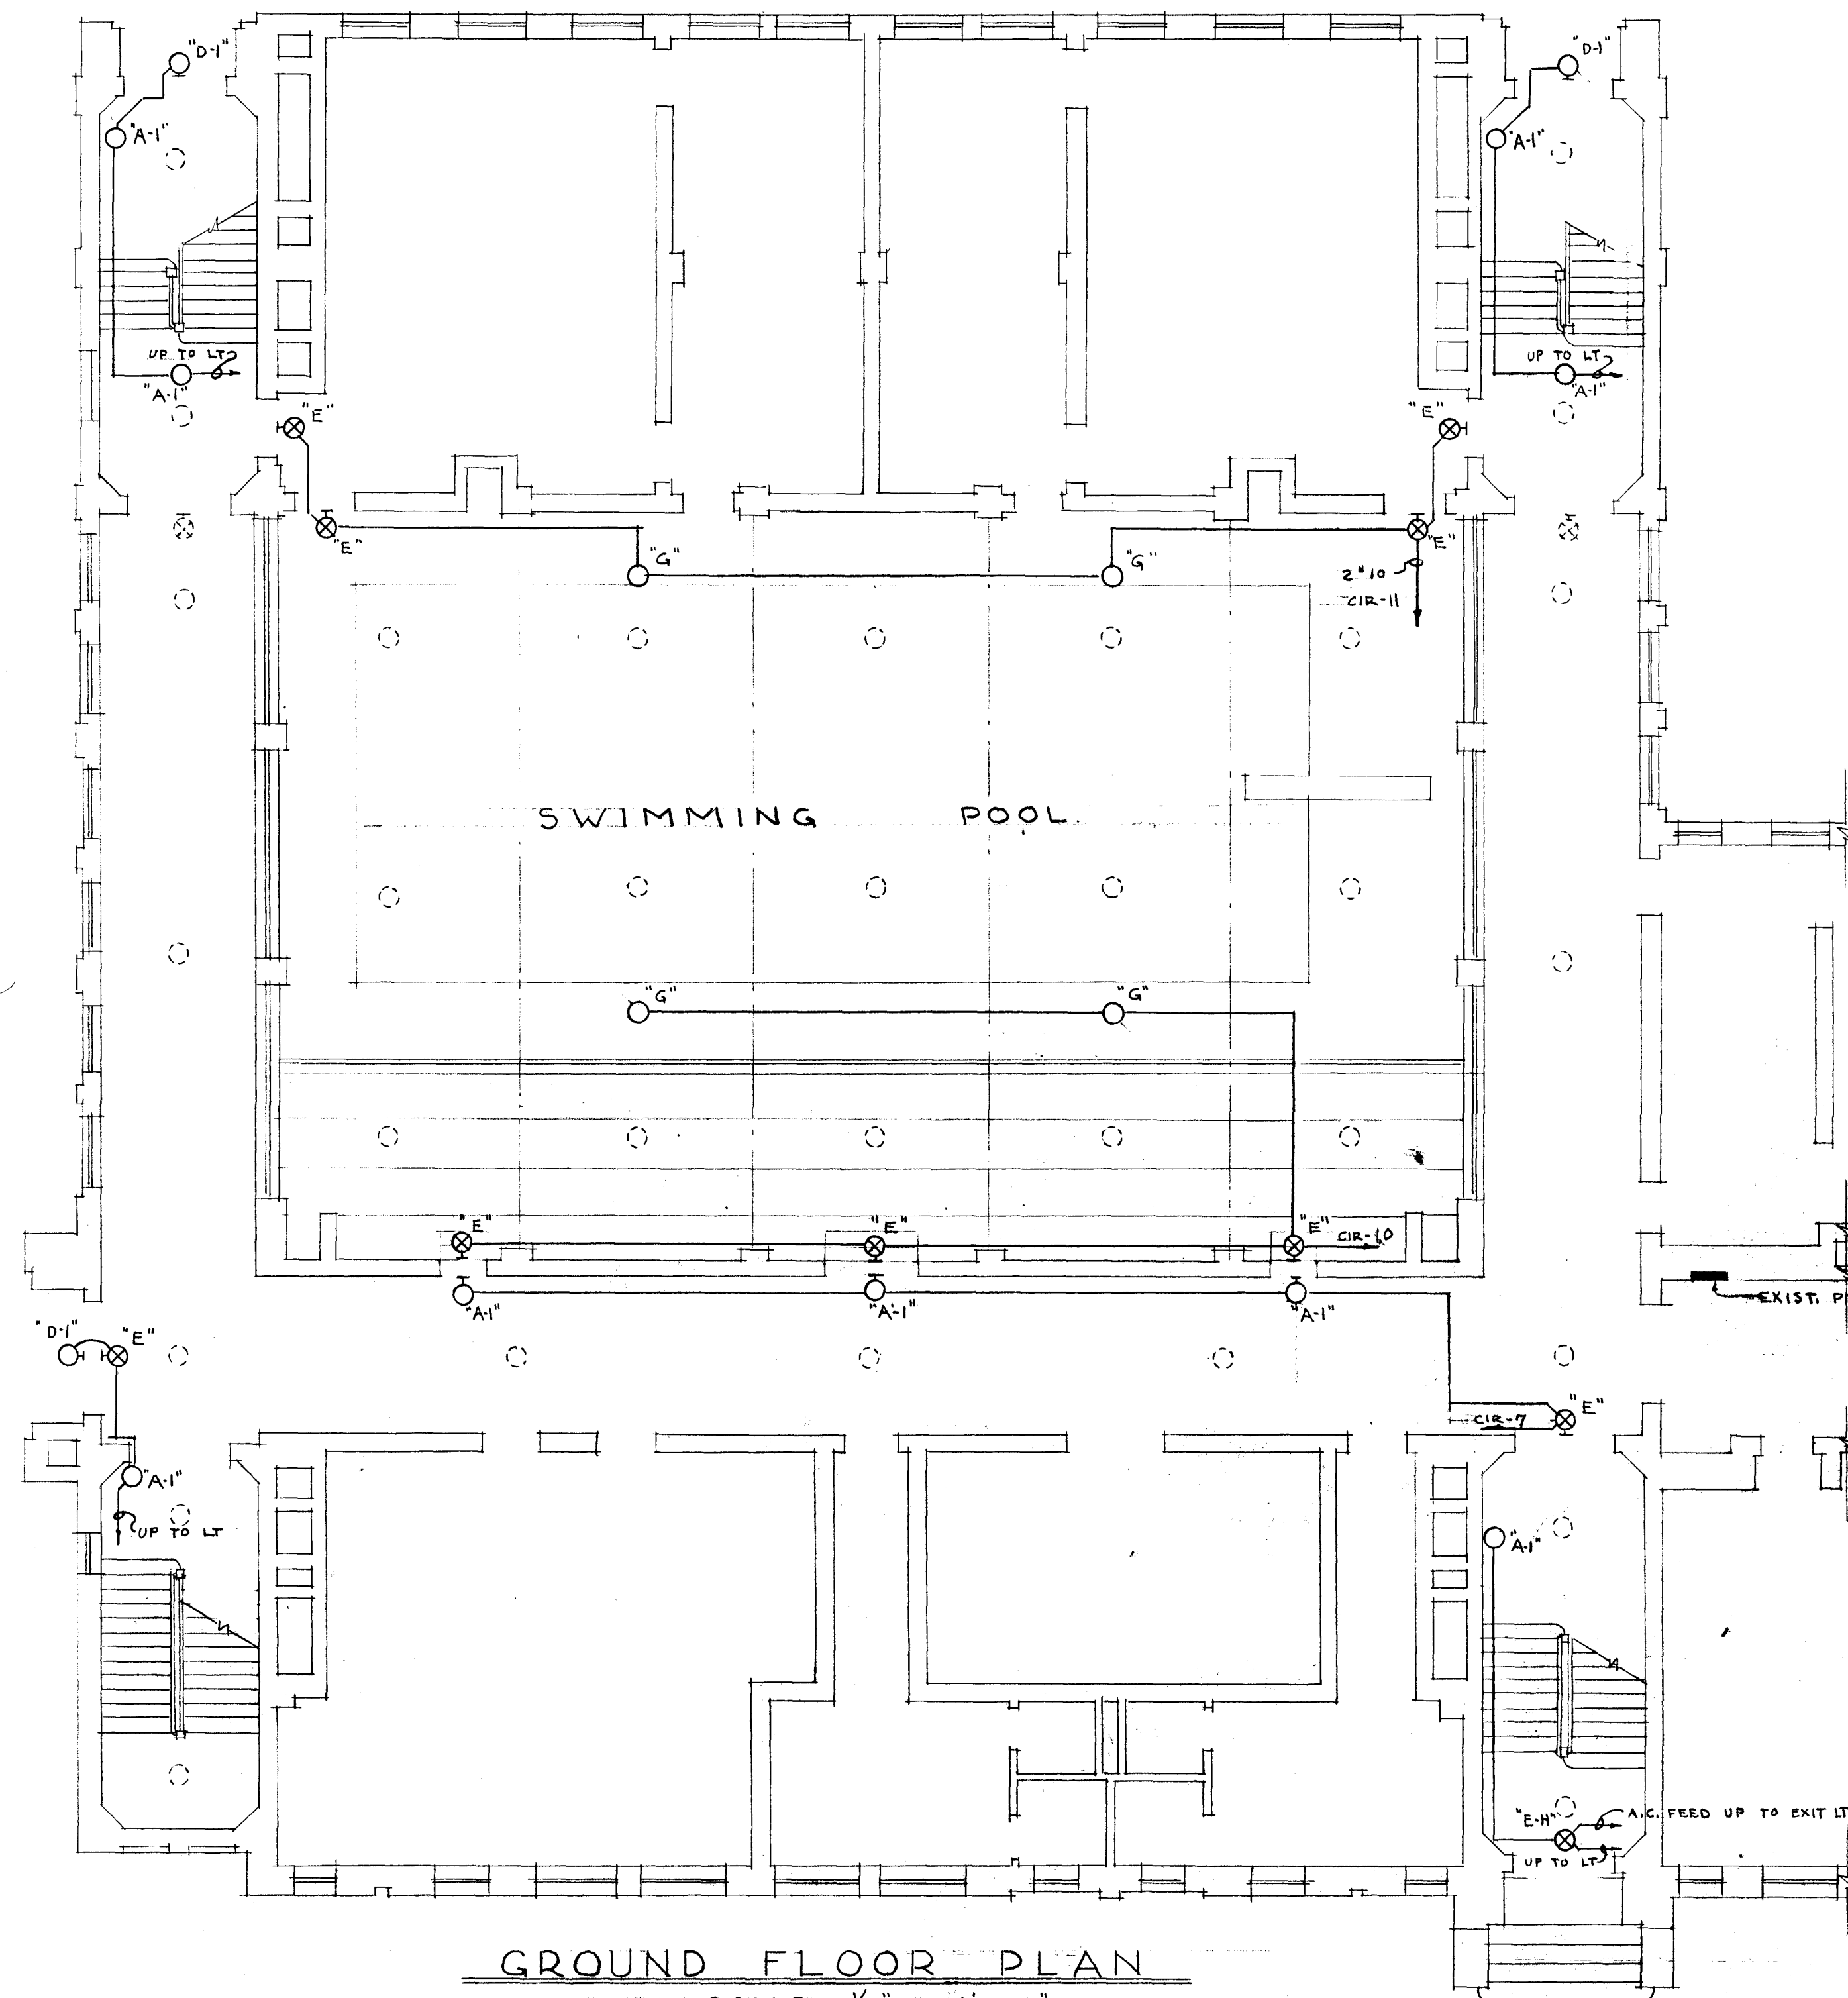

FIXTURE SCHEDULE			
TYPE	MANUFACTURER & CATALOG NO.	LAMPS	
A	DUAL-LITE #EXT-124S	2-32 CP	
A-1	" #EXT-124S	2-15 CP	
C	" #EXT-124R	2-32 CP	
D	" #EXT-OS	2-32 CP	
D-1	" #EXT-OS	2-15 CP	
E	" #EXT-125	2-25 WATT A.C. & 3-15 CP	
E-H	" #EXT-125H	" " " "	
E-WG	" #EXT-125WG	" " " "	
EI	" #EXT-125	" " " "	
G	" #EXT-123S	1-50 CP	

SYMBOL LIST	
SYMBOL	DESCRIPTION
○	EXISTING FIXTURE OR OUTLET
○	CEILING FIXTURE
⊗	WALL BRACKET
⊗	EXIT LIGHT
■	PANELBOARD
□	AUX. ALARMS FOR BFA & D.C. LTG. PNLS.

GYM. & AUD.; POOL

CITY OF HARTFORD, CONNECTICUT
DEPARTMENT OF ENGINEERING

EMERGENCY LIGHTING
FOR
CORNELIUS A. MOYLAN SCHOOL
235 HILLSIDE AV., HARTFORD CONN.

SUBMITTED: [Signature] RECOMMENDED: [Signature] APPROVED: [Signature]
DIVISION ARCHITECT CITY ARCHITECT CITY ENGINEER

DESIGN: R.G.B. DRAWN: R.G.B. DAYBOOK NO. 09612-D
TRACED: CHECK: DATE: MARCH 10, 1960

VERIFY EXISTING
CONDITIONS AND
DIMENSIONS AT
BUILDING