

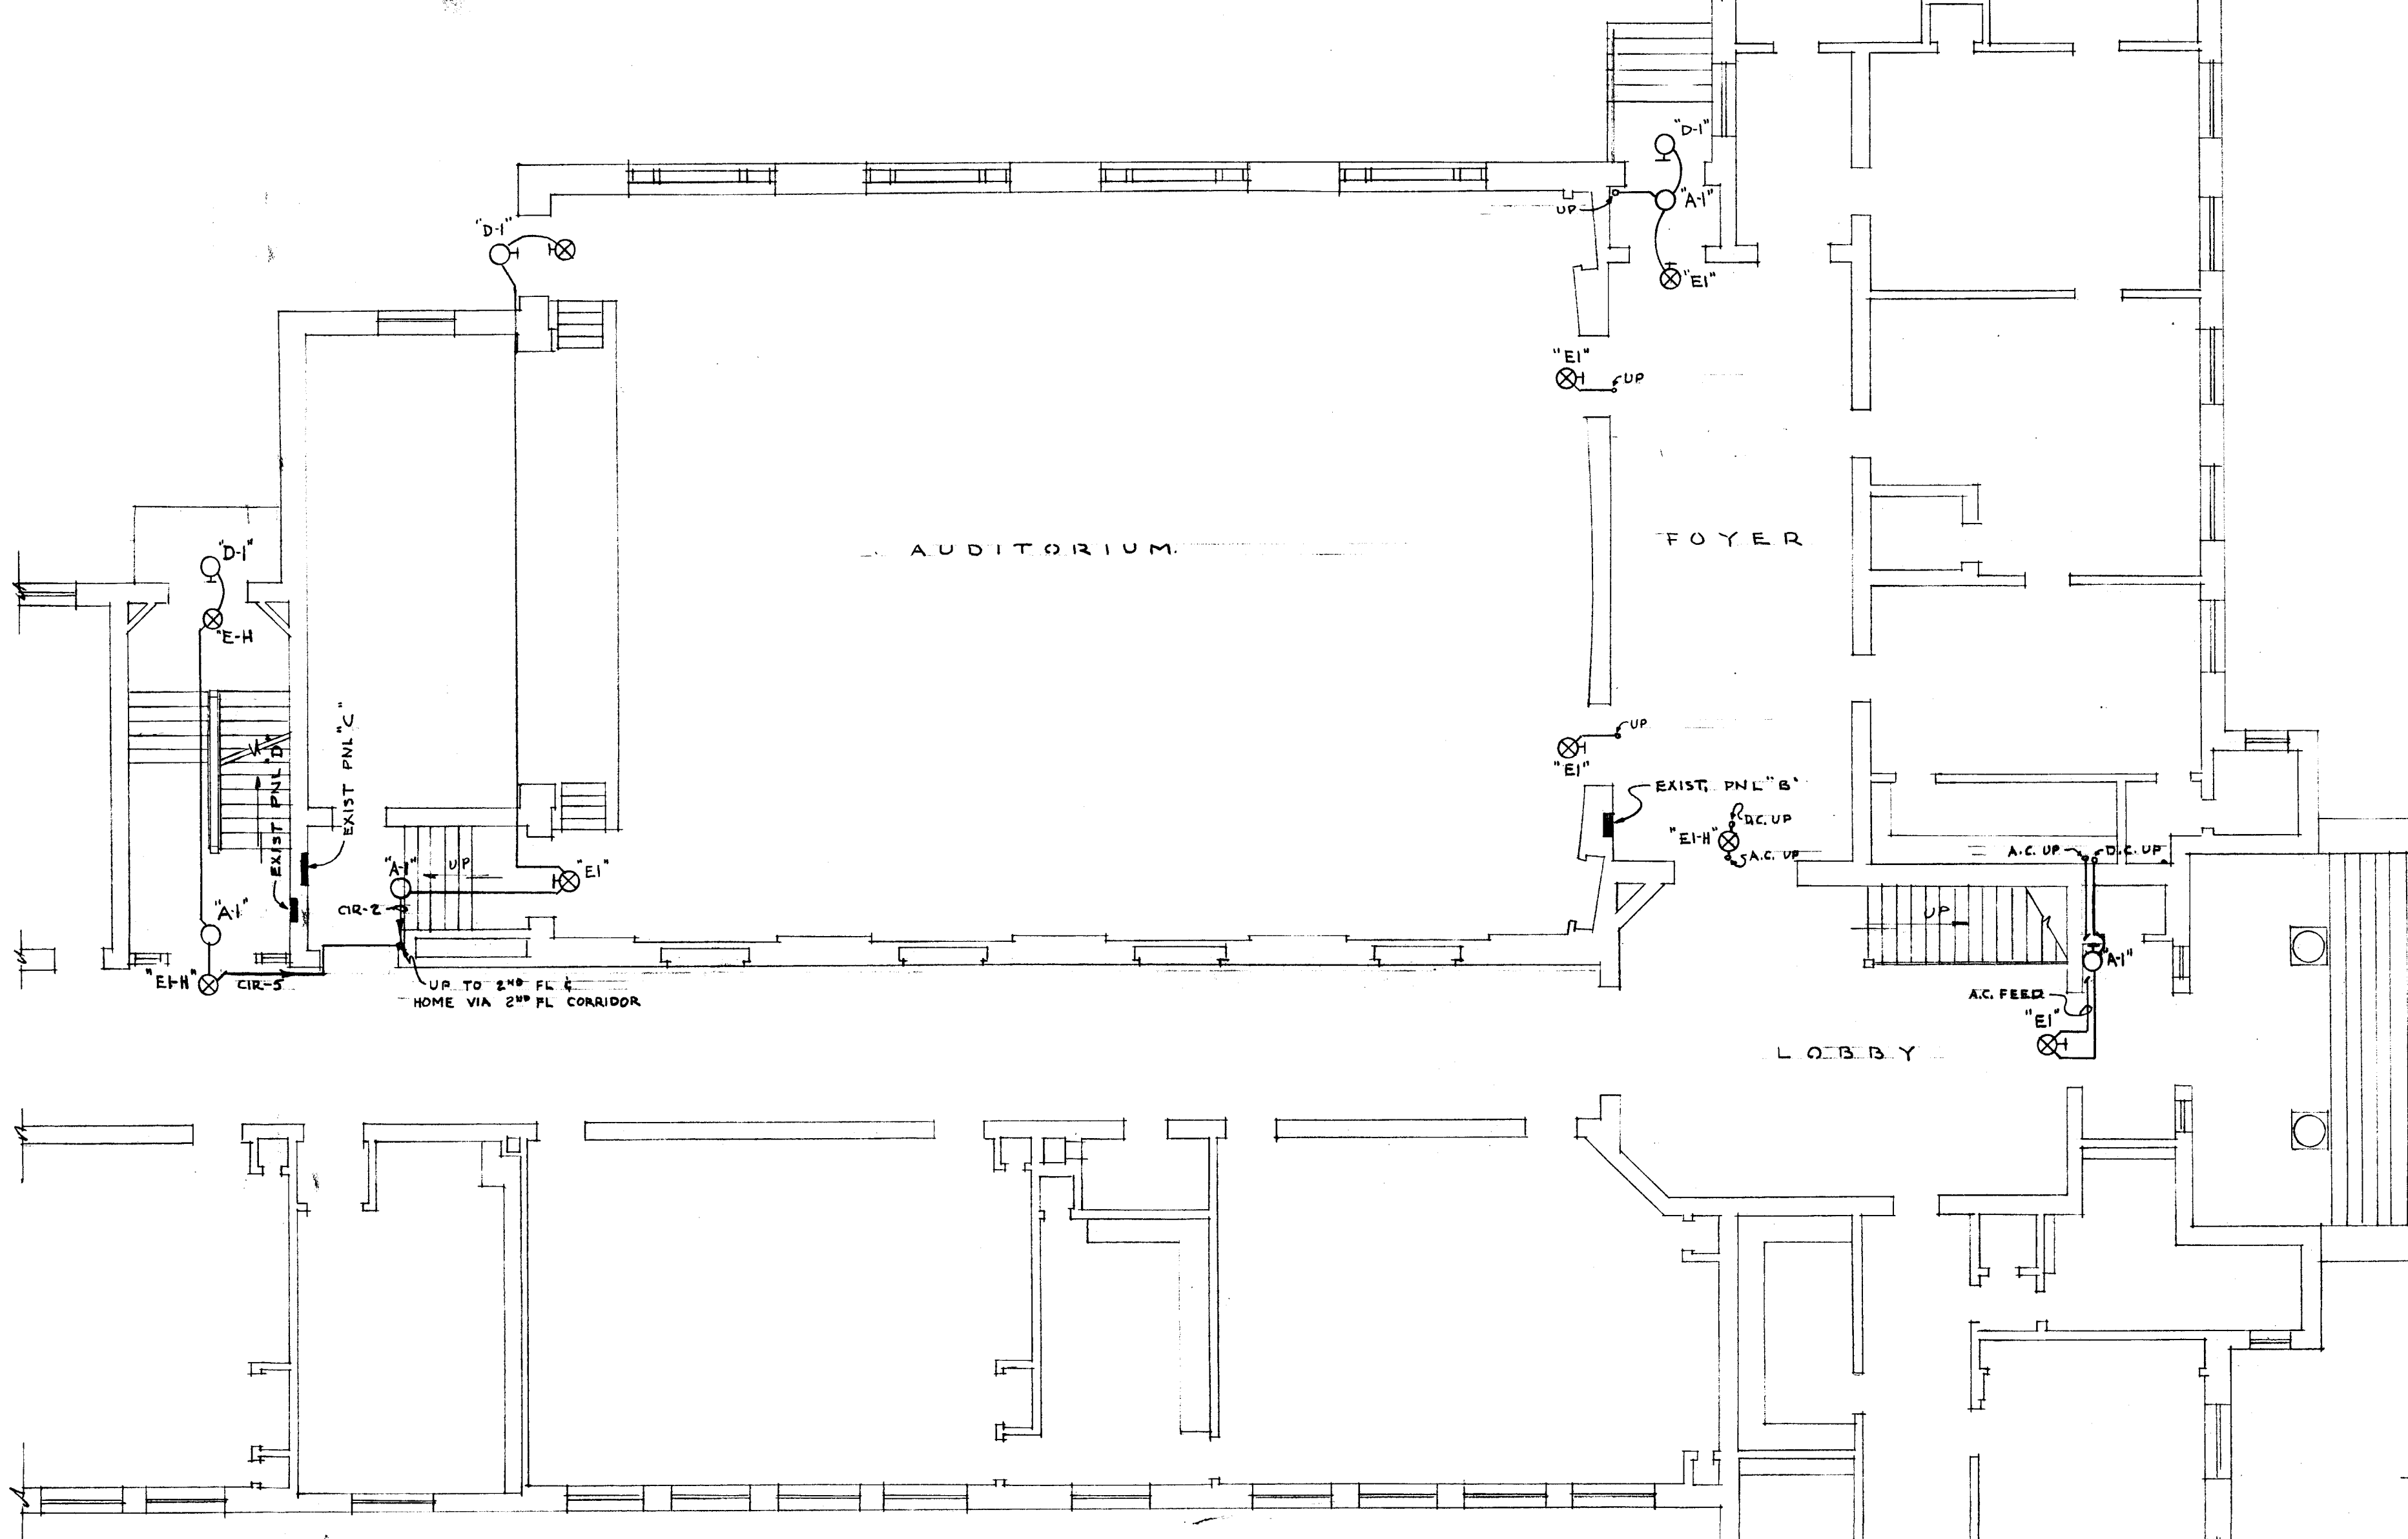
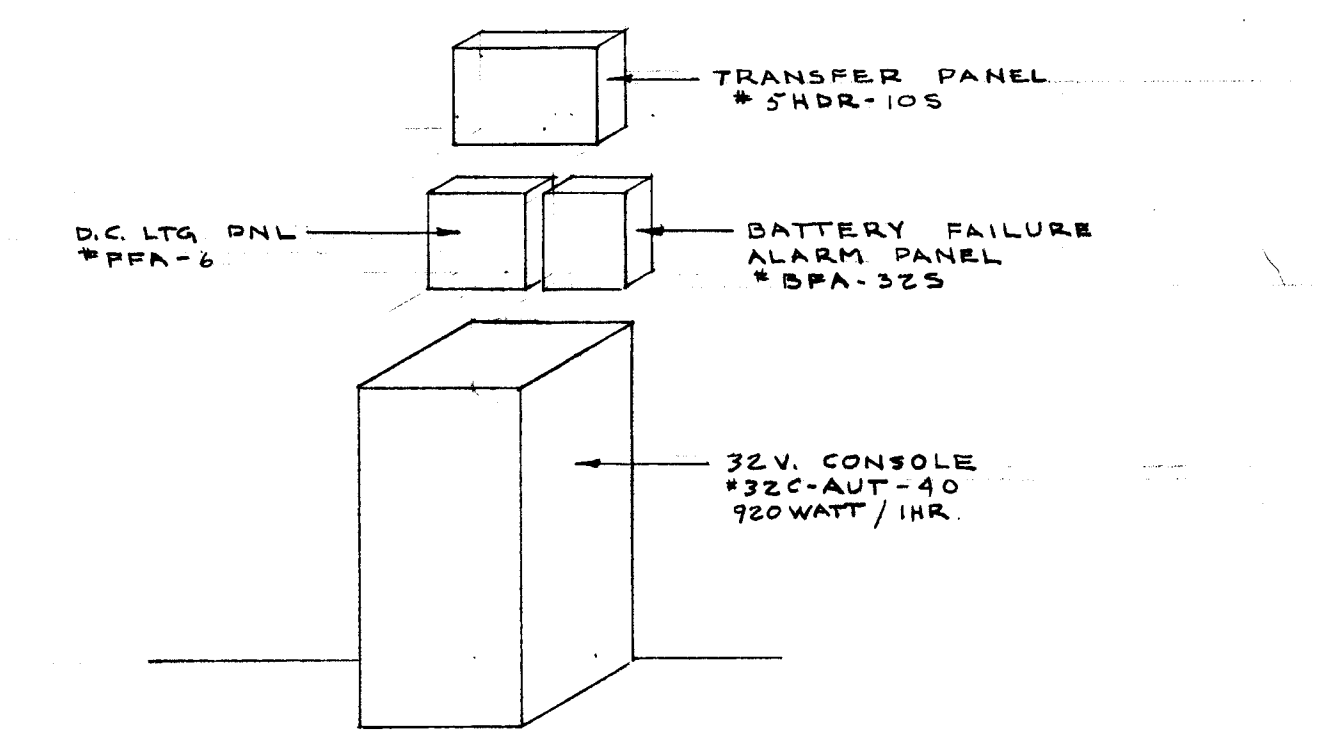
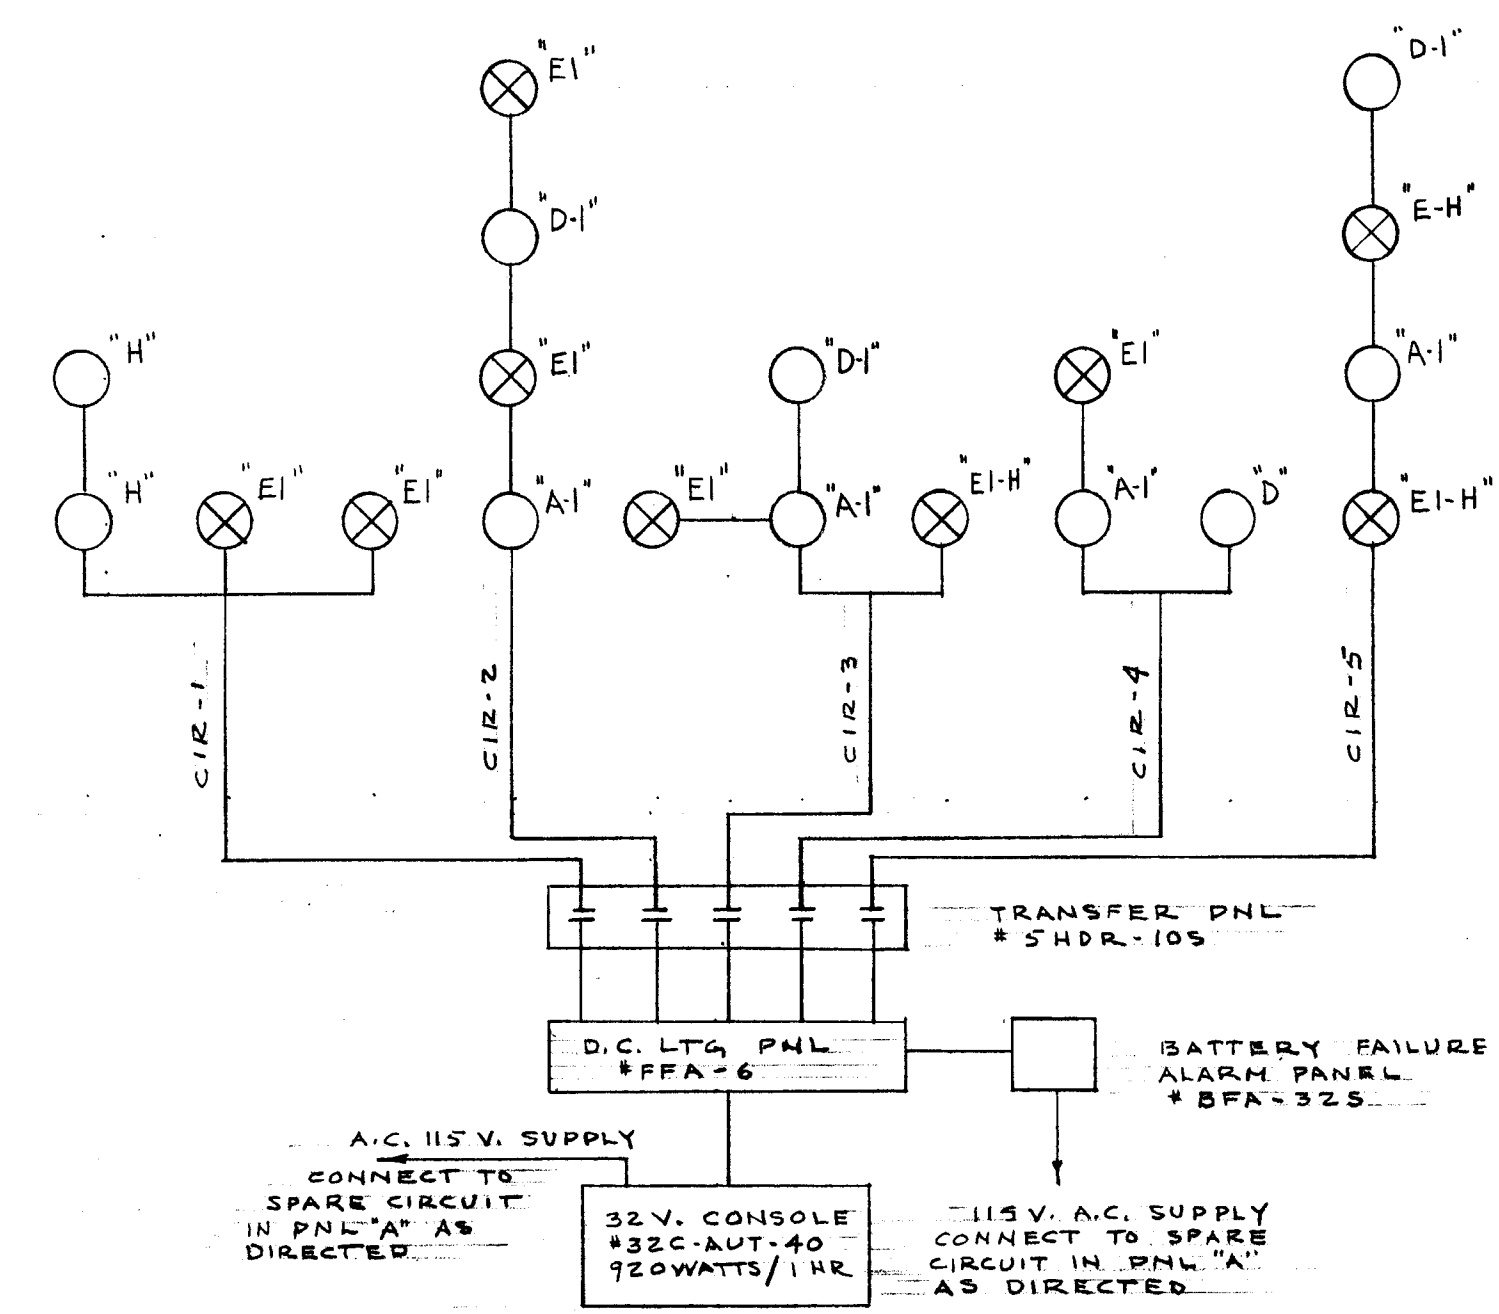


SYMBOL LIST	
SYMBOL	DESCRIPTION
○	CEILING OUTLET-EXISTING
○	CEILING FIXTURE
⊗	WALL BRACKET
⊗	EXIT LIGHT
⊙	JUNCTION BOX
■	PANELBOARD
□	AUX. ALARMS FOR BFA & D.C. LTG PNL'S.

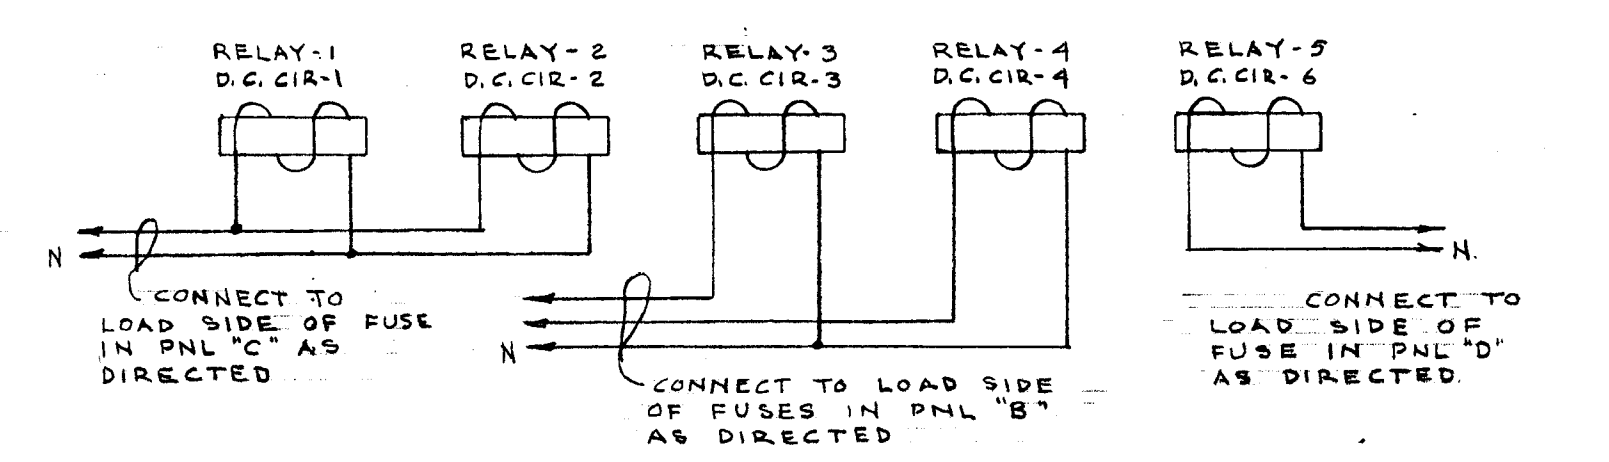

FIXTURE SCHEDULE		
TYPE	MANUFACTURER & CATALOG N°	LAMPS
A	DUAL-LITE #EXT-1245	2-32 CP
A-1	" #EXT-1245	2-15 CP
B	" #EXT-121	1-50 CP
D	" #EXT-05	2-32 CP
D-1	" #EXT-05	2-15 CP
E	" #EXT-125	2-25 WATT AC & 3-15 CP
E-H	" #EXT-125H	" " " "
E-I	" #EXT-125	" 1-15 CP & 2-32 CP
E-H	" #EXT-125H	" " " "
E-HG	" #EXT-125W4	" " " "
E2-DH	" #EXT-127 DH	" 3-15 CP
H	" #EXT-S6WDF	1-50 CP

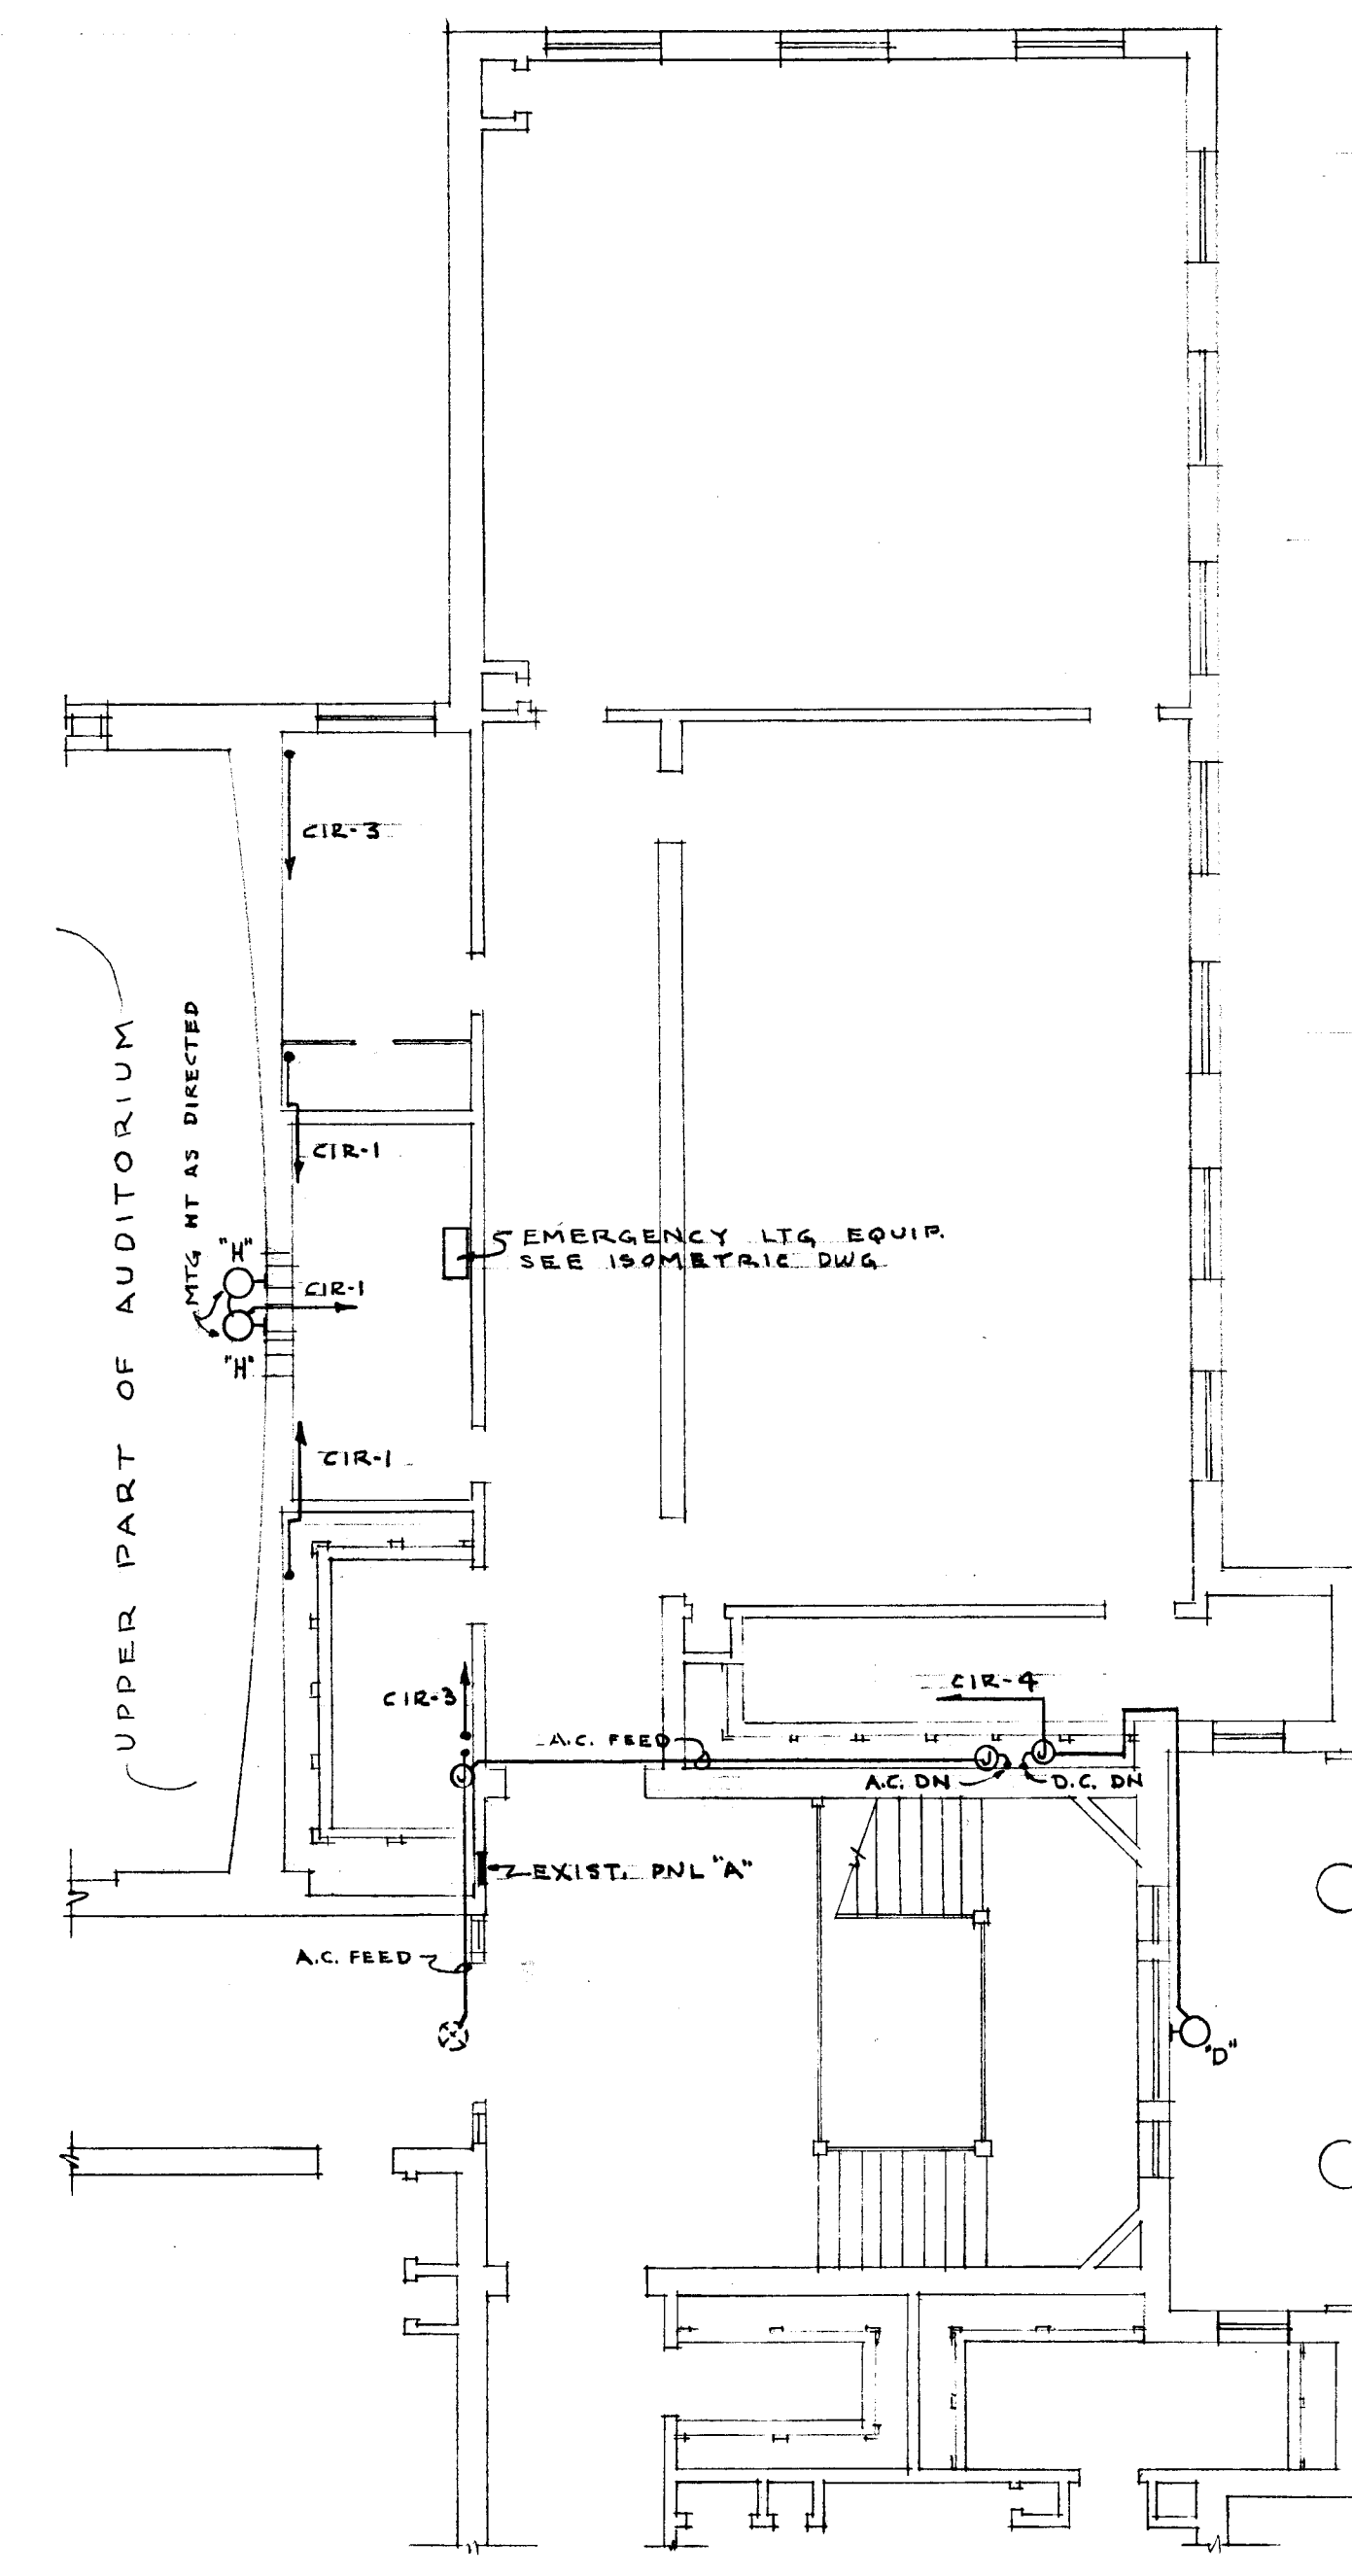

AUDITORIUM
CITY OF HARTFORD, CONNECTICUT
DEPARTMENT OF ENGINEERING

EMERGENCY LIGHTING FOR
WEST MIDDLE SCHOOL
927 ASYLUM AV., HARTFORD CONN

SUBMITTED DIVISION ARCHITECT	RECOMMENDED CITY ARCHITECT	APPROVED CITY ENGINEER
DESIGN R.G.B.	DRAWN R.G.B.	DAYBOOK NO. 09612-1
TRACED	CHECK	DATE MARCH 10, 1960

VERIFY EXISTING
CONDITIONS AND
DIMENSIONS AT
BUILDING