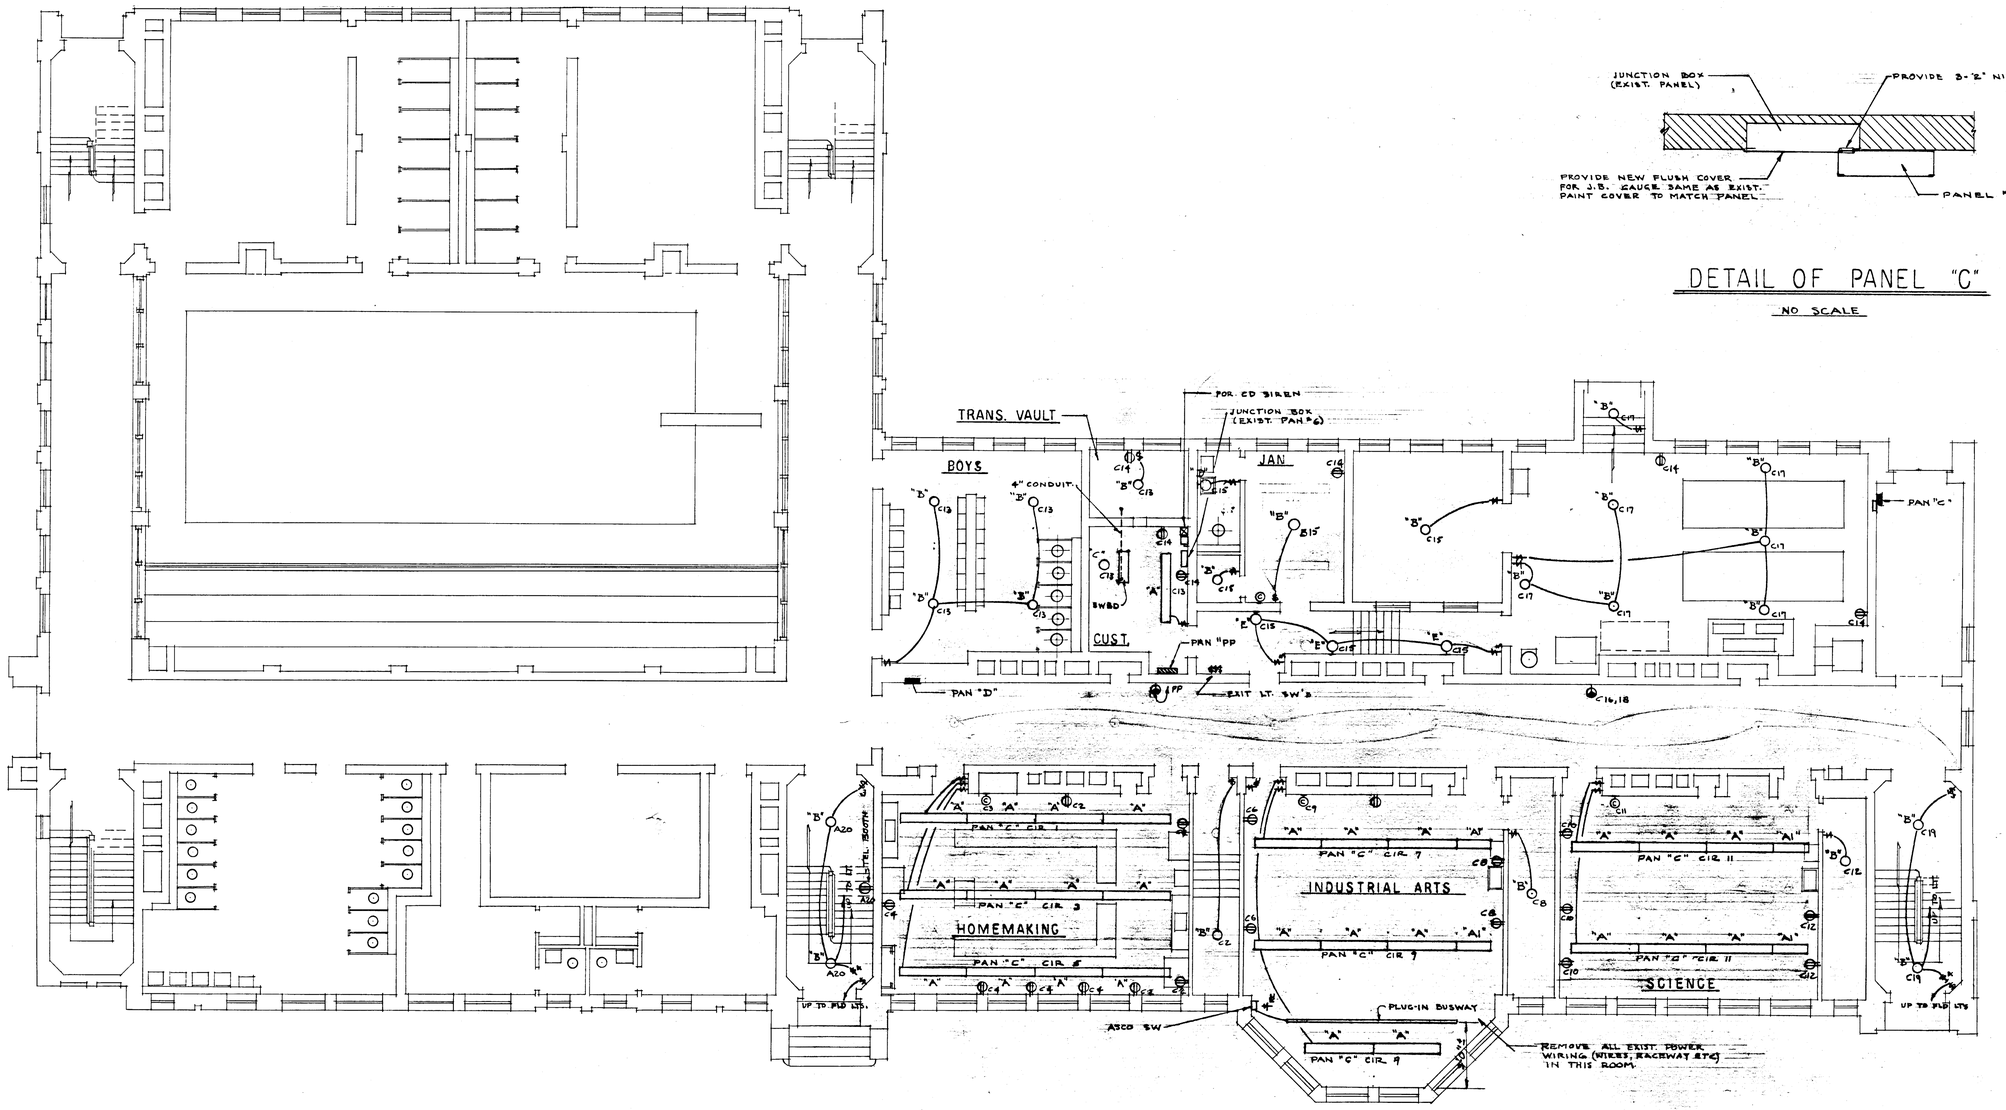

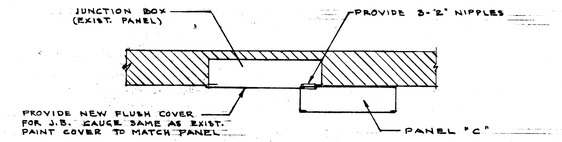

DETAIL OF PANEL "C"

NO SCALE

BASEMENT PLAN

SCALE 1/8" = 1' - 0"

NOTE: ALL CLOCK OUTLETS TO BE FED FROM LT. SW's.

FIXTURE SCHEDULE

TYPE	MANUFACTURER & CATALOG NO.	MOUNTING	LAMPS
A	SEE SPECIFICATION	SEE SPECIFICATION	4-48" T12-40W-RS
A1	SEE SPECIFICATION	SEE SPECIFICATION	2-48" T12-40W-RS
B	EXISTING - PROVIDE NEW FIXTURE WIRE		
C	H & H # 860	BOX MOUNTED	1-100W-INCAND I.P.
D	LIGHTOLIER # 7158	WALL MOUNTED UP - 6'-6"	1-48" T12-40W-RS
E	PRESCOLITE # WB-24	WALL MOUNTED UP 7'-6"	1-100W INCAND. I.P.

VERIFY EXISTING CONDITIONS AND DIMENSIONS AT BUILDING

CITY OF HARTFORD, CONNECTICUT
DEPARTMENT OF ENGINEERING

ELECTRICAL ALTERATIONS
FOR
CORNELIUS A. MOYLAN SCHOOL
235 HILLSIDE AVE. HARTFORD CONN.

SUBMITTED	RECOMMENDED	APPROVED
	CITY ARCHITECT	CITY ENGINEER

DESIGN R.G.B. DRAWN ____ TRACED ____ CHECK ____

DAYBOOK NO. 09771A
DATE APRIL 4, 1963