HEATING SYMBOLS

	HOT WATER SUPPLY
	HOT WATER RETURN
	COLD WATER
	OIL SUCTION
	GATE VALVE
	UNION
	BALANCING COCK
	MOTOR OPERATED VALVE
	KEY AIR VENT
(T)	THERMOSTAT
(A)	AQUASTAT
	DUCT

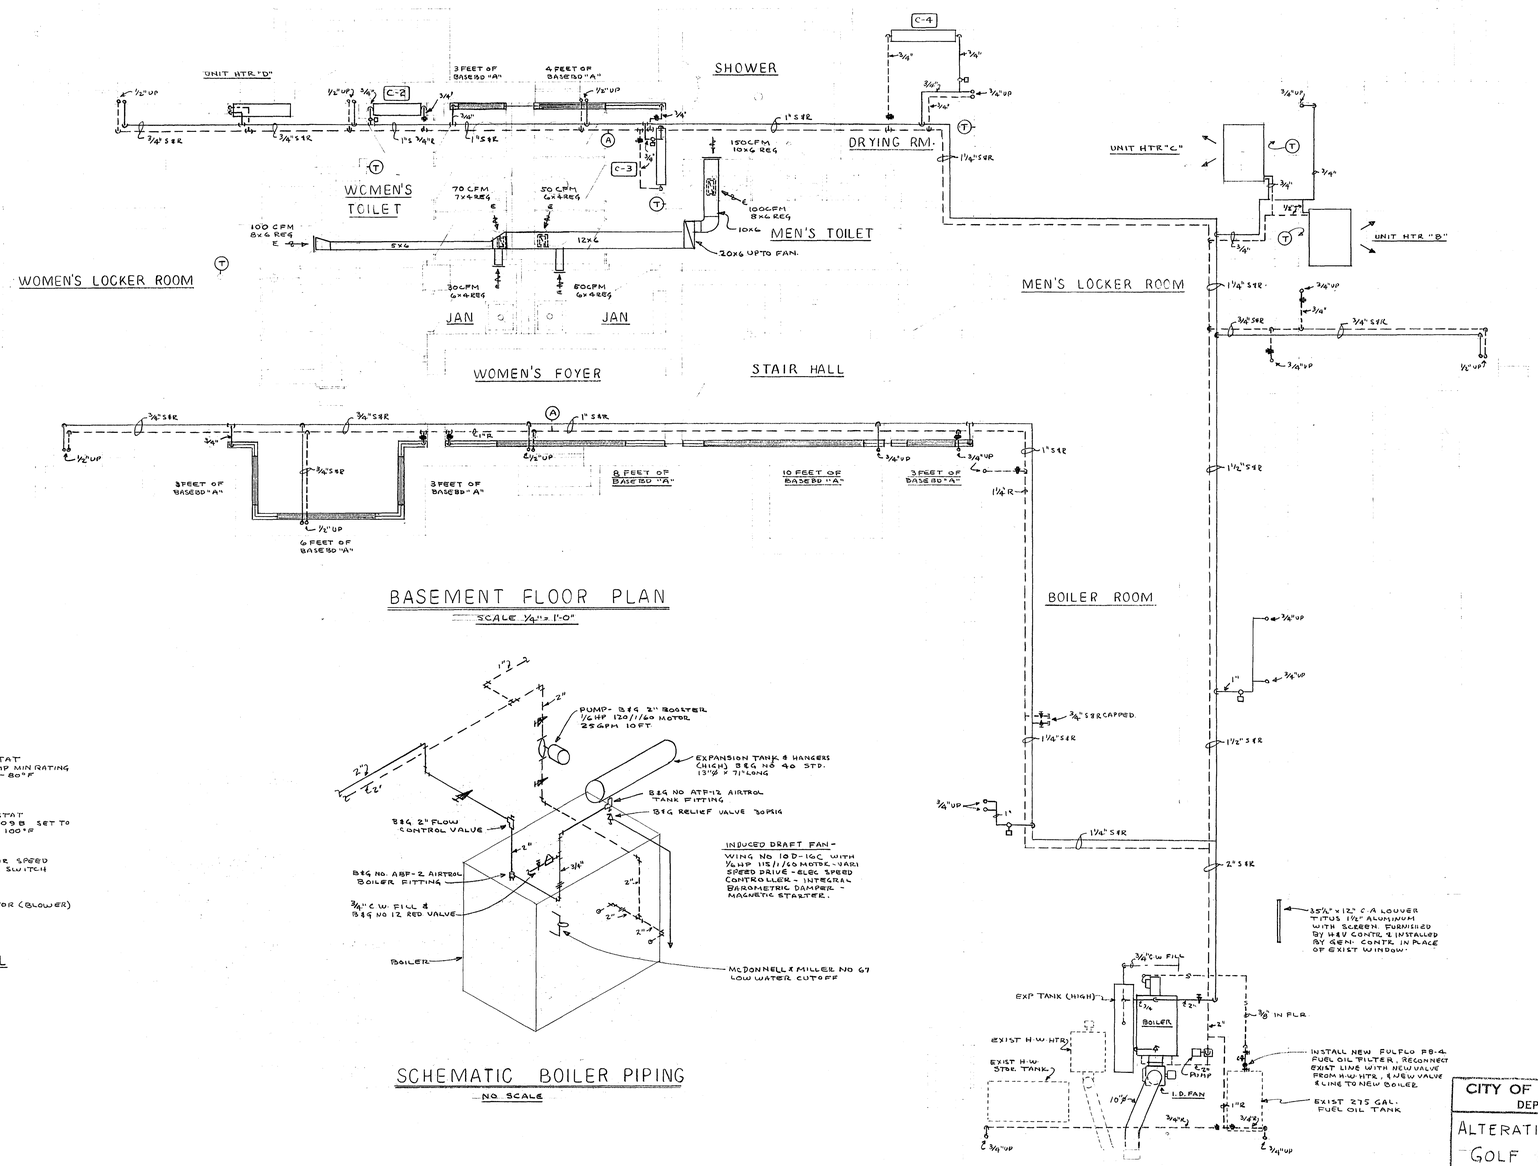

BASEMENT FLOOR PLAN

SCALE 1/4" = 1'-0"

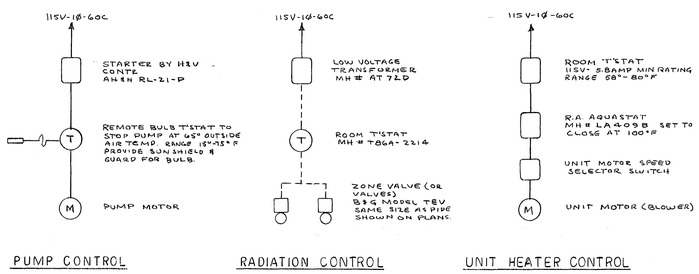

PUMP CONTROL — RADIATION CONTROL — UNIT HEATER CONTROL

TEMPERATURE CONTROLS

NO SCALE

SCHEMATIC BOILER PIPING

NO SCALE

VERIFY EXISTING CONDITIONS AND DIMENSIONS AT BUILDING

HV-1

CITY OF HARTFORD, CONNECTICUT
DEPARTMENT OF ENGINEERING

ALTERATIONS TO KENEY PARK GOLF CLUB HOUSE
WINDSOR, CONNECTICUT

SUBMITTED	RECOMMENDED	APPROVED
Paul D. Pomatchl	Donald J. Toeldte	Peter H. Berman
	CITY ARCHITECT	CITY ENGINEER

DESIGN PDP DRAWN P.D.P
TRACED CHECK
DAYBOOK NO. 09943-E
DATE OCT. 31, 1966.