

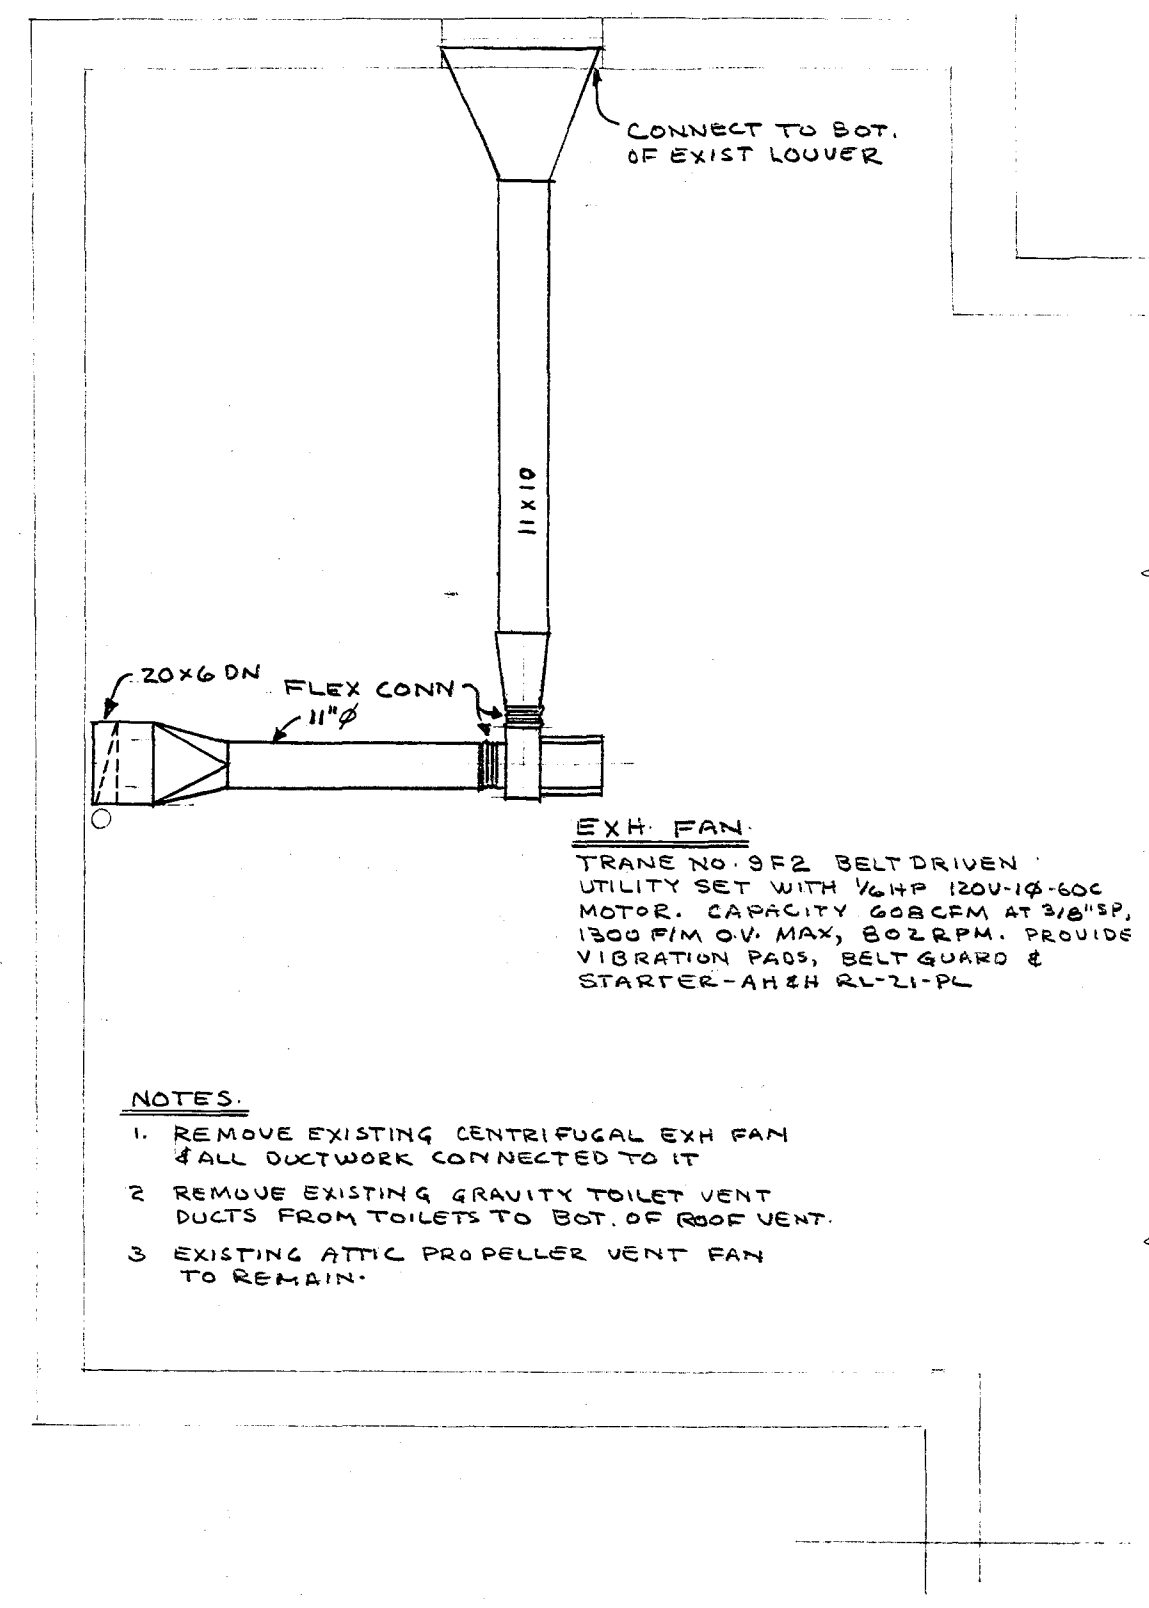








NOTES:

1. REMOVE EXISTING CENTRIFUGAL EXH. FAN & ALL DUCTWORK CONNECTED TO IT
2. REMOVE EXISTING GRAVITY TOILET VENT DUCTS FROM TOILETS TO BOT. OF ROOF VENT.
3. EXISTING ATMC PROPELLER VENT FAN TO REMAIN.



CLUB LOUNGE



SERVING ROOM

KITCHEN

CHECKING ROOM

ENTRANCE HALL

5 FEET OF BASEBOARD "B"

10 FEET OF BASEBOARD "B"

20 FEET OF BASEBOARD "B"

LUNCH ROOM

PORCH

20 FEET OF BASEBOARD "B"

20 FEET OF BASEBOARD "B"

FIRST FLOOR PLAN

SCALE 1/4" = 1'-0"

UNIT HEATER SCHEDULE

TYPE	MFR. TYPE	SIZE	CABINET ARRANGEMENT	MOTOR - 115/60/1		R.O.M. CFM	COIL CAPACITY AT 40°F WWT & 180°F EWT									
				TYPE	RPM	AMP	GPM	WATER PD. FT.	MBH	WATER AT	F.A.T.	MBH	WATER AT	F.A.T.		
A	TRANE FORCE-FLO	04	A-42	G-1	1050/500	1.50	400	1.0	0.30	21.2	42.7	109.2	15.0	30.4	132.9	
B	DO	DO	B-16	G-1	DO	1.80	300	0.5	0.06	12.2	48.7	98.1	9.2	37.3	121.2	
C	DO	DO	B-16	G-1	DO	1.80	300	2.0	0.84	20.3	20.5	123.5	13.1	13.3	146.5	
D	DO	DO	A-42	G-1	DO	1.80	300	1.0	0.24	14.4	33.4	111.9	11.5	23.3	132.9	

CONVECTOR SCHEDULE


TYPE	MFR. TYPE	HEIGHT	DEPTH	LENGTH	BTU/K	DAMPER
C-1	TRANE FG	26"	6"	64"	9400	YES
C-2	DO SW	32"	8"	36"	8100	NO
C-3	DO SW	26"	6"	40"	7000	NO
C-4	DO SW	26"	8"	48"	10400	NO

* BASED ON 180°F WWT, 20°F AT, 60°F EWT.
COVERS 18 GA MIN. BACK PLATE 20 GA MIN. GREY PRIMER FINISH

BASEBOARD SCHEDULE

TYPE	MFR.	SIZE	BTU/FT*	DAMPER
"A"	TRANE	B-8	505	YES
"B"	DO	B-12	623	NO

* BASED ON 180°F WWT & 1 GPM FLOW RATE
PROVIDE CAPS, FILLERS, CORNERS ETC. AS SHOWN ON PLANS. 22 GA MIN. WHITE PRIMER FINISH.

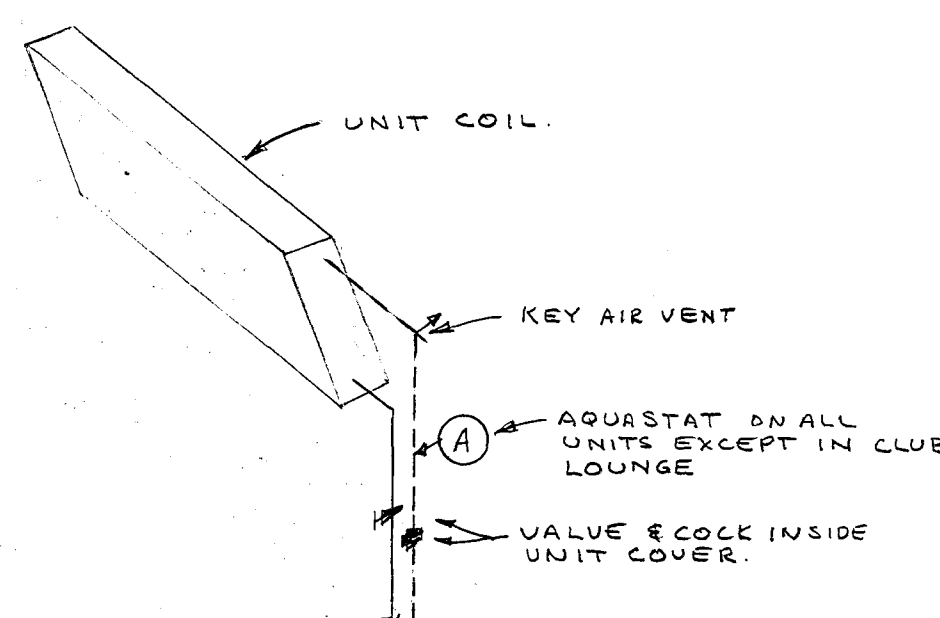

UNIT HEATER PIPING

NO SCALE

HV-2

CITY OF HARTFORD, CONNECTICUT DEPARTMENT OF ENGINEERING		
ALTERATIONS TO KENY PARK GOLF CLUB HOUSE		
WINDSOR, CONNECTICUT		
SUBMITTED <i>Paul J. Fontana</i>	RECOMMENDED <i>Daniel J. Willis</i>	APPROVED <i>Robert A. Bessone</i>
CITY ARCHITECT	CITY ENGINEER	
DESIGN P.D.P.	DRAWN P.D.P.	DAYBOOK NO. 09943-F
TRACED	CHECK	DATE OCT. 31, 1966

VERIFY EXISTING
CONDITIONS AND
DIMENSIONS AT
BUILDING