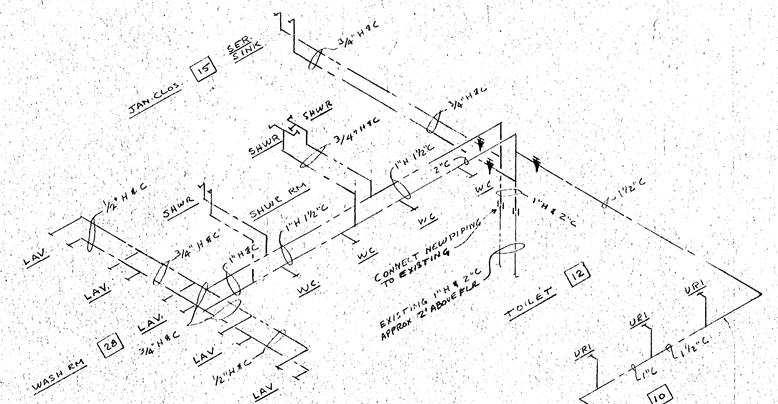

SCHEMATIC WATER PIPING
NO SCALE

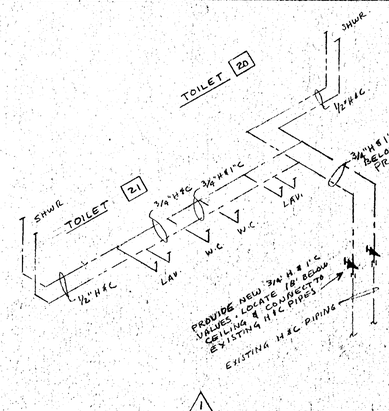

1
SCHEMATIC WATER PIPING
NO SCALE

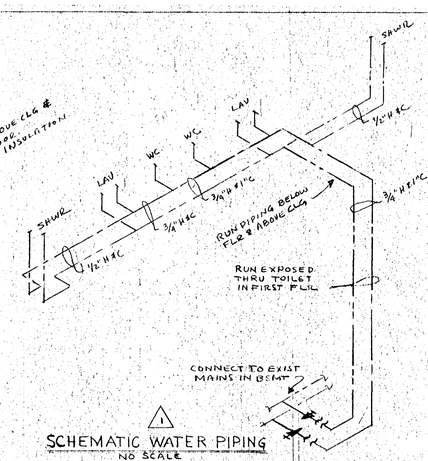

1
SCHEMATIC WATER PIPING
NO SCALE

PLUMBING FIXTURE SCHEDULE

SYM.	FIXTURE	SOIL OR WASTE	VENT	COLD WATER	HOT WATER	SPECIFICATION
A	W.C.	4"	2"	1/2"	-	AM. STD. "ELONGATED GLENWALL" TOILET NO. F-7002-L WITH TANK LINER, R-3004 SUPPLY & STOP, OLSONITE NO. 10 BLACK SEAT. ZURN INTEGRAL CARRIER & FITTINGS WITH FRONT SUPPORT OF SIZES & TYPES AS SHOWN ON PLANS.
B	W.C.	4"	2"	1/2"	-	AM. STD. "ELONGATED CADETT TOILET NO. F-2109-L WITH TANK LINER, R-3514 SUPPLY STOP, OLSONITE NO 10 BLACK SEAT.
C	URINAL	2"	1 1/2"	3/4"	-	AM. STD. "WASHBROOK" NO. F 6501-11 WITH # 186-11 SLOAN ROYAL VALVE
D	LAVATORY	1 1/2"	1 1/2"	1/2"	1/2"	AM. STD. "REGALYN" NO. P-4867, 20" x 18" C.I. ACID RESISTING ENAMEL WITH N-2101-8 TRIM, R-2607-3/8" SUPPLY & STOPS WITH LOOSE SET KEYS, R-7000-42 1 1/4" x 1 1/4" P TRAP.
E	LAVATORY	1 1/2"	1 1/2"	1/2"	1/2"	SAME AS (D) EXCEPT USE R-2614 FLOOR SUPPLY & STOPS.
F	DRINKING FOUNTAIN	1 1/2"	1 1/2"	1/2"	-	HALSEY TAYLOR FLOOR MTD MODEL NO. 5C-16A ELECTRIC AIR COOLED WITH STAINLESS STEEL TOP & BONDERIZED STEEL SIDES. CAPACITY 16 GPH 80° TO 50°F AT 90°F AMBIENT TEMP. MOTOR VALVE, 115-1P-60-C, 1 1/4" x 1 1/4" ABT P TRAP & STOP. MOUNT 40" ABOVE FLOOR.
G	SERVICE SINK	3"	1 1/2"	3/4"	3/4"	AM. STD. "ARGO" NO. P-7706 SINK 22" x 18" C.I. ACID RESISTING WITH P-7798 TRAP STANDARD, R-5084-T FAUCETS.
H	SHOWER	-	-	1/2"	1/2"	SYMMONS NO. 4-235 FIELD HEAD WITH 2 GPM RESTRICTOR & NO. 4-500-X SAFETY MIX CONCEALED VALVE WITH INTEGRAL STOPS. MOUNT HEAD AT 6'-0"

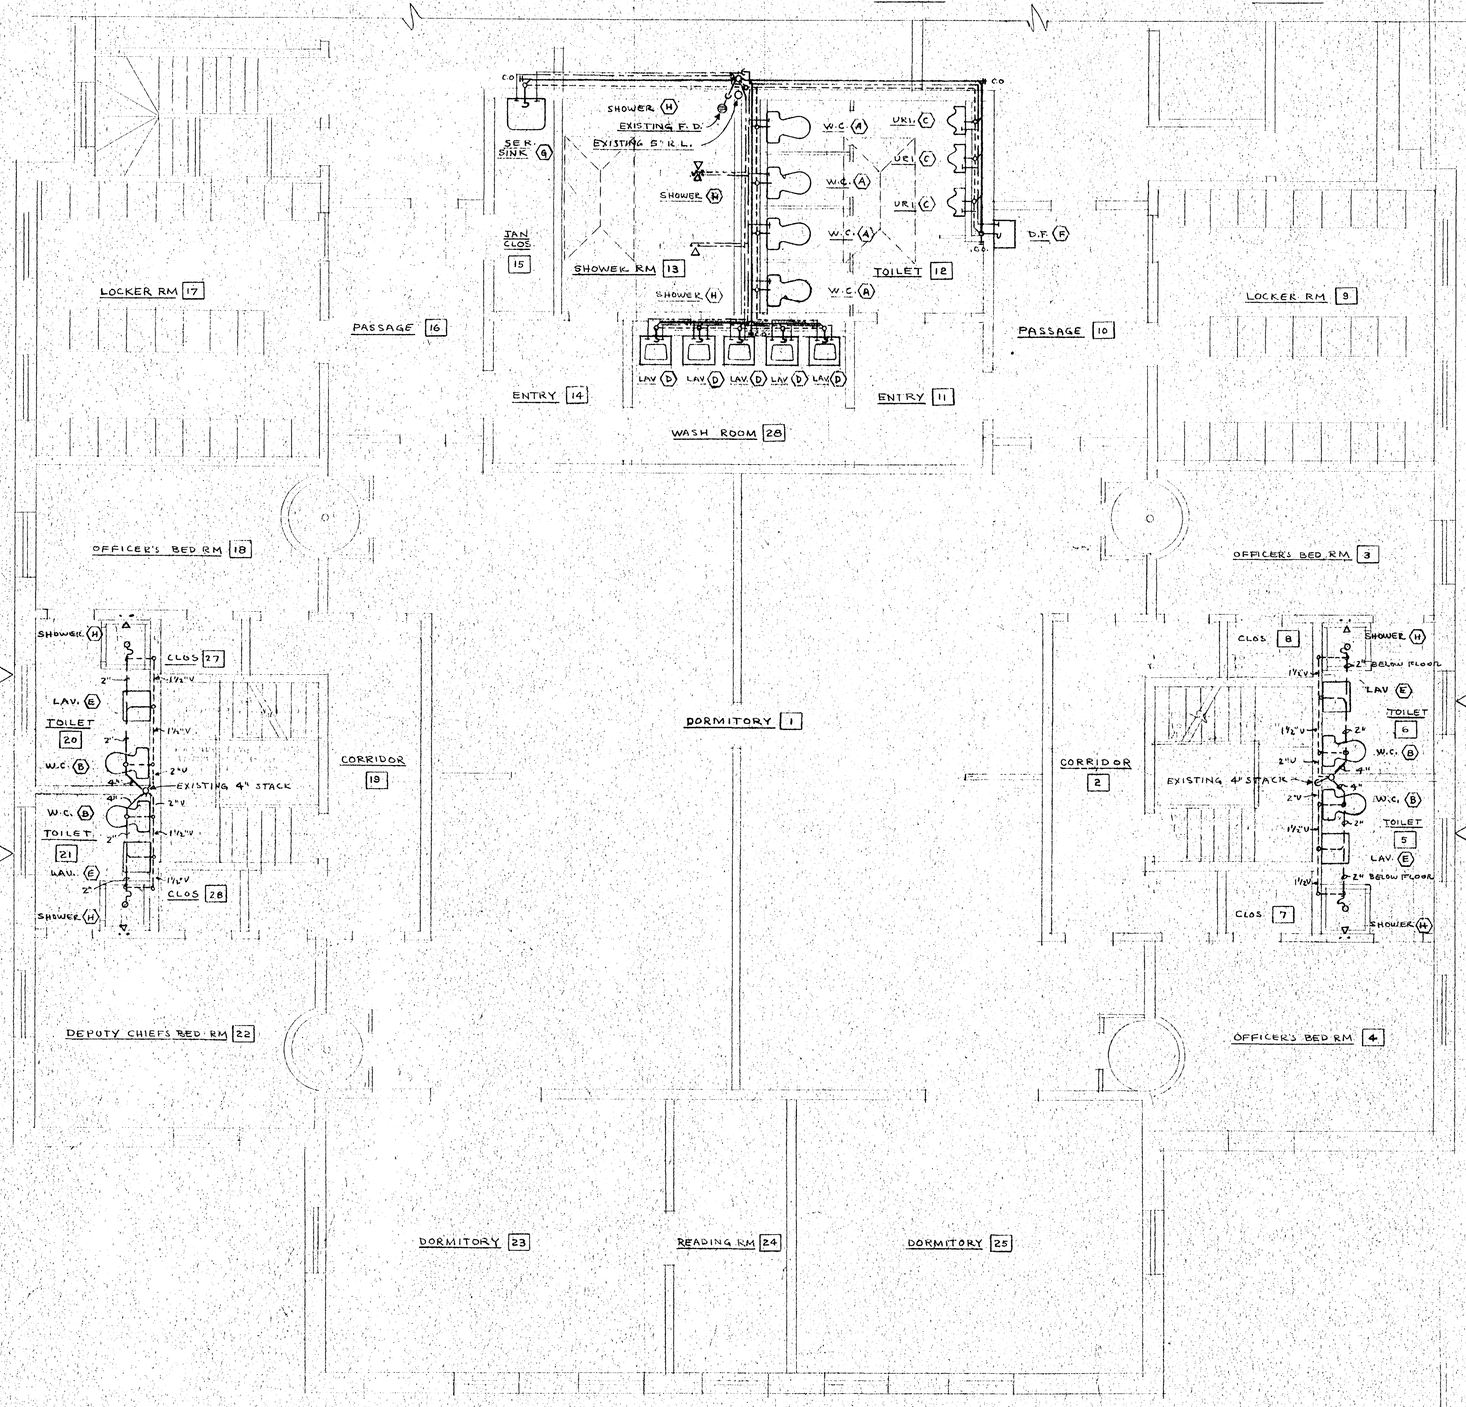

SECOND FLOOR PLAN
SCALE 1/4" = 1'-0"

N

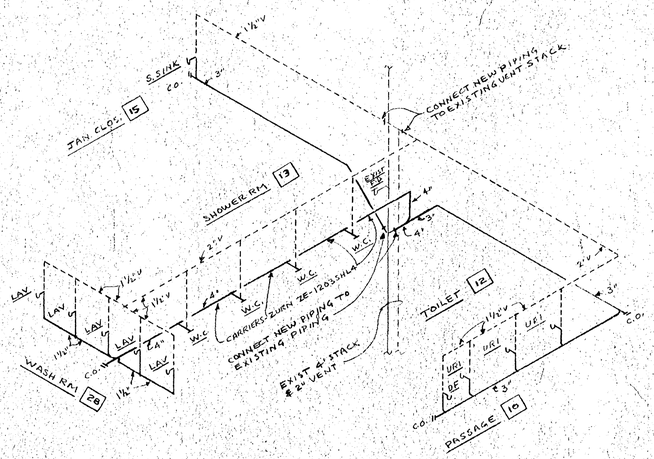

SCHEMATIC WASTE & VENT PIPING
NO SCALE

VERIFY EXISTING CONDITIONS AND DIMENSIONS AT BUILDING

REV. No.	DATE	
1	3-18-68	RELOCATE FIXTURES IN TOILETS ROOMS NO. 5, 6, 20 & 21 & PIPING SCHEMATICS.

CITY OF HARTFORD, CONNECTICUT
DEPARTMENT OF ENGINEERING

ALTERATIONS TO SECOND FLOOR OF ENGINE HOUSE No. 2
1515 MAIN STREET
HARTFORD CONNECTICUT

DWG. NO. P-1

SUBMITTED	RECOMMENDED	APPROVED
P.D.P.	Daniel J. Tarello	Peter A. Barrows
	CITY ARCHITECT	CITY ENGINEER

DESIGN P.D.P. DRAWN P.D.P.
TRACED CHECK
DAYBOOK NO. 010007D
DATE MARCH 1, 1968