

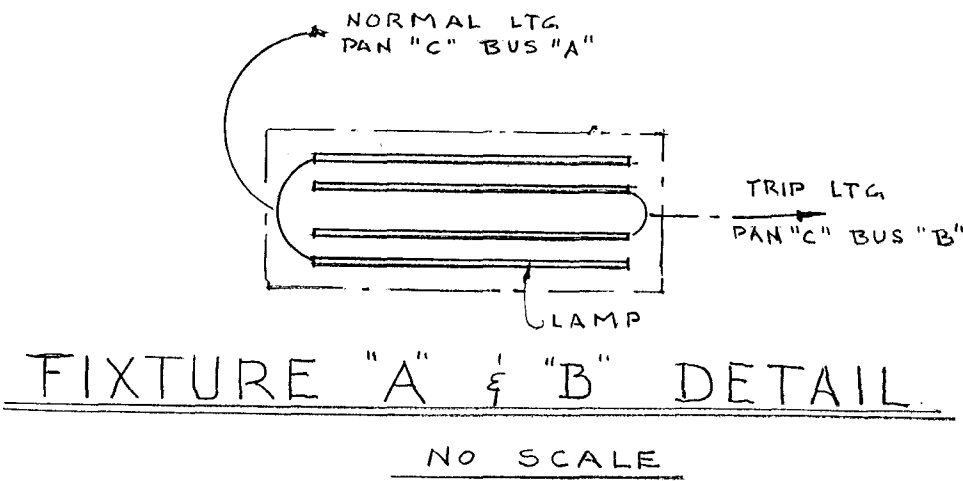
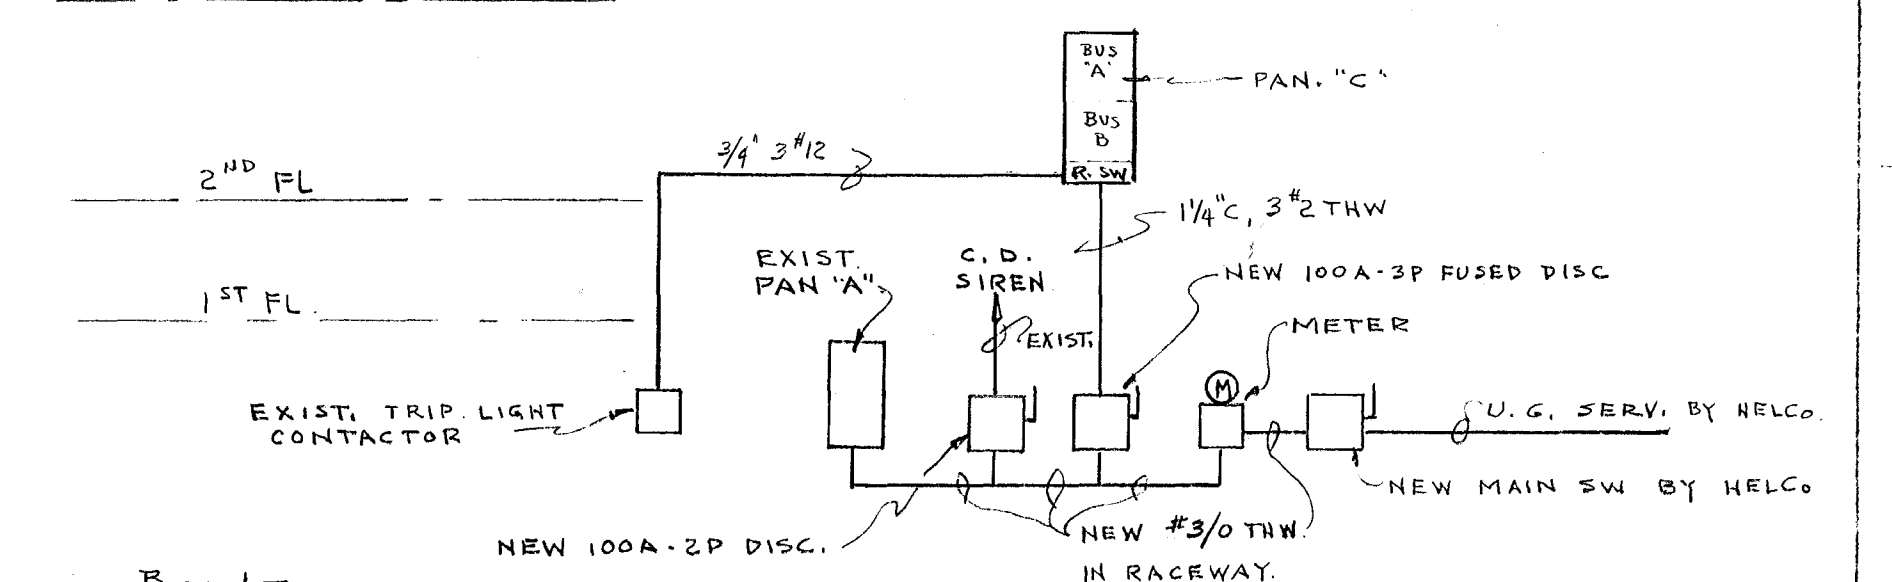


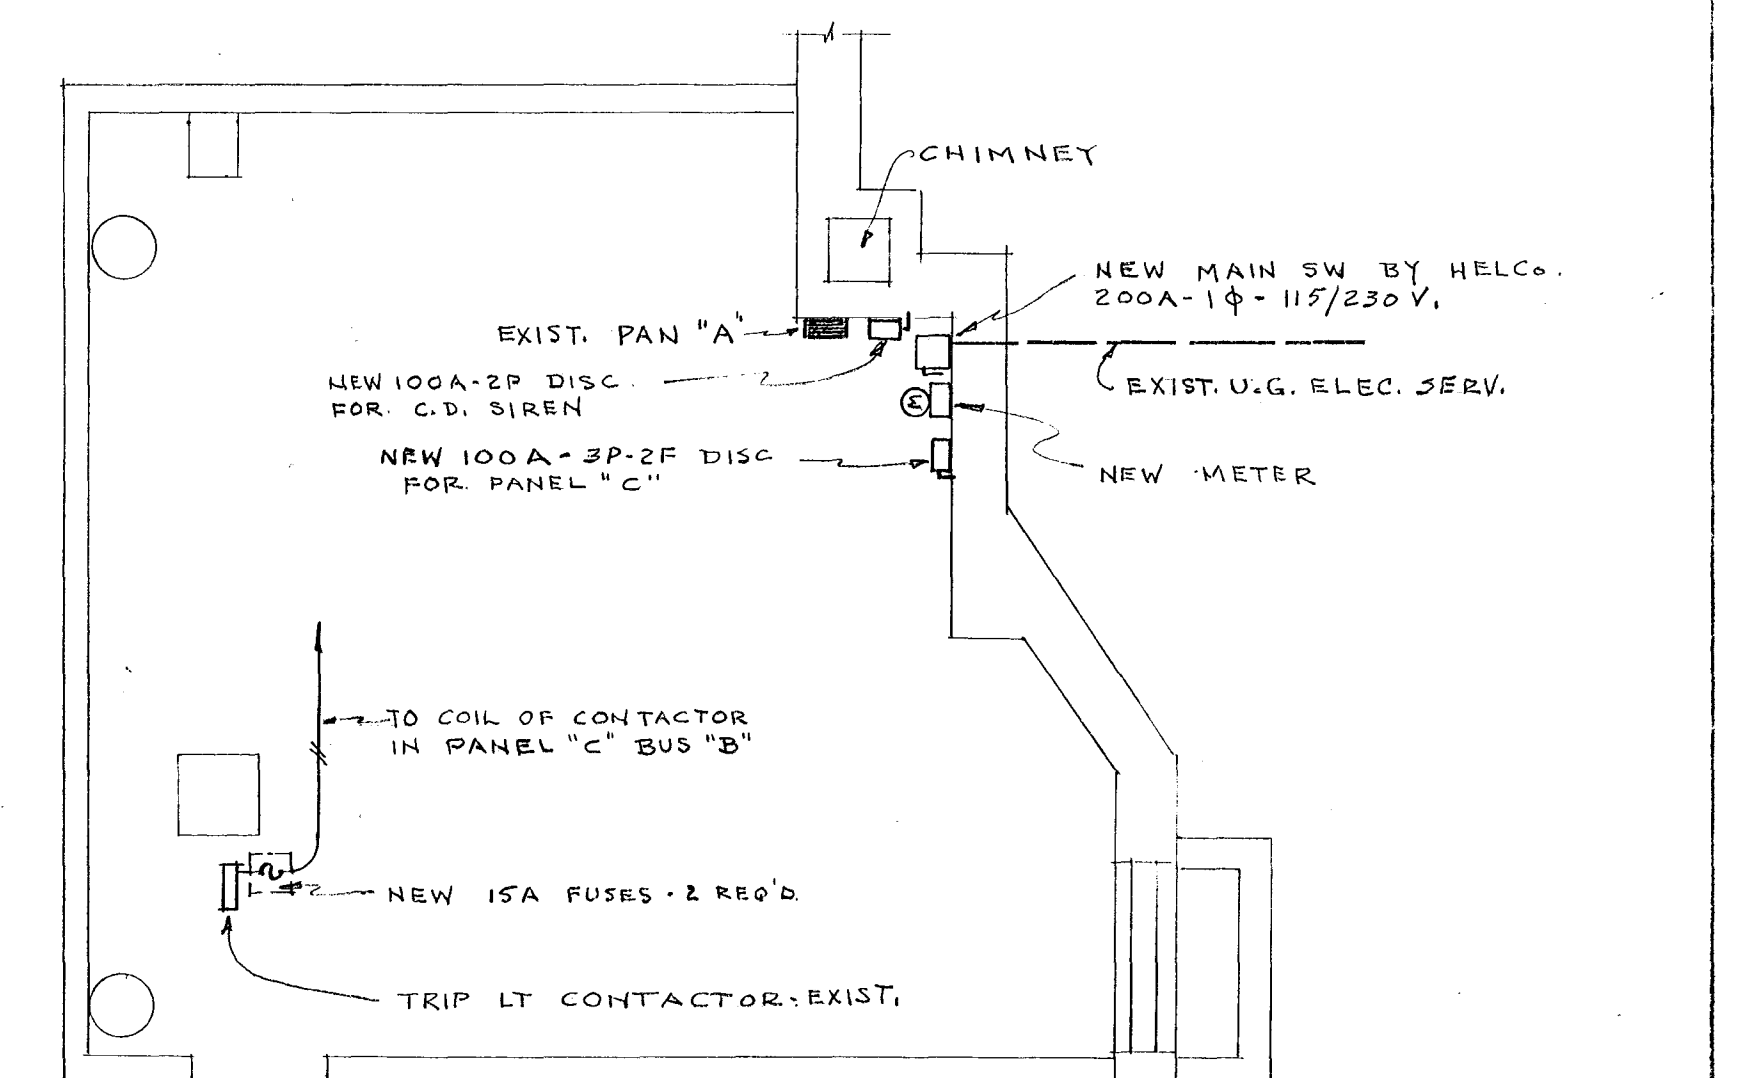

SYMBOL		SYMBOL	
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	FLUORESCENT FIXTURE		SINGLE POLE SW ~ H & H #1991 ~ UP 4'-0"
	FLUORESCENT TROFFER		THREE-WAY SW. ~ H & H #1993 ~ UP 4'-0"
	CEILING FIXTURE OR OUTLET		FOUR-WAY SW ~ H & H #1994 ~ UP 4'-0"
	WALL BRACKET		DUPLEX CONV. OUTLET ~ H & H #5262 ~ UP 18"
	NIGHT LIGHT		FUSED DISCONNECT
	WIRING FOR CIRCUITS ON PANEL "C" BUS "A"		MOTOR - PROVIDED BY OTHERS
	ELEC. BASEBOARD HEATER - SEE SPEC.		MANUAL MOTOR STARTER w/ THERMAL O.L. & PILOT LT.
	THERMOSTAT		MAGNETIC MOTOR STARTER

FIXTURE SCHEDULE			
TYPE	MANUFACTURER & CATALOG NO.	LAMPS	REMARKS
A	LITHONIA # 2G-440-RH	FOUR F40CW	SEE TYPICAL WIRING DETAIL
B	LITHONIA # WA-440-RH	FOUR F40CW	" " " "
C	LITHONIA # BTCC140RH	TWO F40CW	" " " "
C-1	LITHONIA # CC140RH	ONE F40CW	" " " "
C-2	LITHONIA # CC140RH	ONE F40CW	WALL MTD
D	DAYBRITE # 5240W	TWO F40CW	WALL MTD. OVER MIRROR
D-1	DAYBRITE # 5220W	TWO 2 FT TRIGGER ST	WALL MTD OVER MIRROR
E	EXISTING TO REMAIN		
F	LITHONIA # BAC115	G.E. #150R/R	WALL MTD 12" BELOW CEILING
F-1	LITHONIA # BAC215	TWO 150W R40 FL.	" " 12" " "
G	LITHONIA # AL4	ONE 40W 1/8"	" " 18" ABOVE FLOOR
H	H & H # 860	ONE 100W LF.	

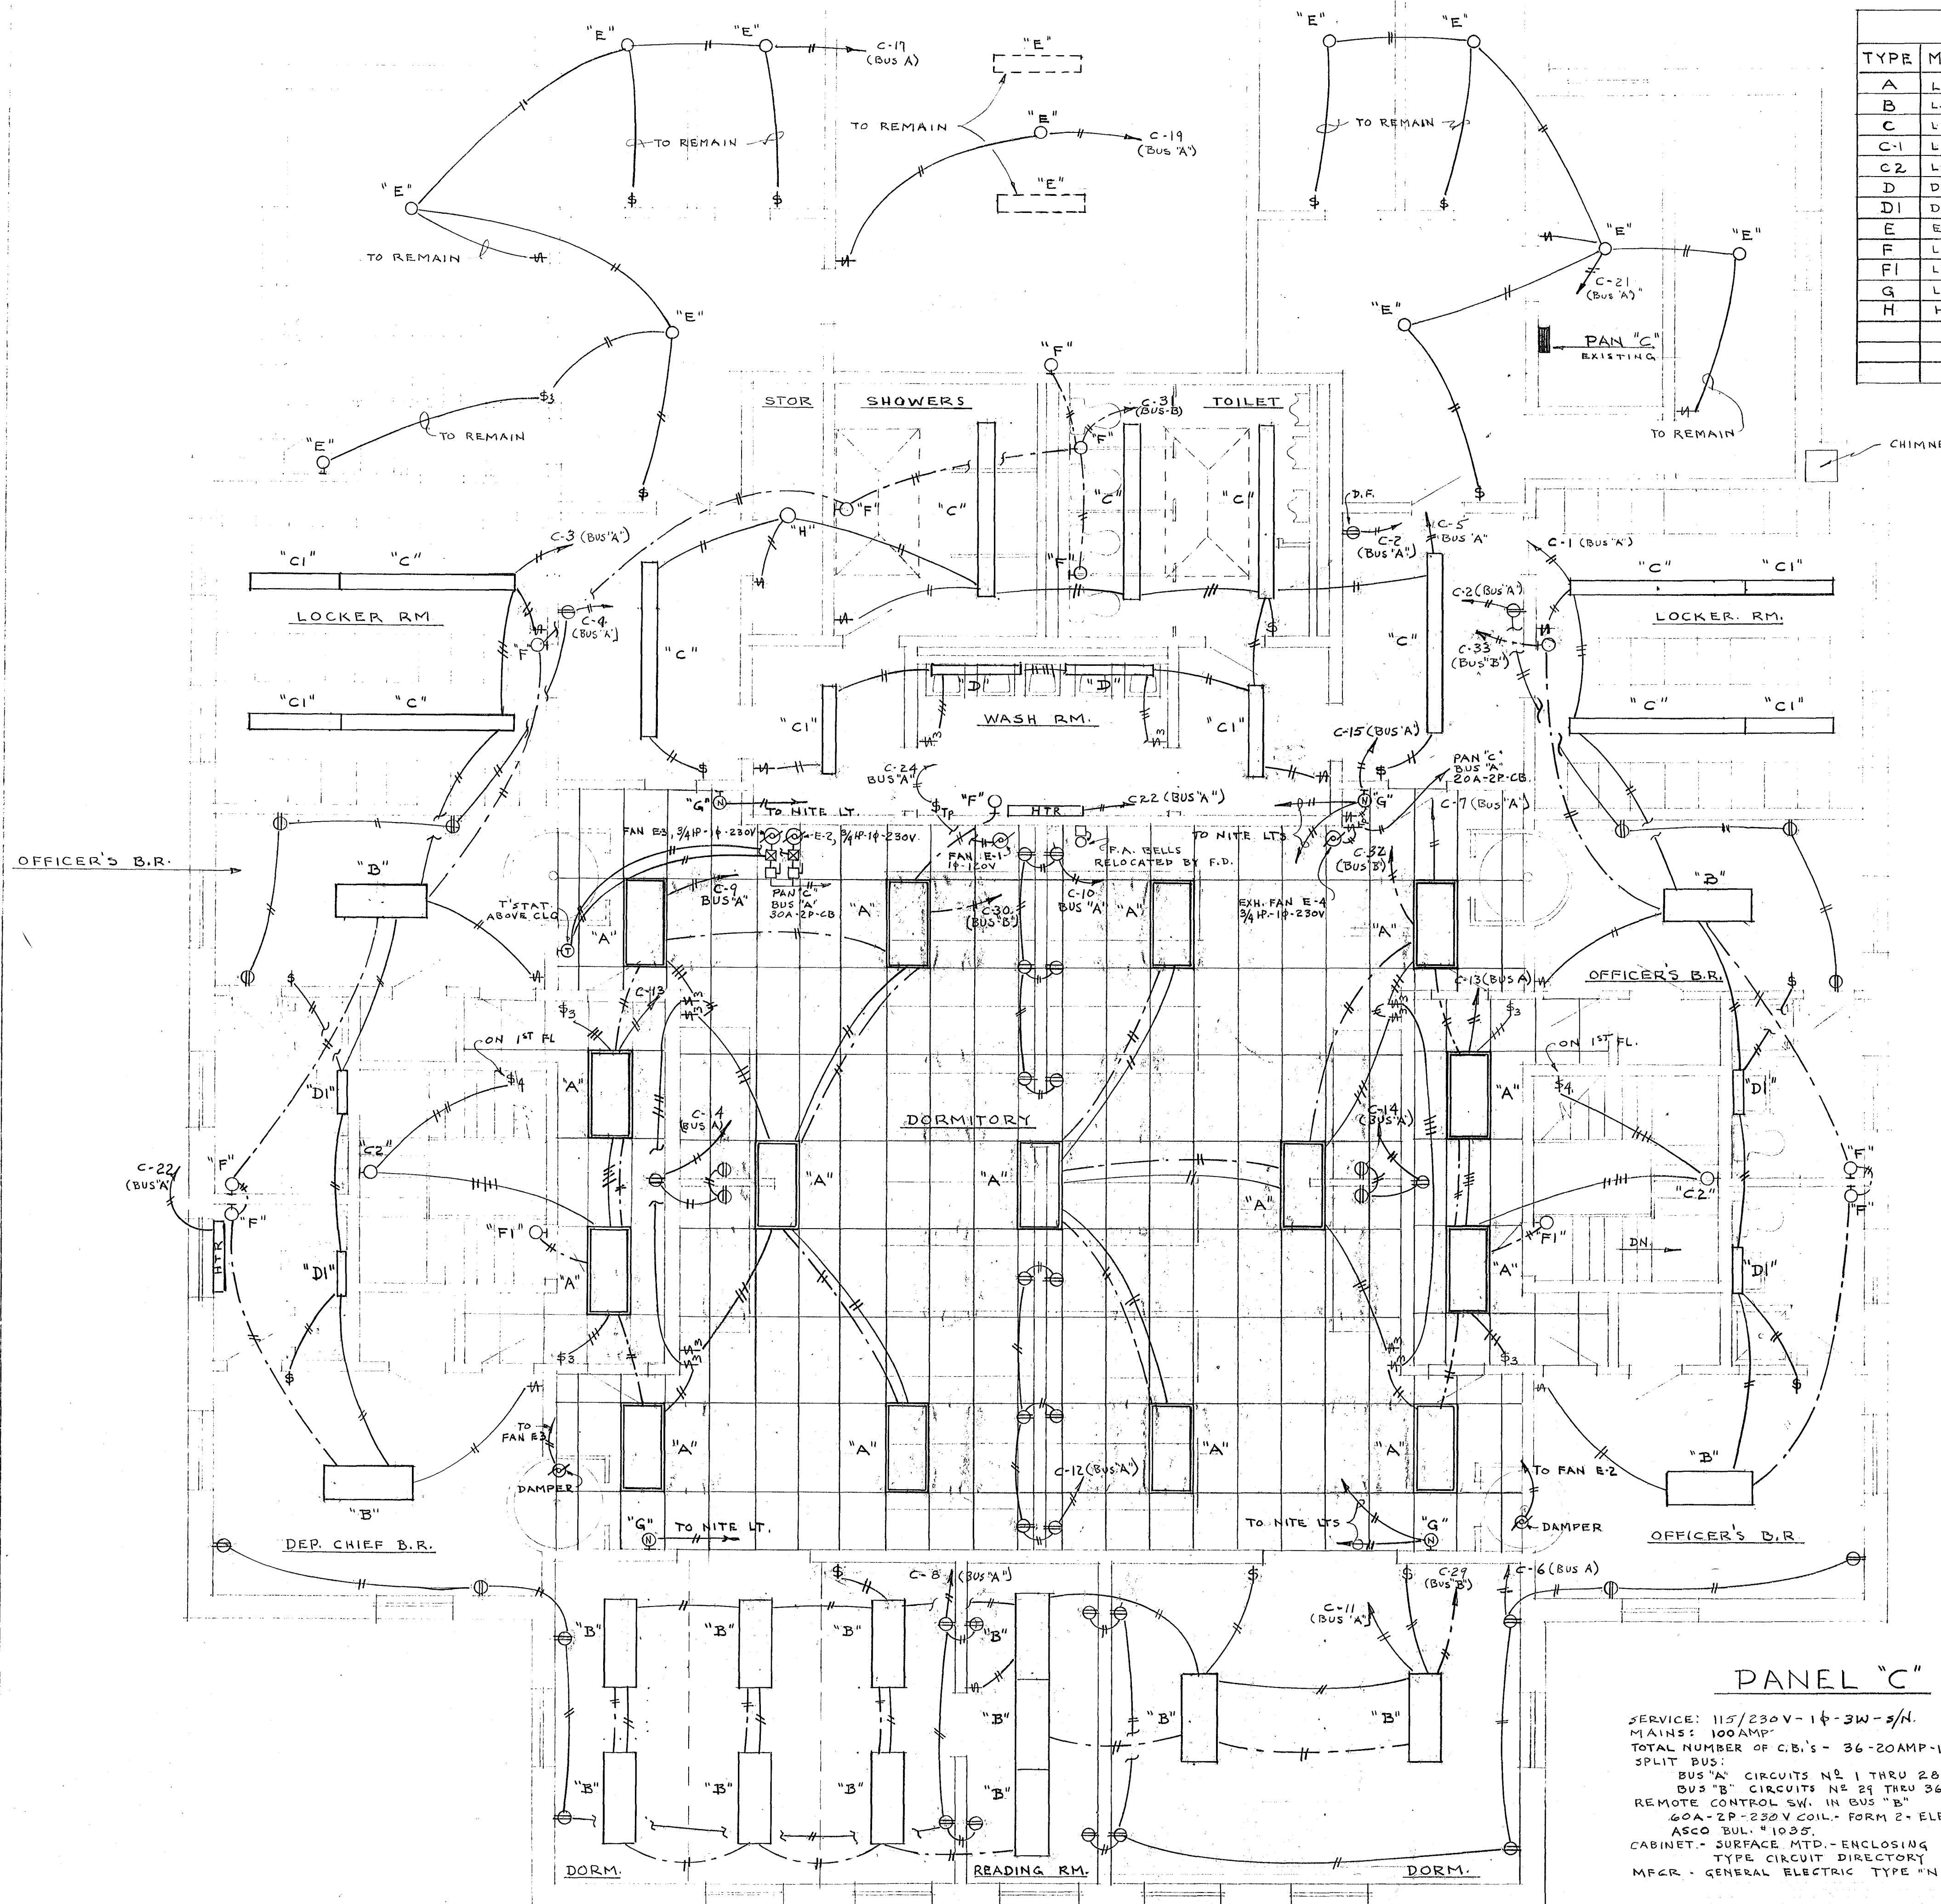

PANEL "C"

SERVICE: 115/230V - 1ϕ-3W-3/4"

MAINS: 100AMP

TOTAL NUMBER OF C.B.'S - 36-20AMP-1P; 1-20A-2P, 1-30A-2P SPLIT BUS.

BUS "A" CIRCUITS NO 1 THRU 28

BUS "B" CIRCUITS NO 29 THRU 36

REMOTE CONTROL SW. IN BUS "B"

60A-2P-230V COIL - FORM 2 - ELECTRICALLY HELD.

ASCO BUL. #1035

CABINET - SURFACE MTD. - ENCLOSING DOOR W/ LOCK.

TYPE CIRCUIT DIRECTORY

MFG. - GENERAL ELECTRIC TYPE "NLAB"

VERIFY EXISTING CONDITIONS AND DIMENSIONS AT BUILDING

CITY OF HARTFORD, CONNECTICUT DEPARTMENT OF ENGINEERING			DWG. NO.
ALTERATIONS TO 2ND FL. ENGINE HOUSE No 2			E-1
1515 MAIN STREET HARTFORD CONNECTICUT			
SUBMITTED	RECOMMENDED	APPROVED	
<i>R. G. B.</i>	<i>David J. ...</i>	<i>Arthur H. ...</i>	
DESIGN R.G.B.	DRAWN R.G.B.	DAYBOOK NO. 010007E	
TRACED	CHECK	DATE MARCH 1, 1948	