




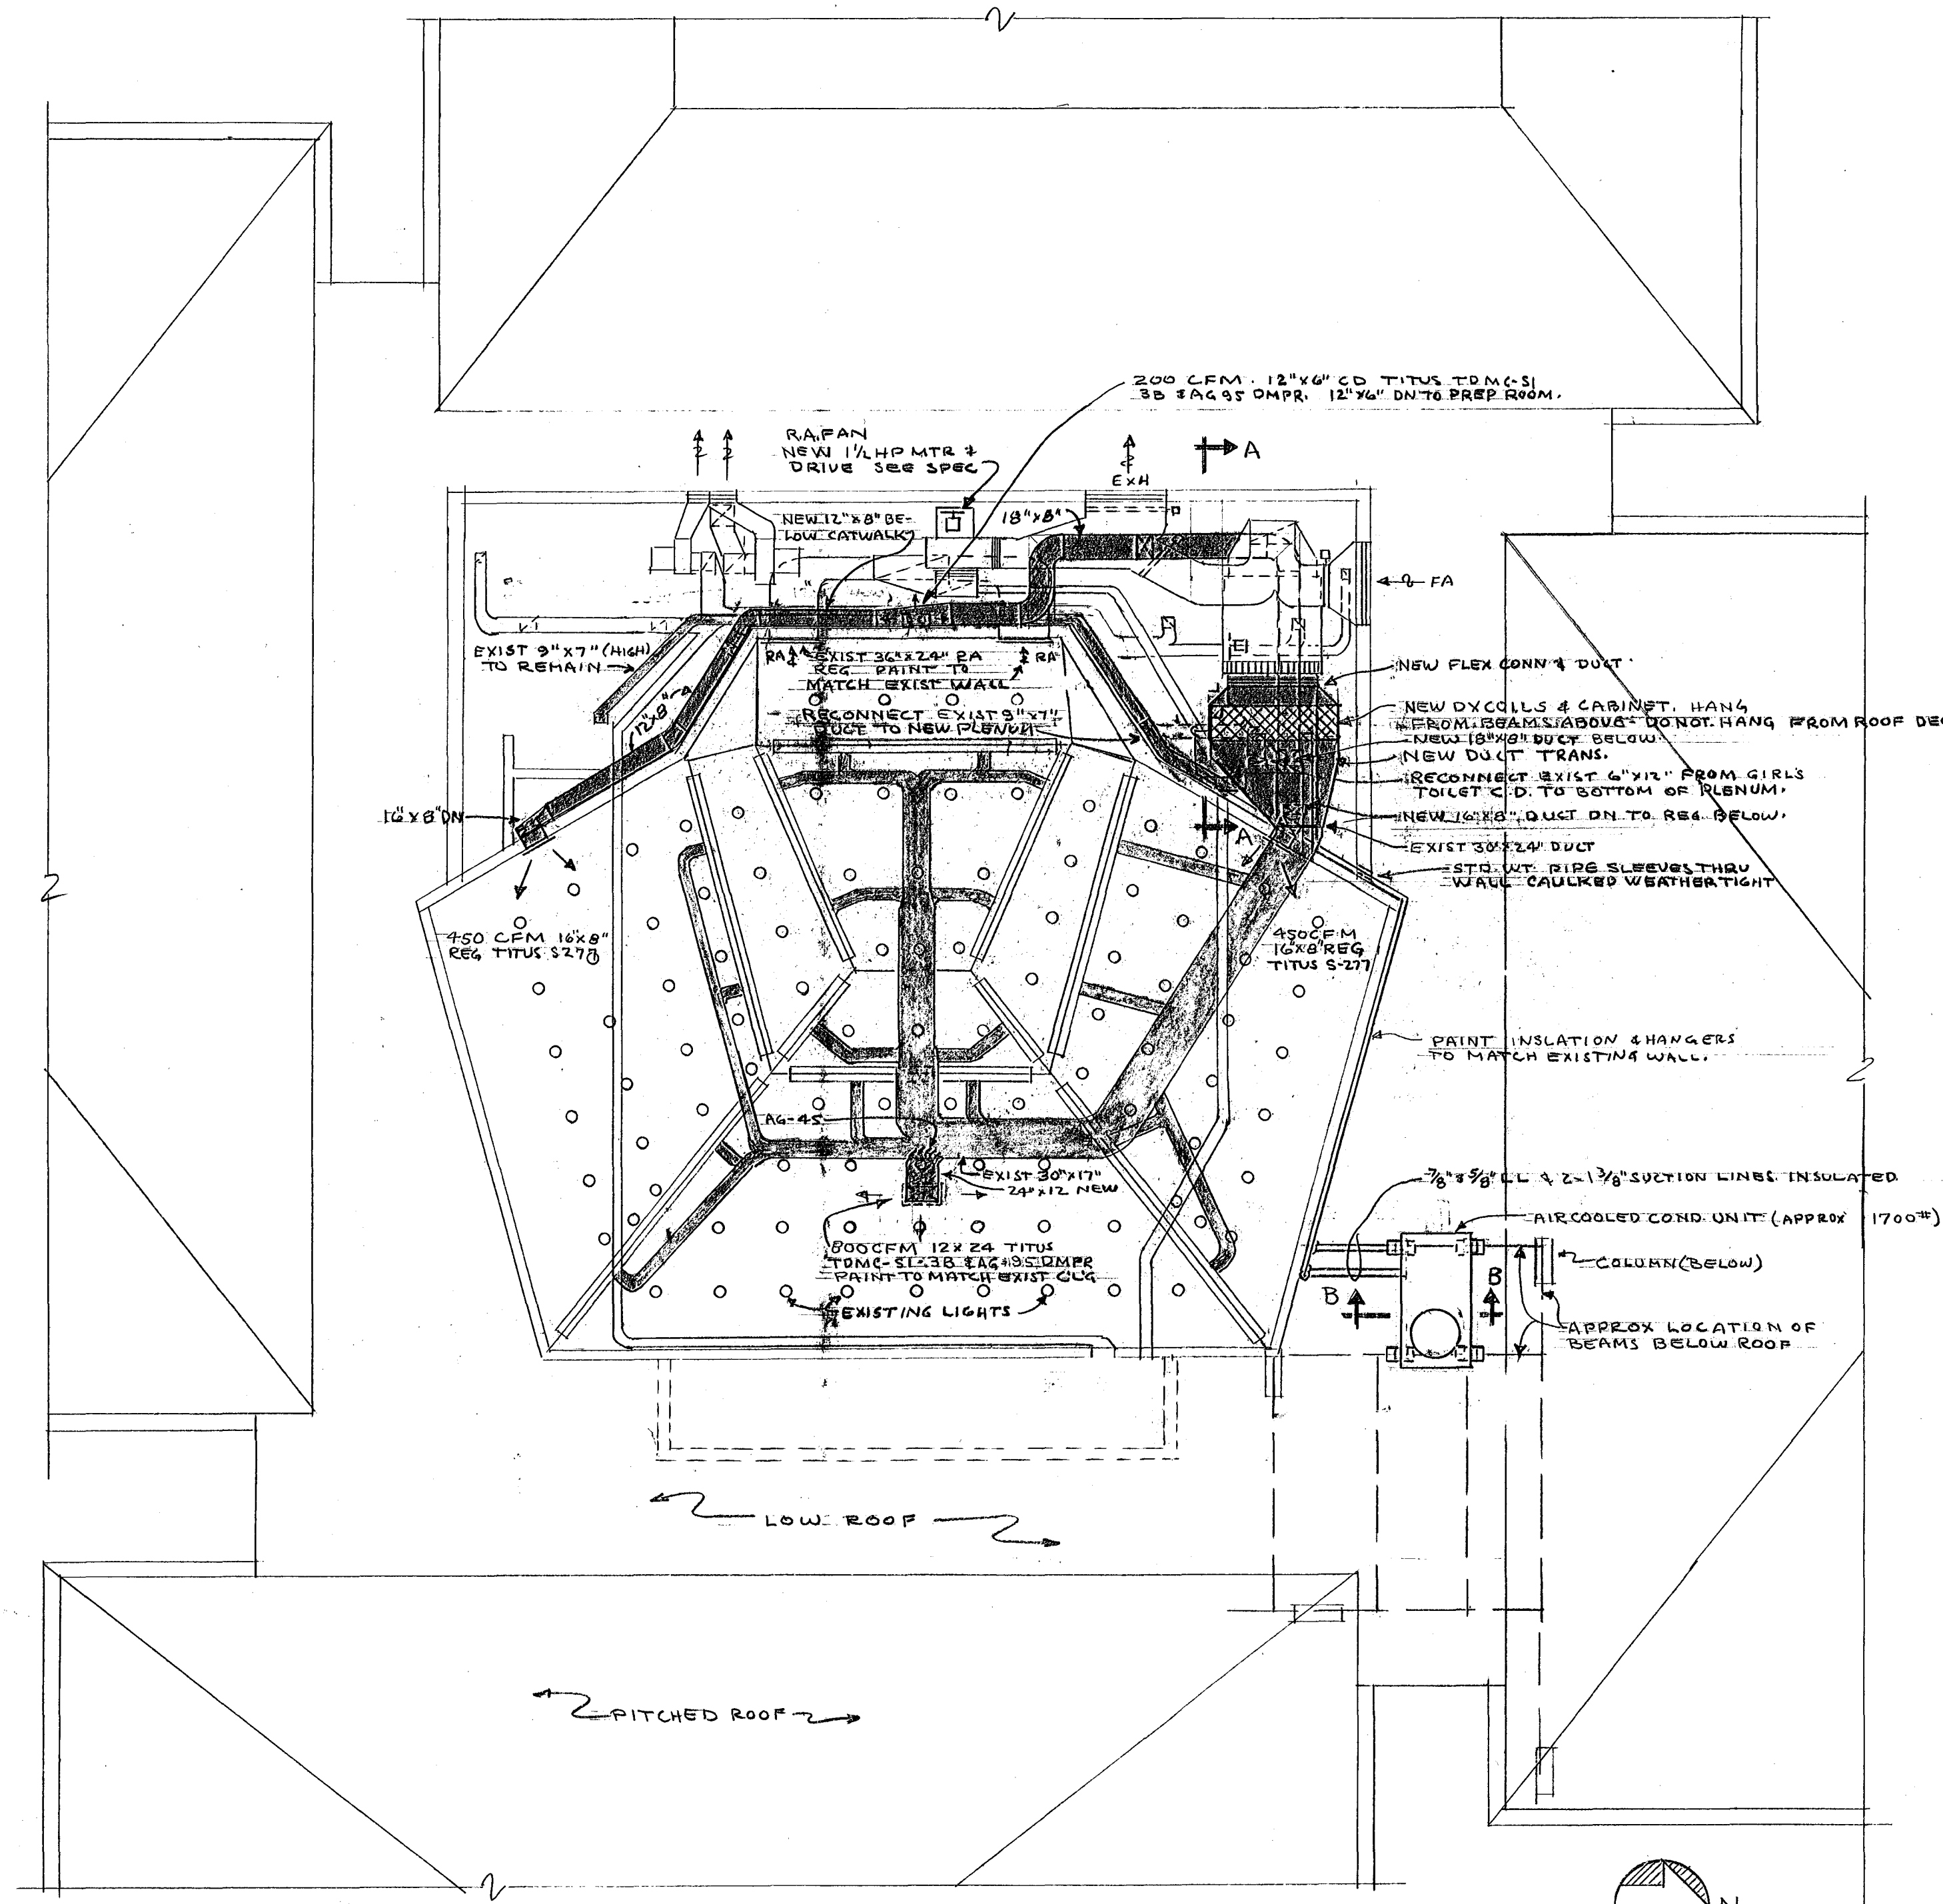


PLAN- UNIT "D" ROOF & UPPER PART OF LECTURE ROOM
SCALE 1/8" = 1'-0"

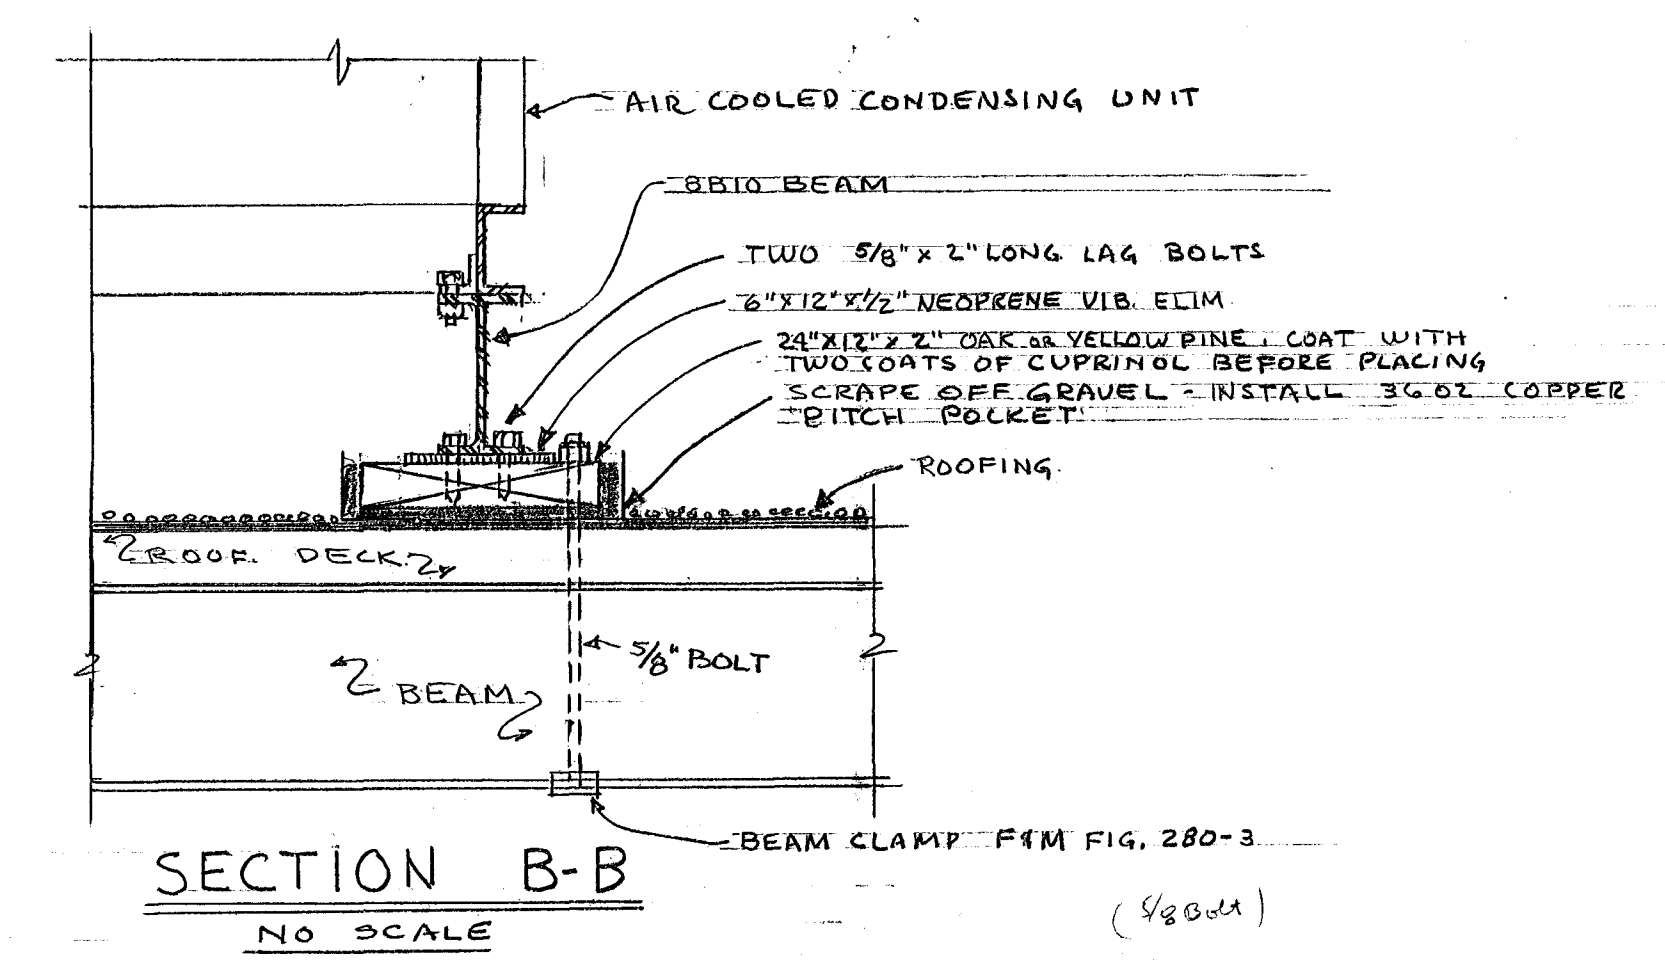


SECTION B-B
NO SCALE

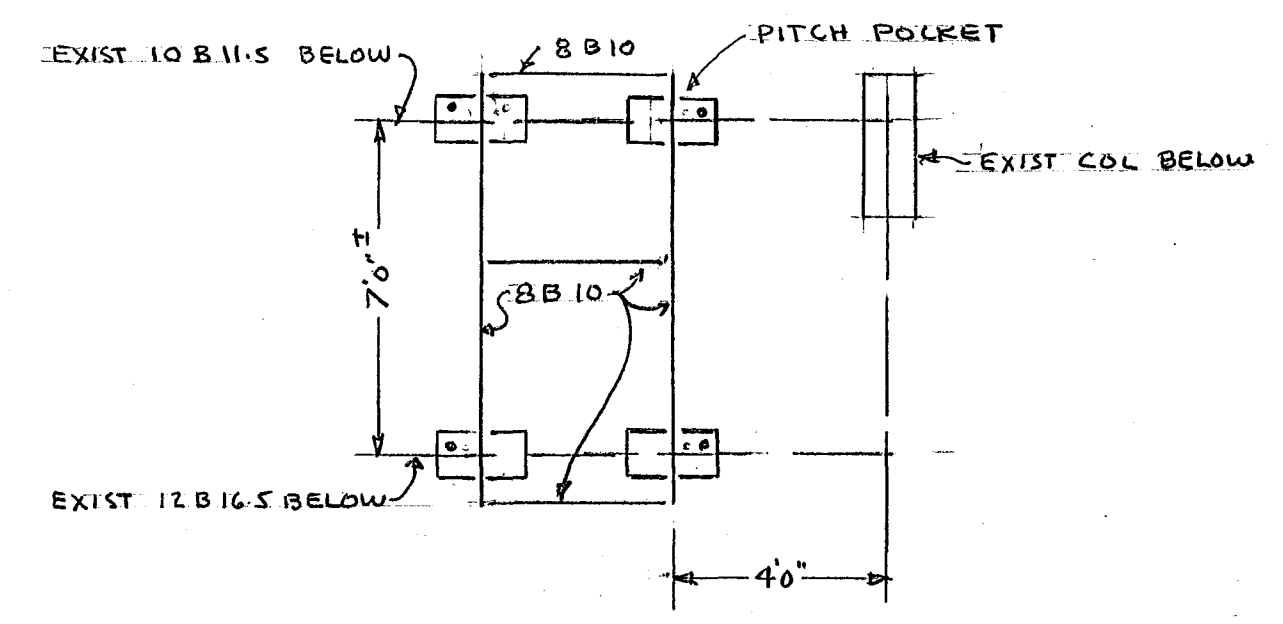

PLAN STEEL FRAMING FOR
ROOF TOP COOLING UNIT
NO SCALE

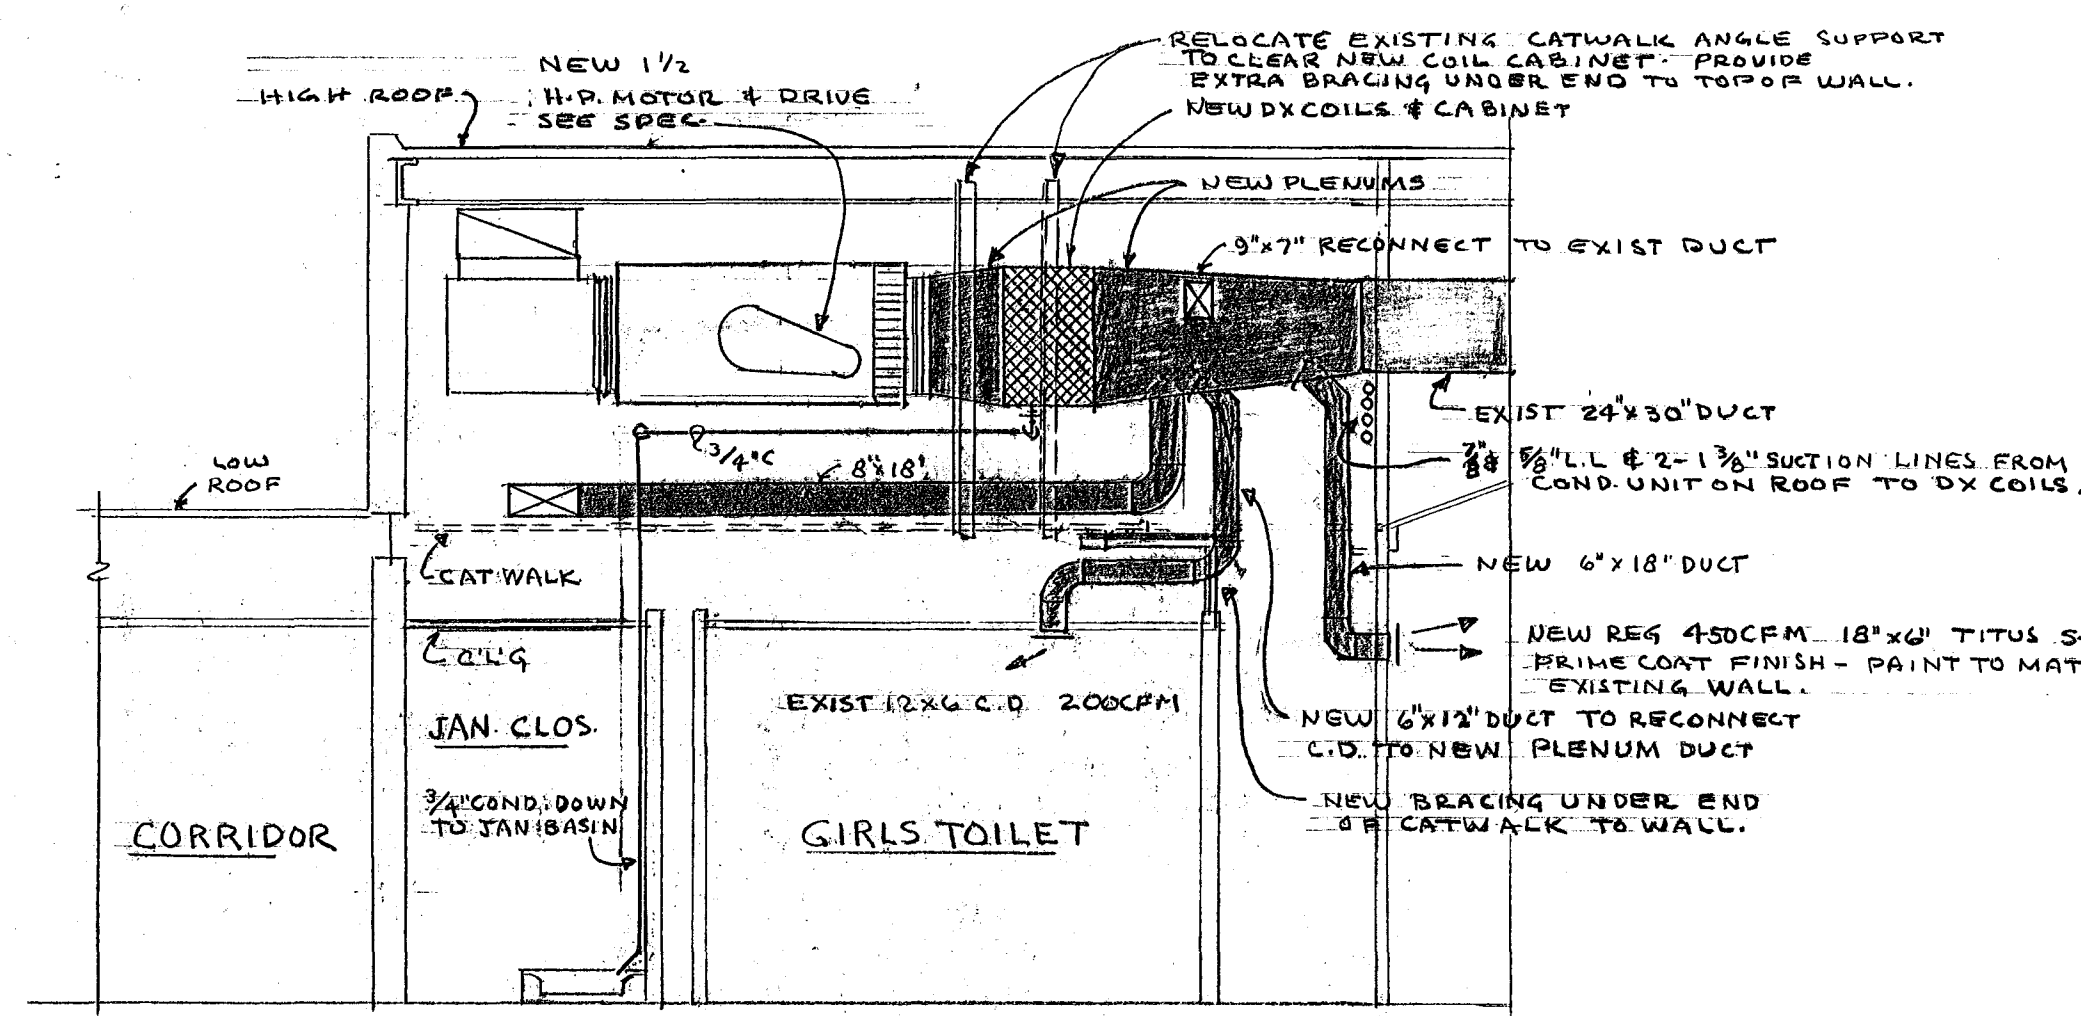


SECTION A-A
SCALE 1/4" = 1'-0"

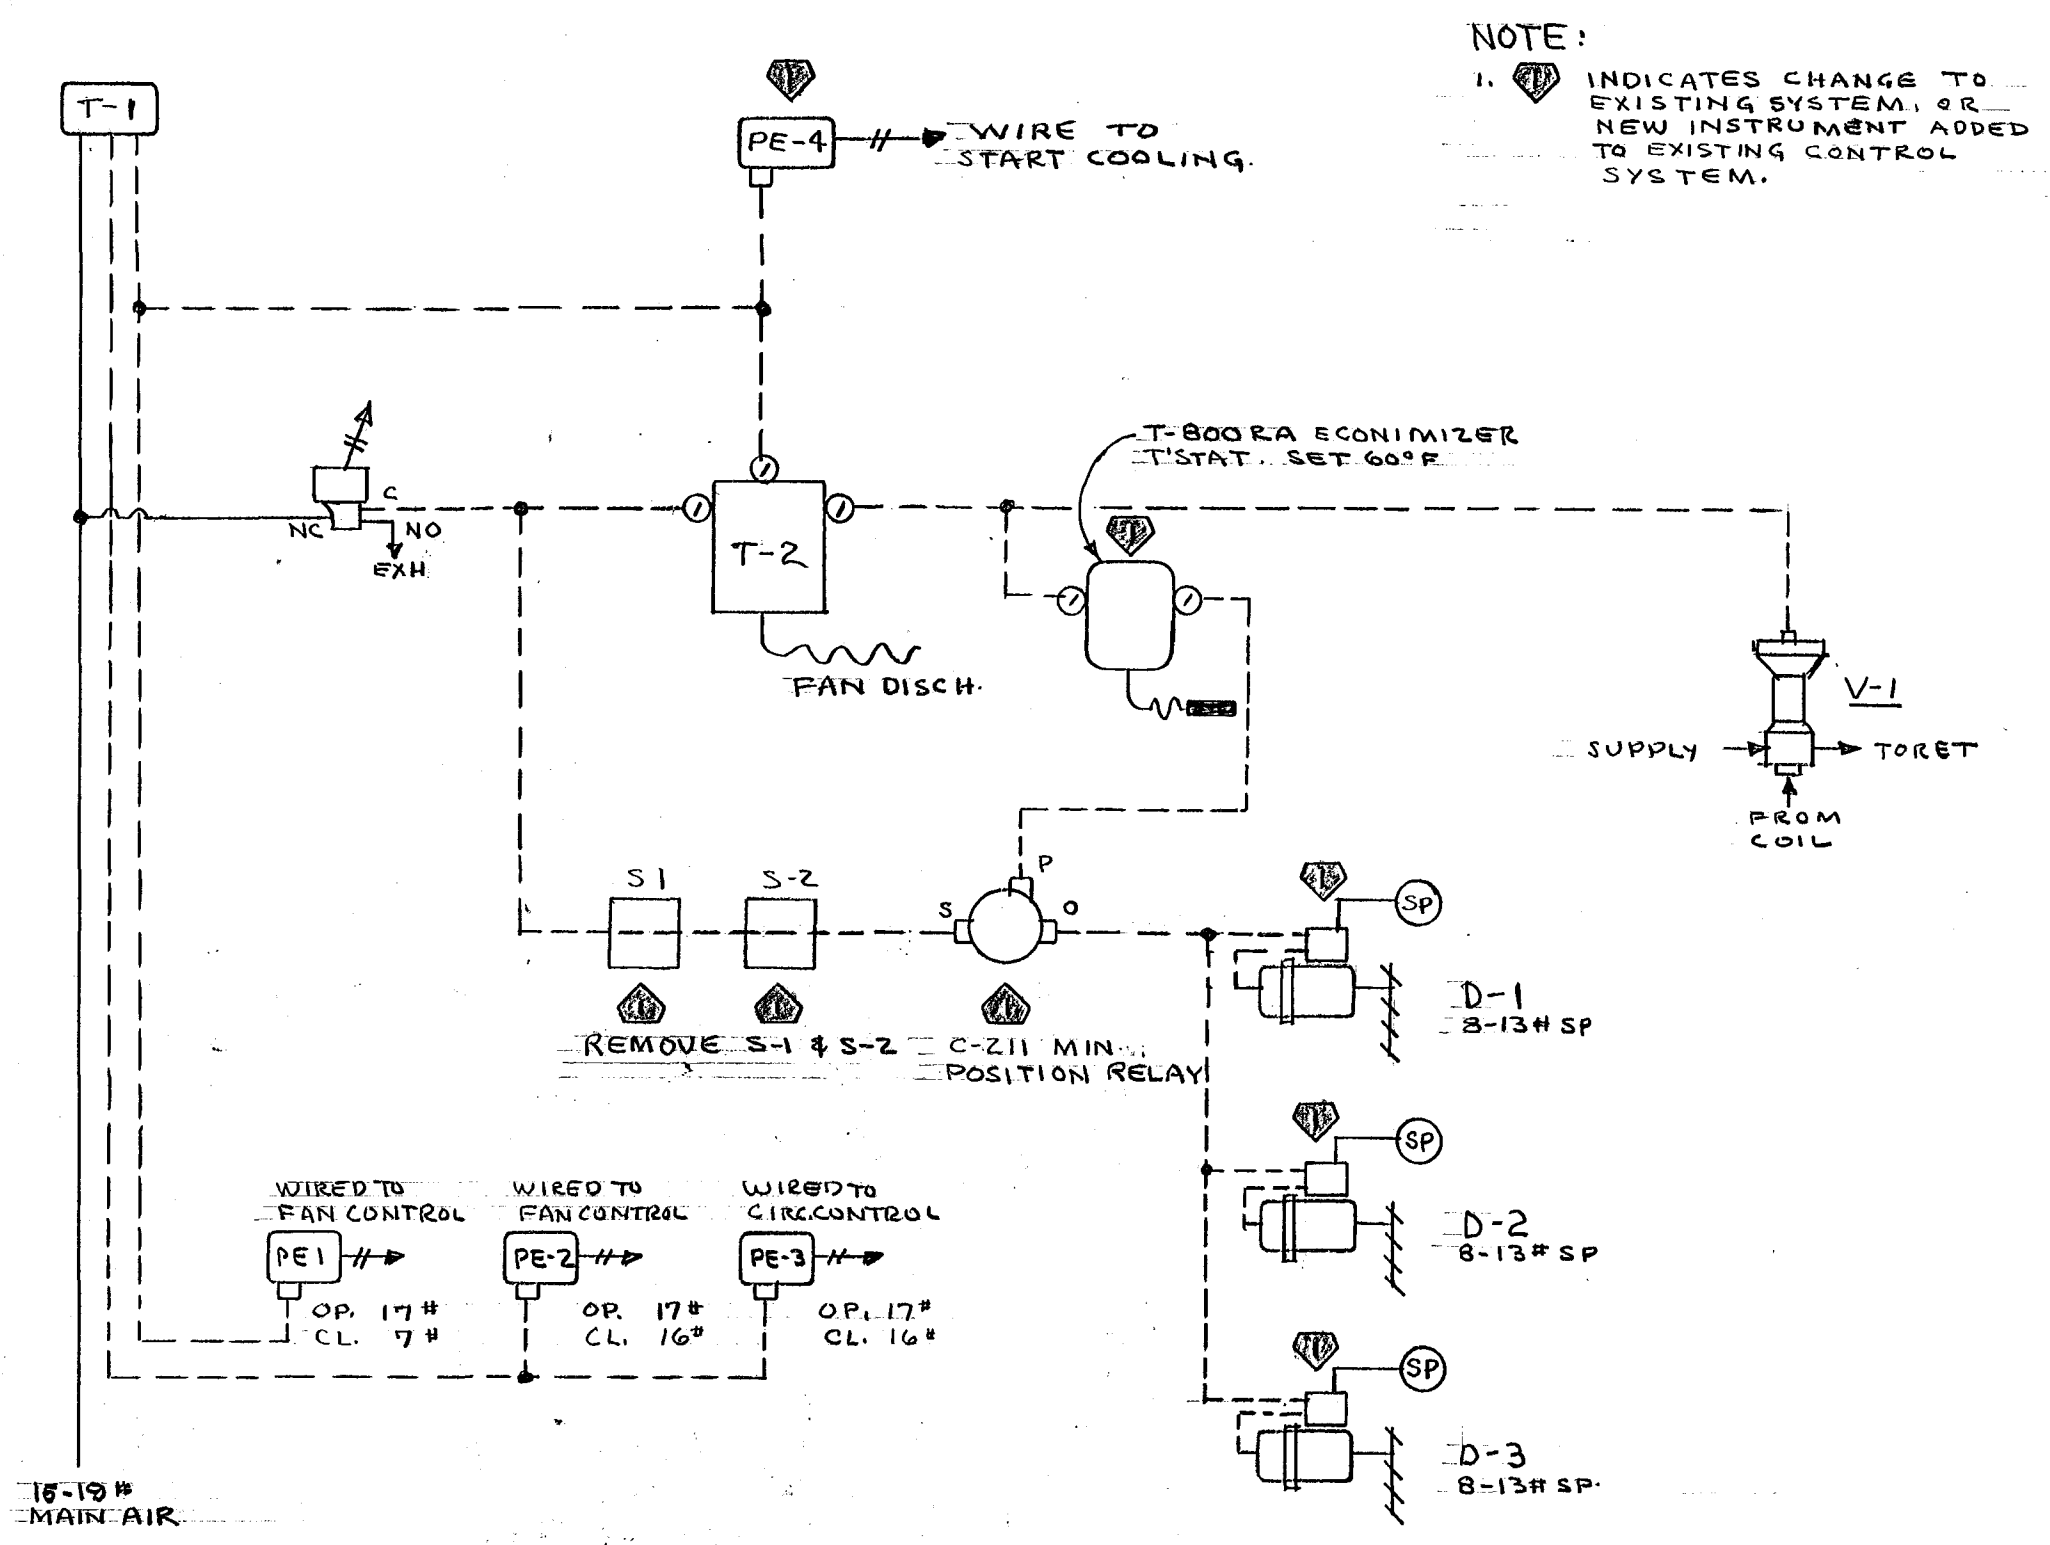

TEMPERATURE CONTROL SYSTEM
NO SCALE

NOTE:
1. DIAMOND INDICATES CHANGE TO EXISTING SYSTEM, OR NEW INSTRUMENT ADDED TO EXISTING CONTROL SYSTEM.

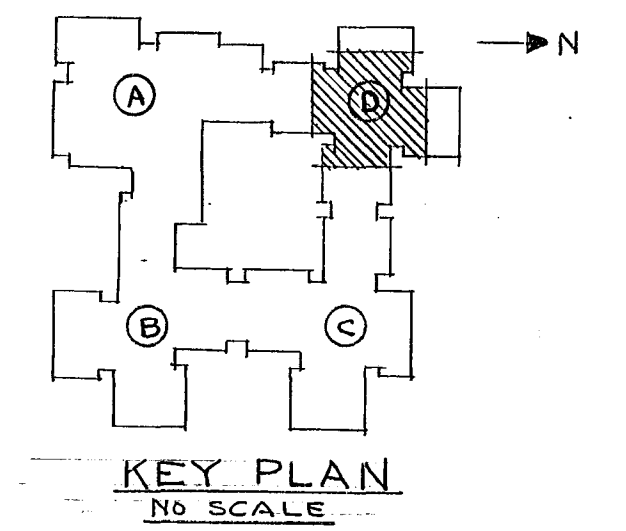

KEY PLAN
NO SCALE

CITY OF HARTFORD, CONNECTICUT DEPARTMENT OF ENGINEERING			
AIR CONDITIONING FOR LECTURE ROOM BUILDING "D" ANNIE FISHER ELEM. SCHOOL PLAINFIELD ST., HARTFORD, CONN.			DWG. No. AC-1
SUBMITTED <i>[Signature]</i>	RECOMMENDED <i>[Signature]</i>	APPROVED <i>[Signature]</i>	
DESIGN P.D.P.	DRAWN P.D.P.	DAYBOOK No. 010099 A	
TRACED	CHECK	DATE MAY 23, 1969	

VERIFY EXISTING
CONDITIONS AND
DIMENSIONS AT
BUILDING