


FED. ROAD DIST. NO.	STATE	TOWN	FED. AID PROJ. NO.	FISCAL YEAR	ROUTE NO.	SHEET NO.	TOTAL SHEETS
9	CONN	Hartford		1941			


HARTFORD BY-PASS - HIGH TENSION CABLE INSTALLATION
Project No. 63-50

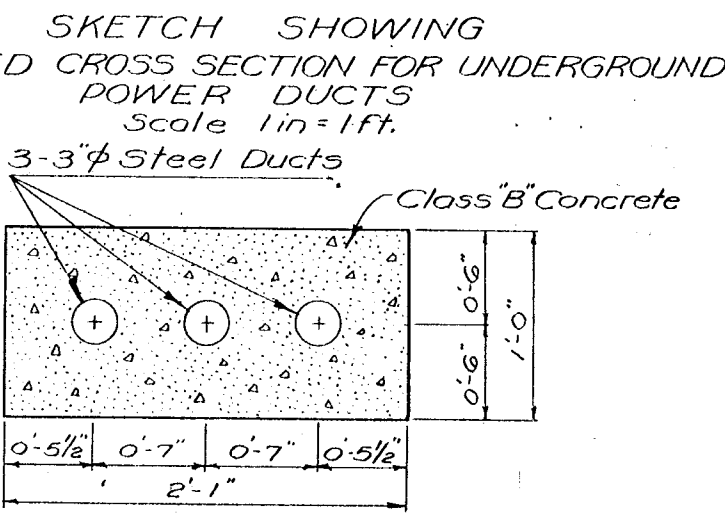



Notes: Minimum Separation between Underground Telephone and Power Cables to be 12 in. of Earth or 3 in. of Concrete.
Minimum Cover to be 2 feet.

PLAN	NOTE BOOK NO.	BY	DATE
Surveyed, Plotted, Line checked, Structures noted			

PROFILE	NOTE BOOK NO.	BY	DATE
Surveyed, Plotted, Grades checked, E. Ms. noted			

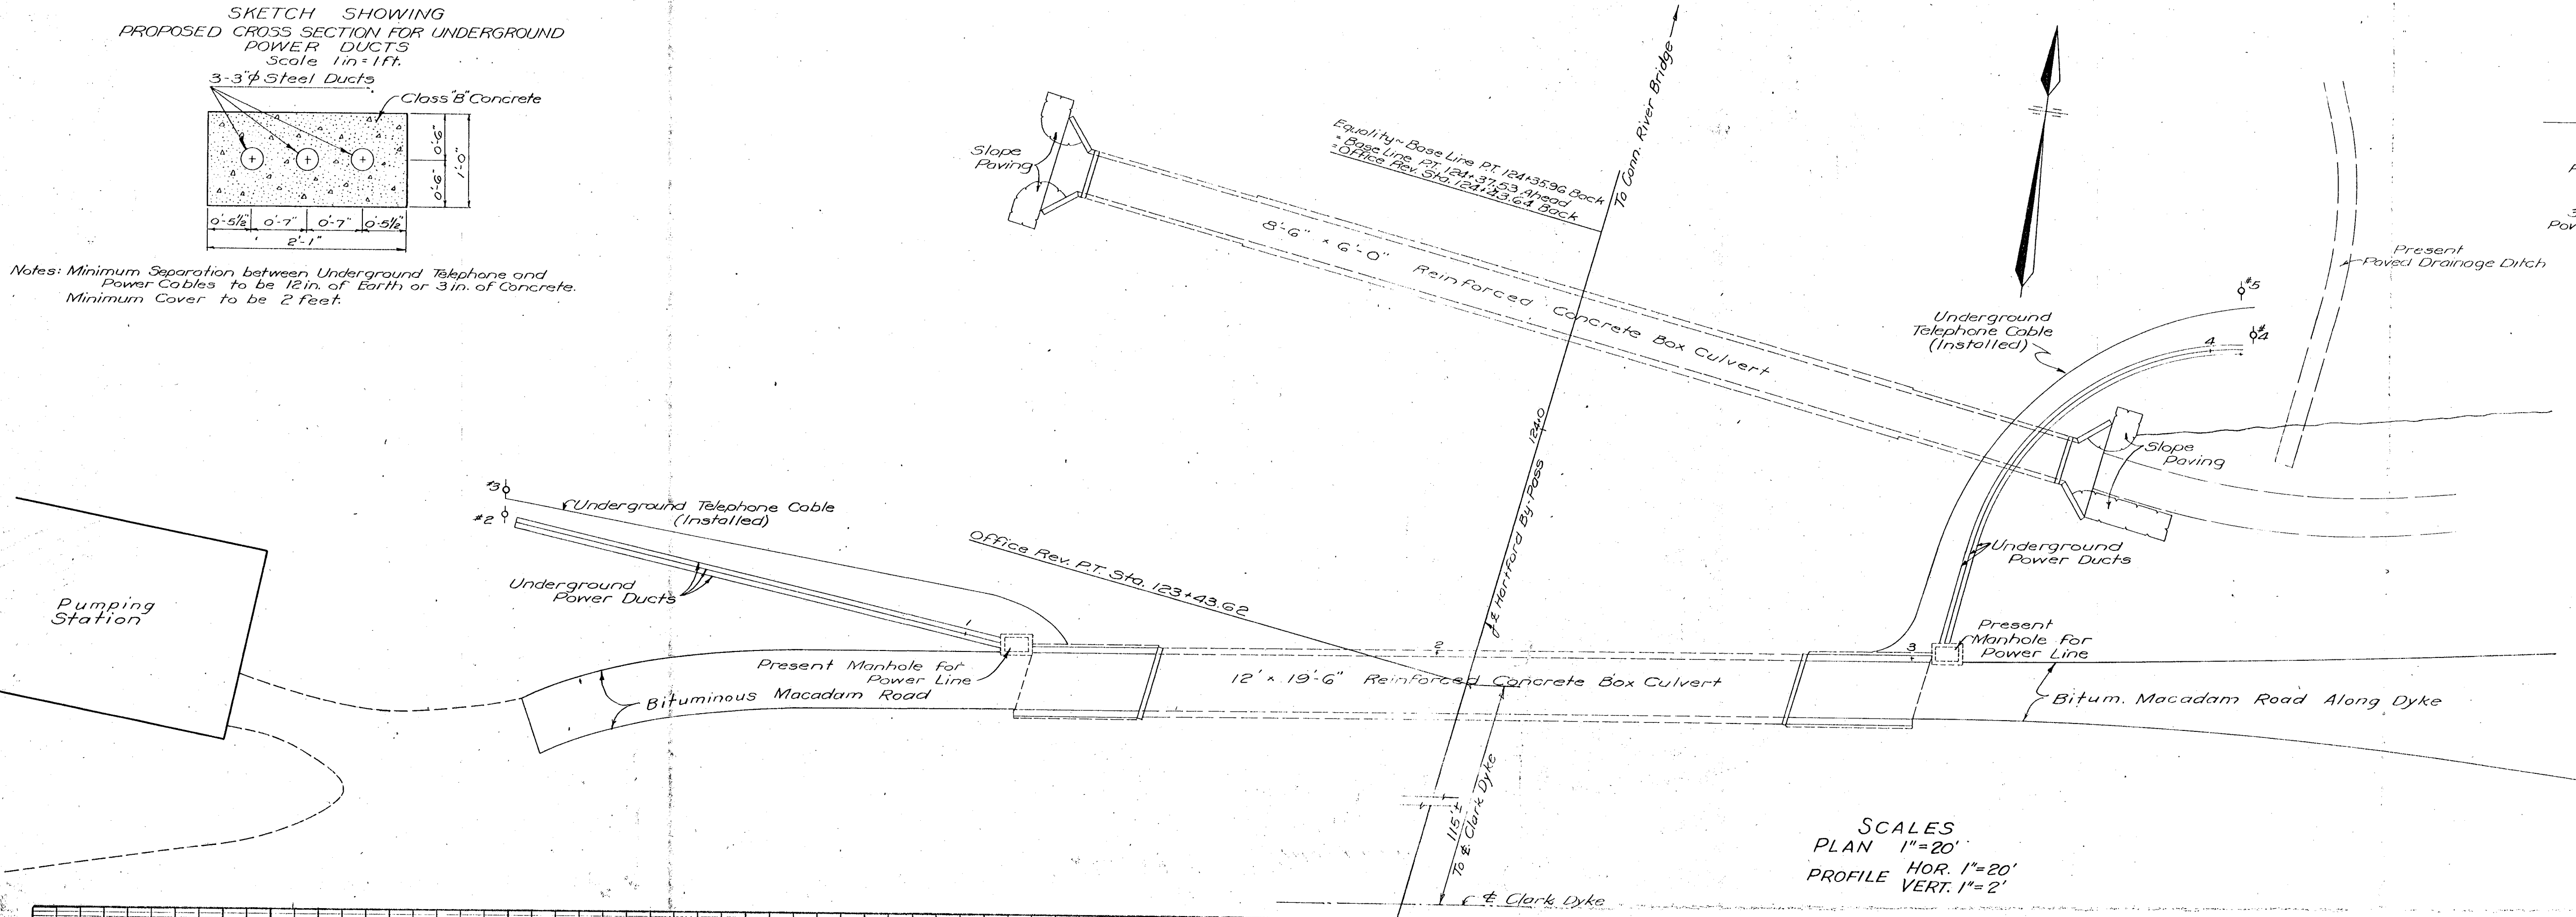

SCALES
PLAN 1" = 20'
PROFILE HOR. 1" = 20'
VERT. 1" = 2'

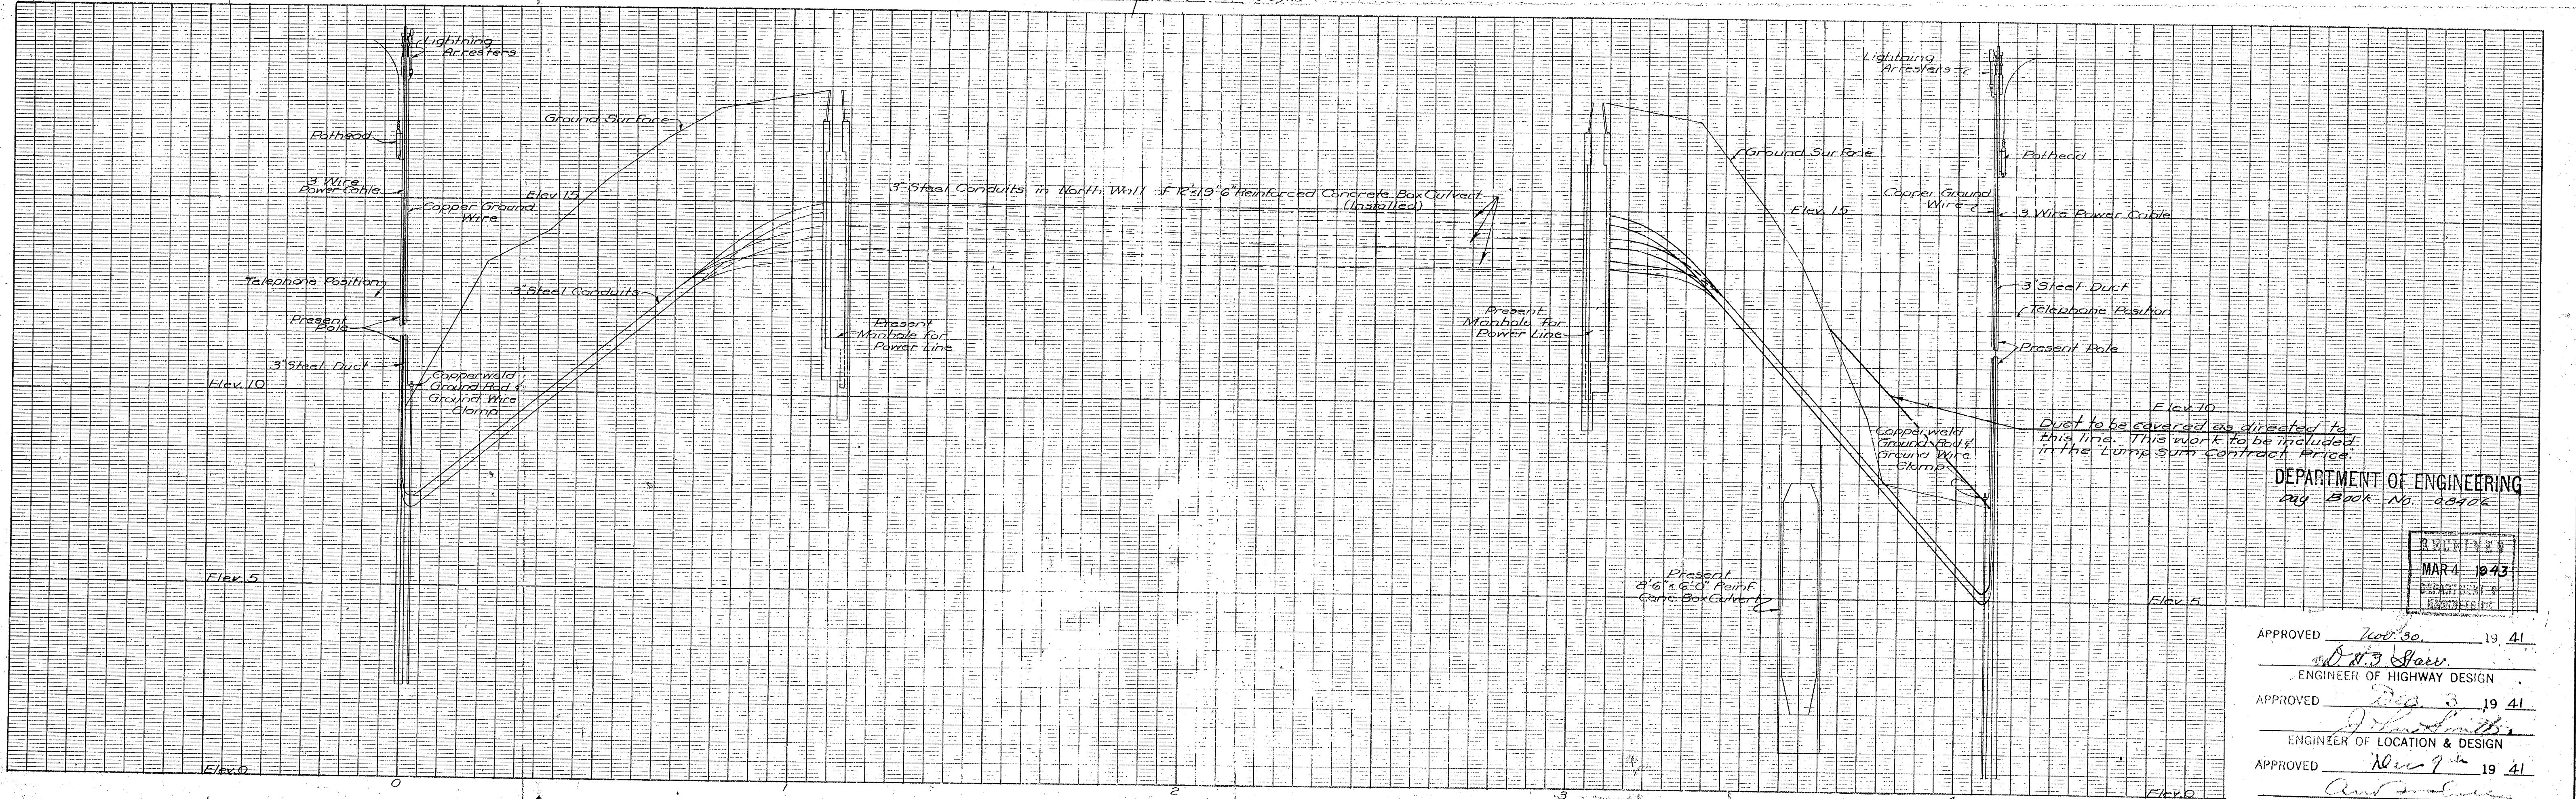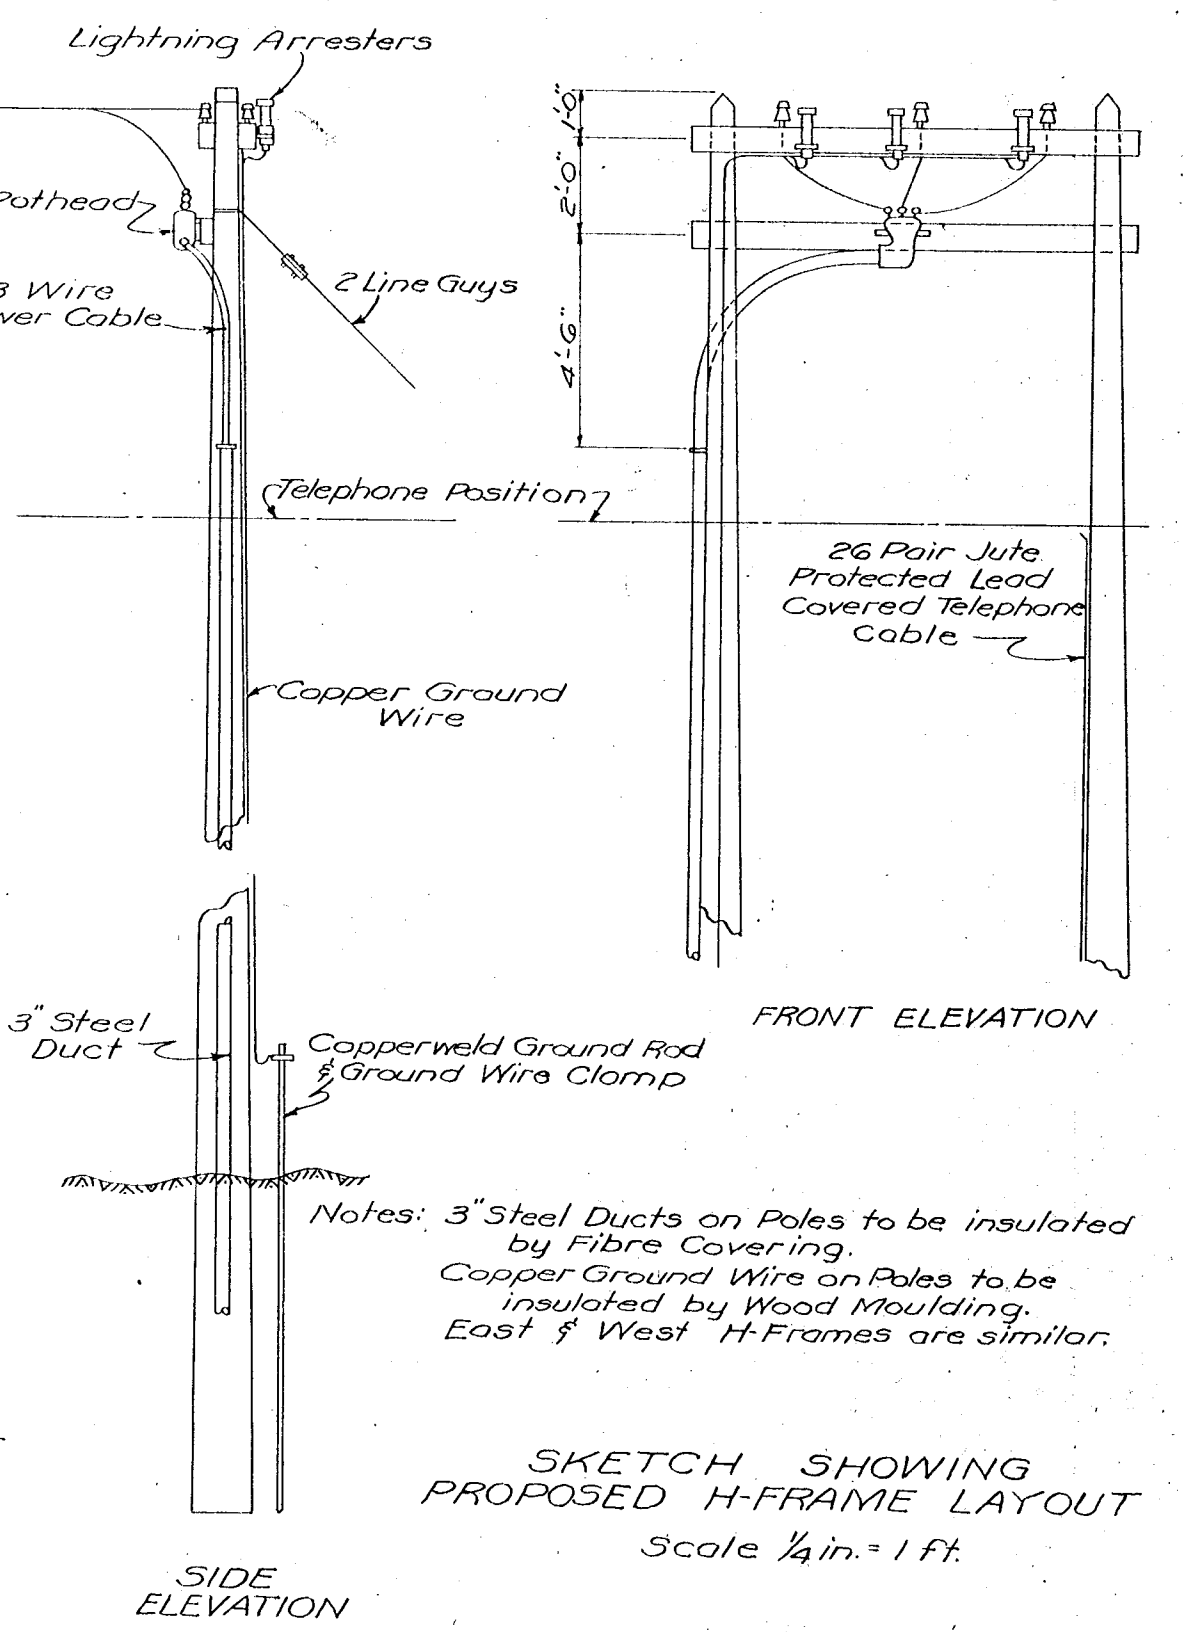

DEPARTMENT OF ENGINEERING
By Book No. 08406

RECEIVED
MAR 4 1943
DEPARTMENT OF ENGINEERING

APPROVED *W. H. 30* 19 41
ENGINEER OF HIGHWAY DESIGN
APPROVED *W. H. 30* 19 41
ENGINEER OF LOCATION & DESIGN
APPROVED *W. H. 30* 19 41
DIRECTOR OF ENGINEERING & CONSTRUCTION