


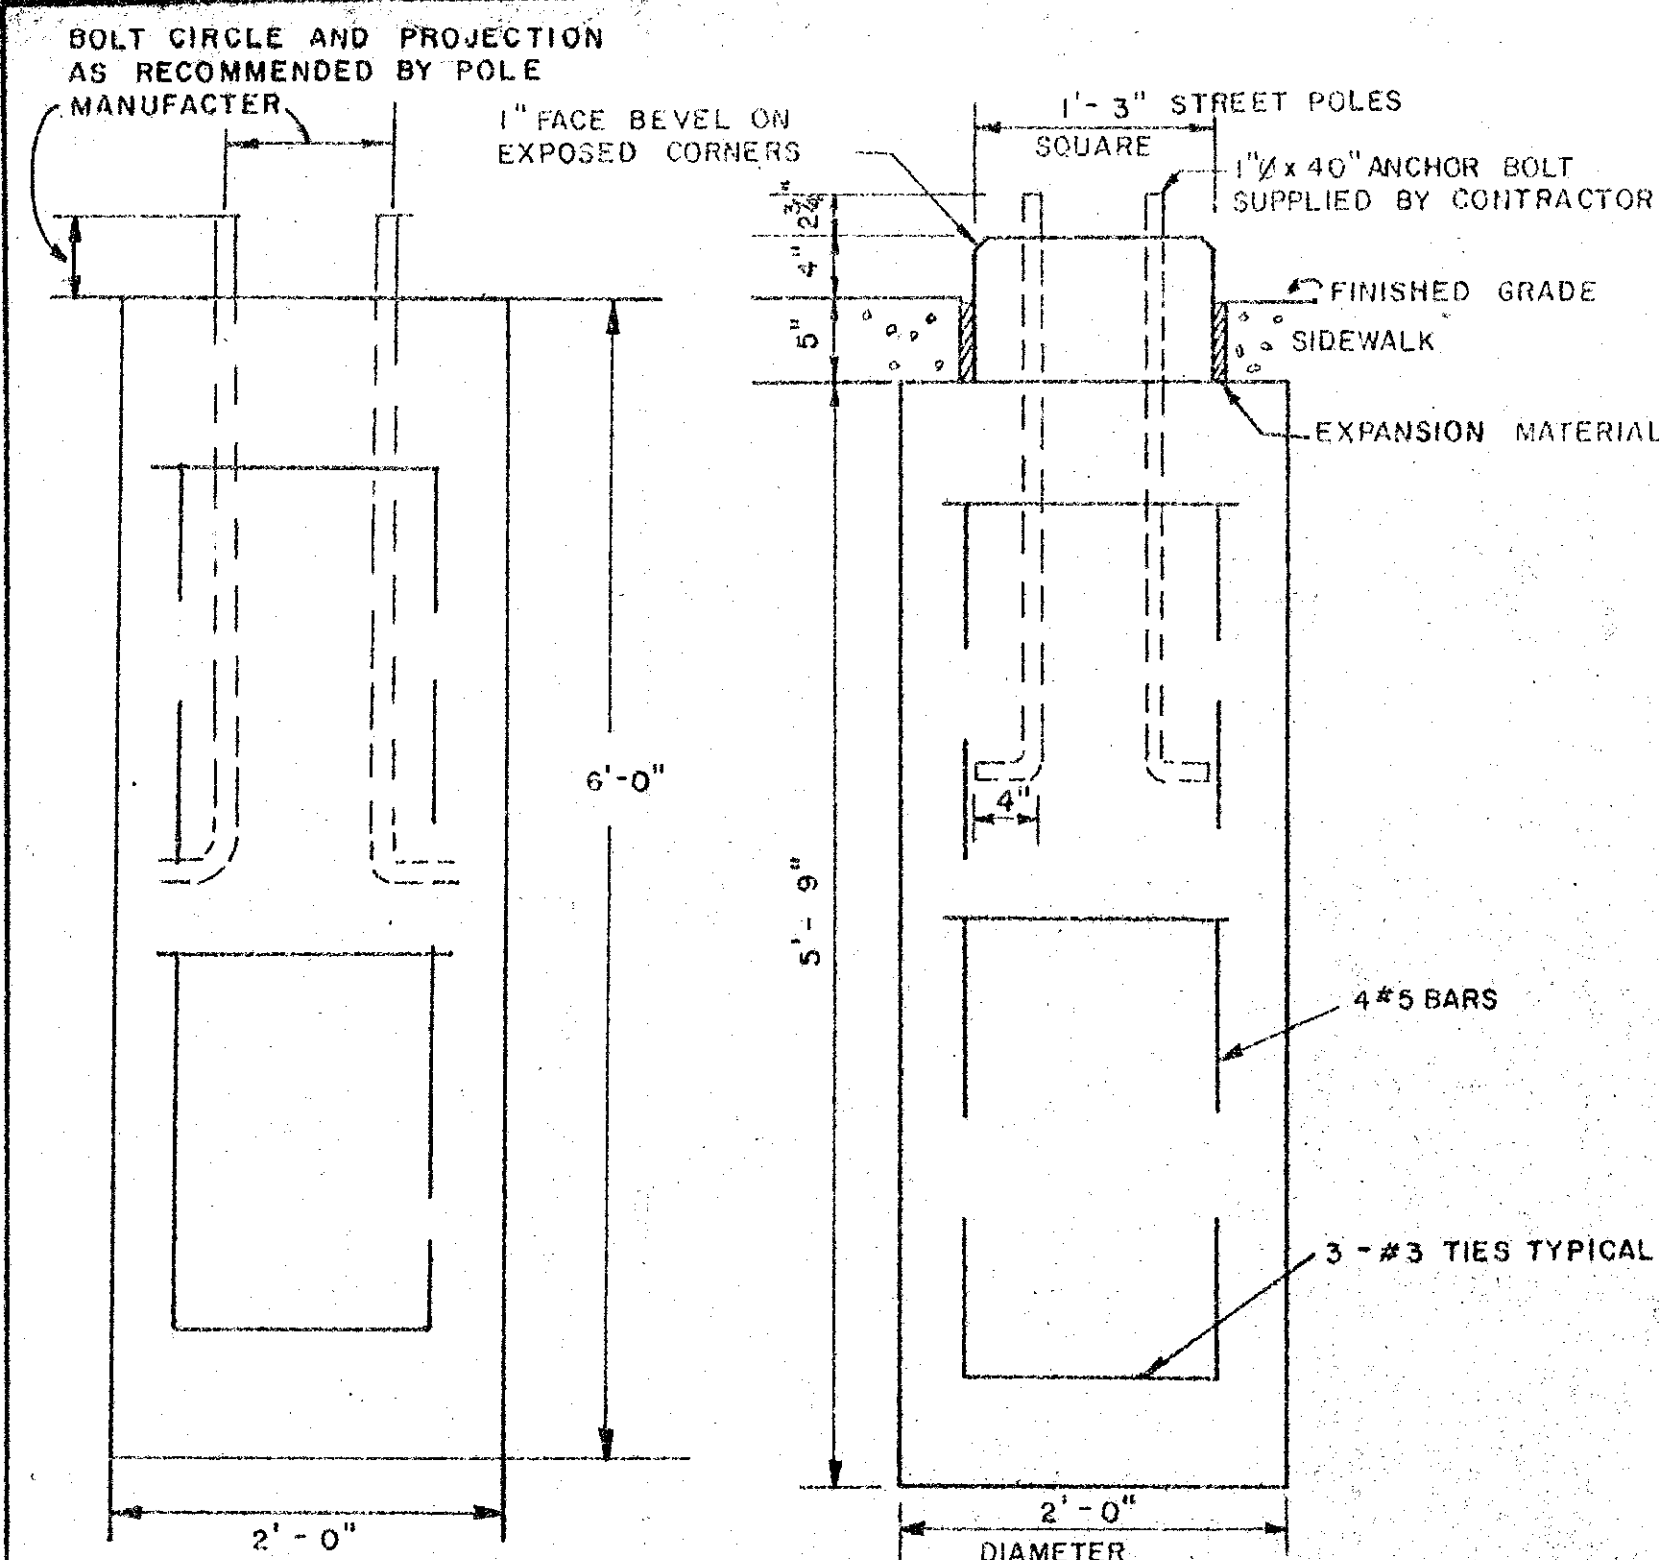


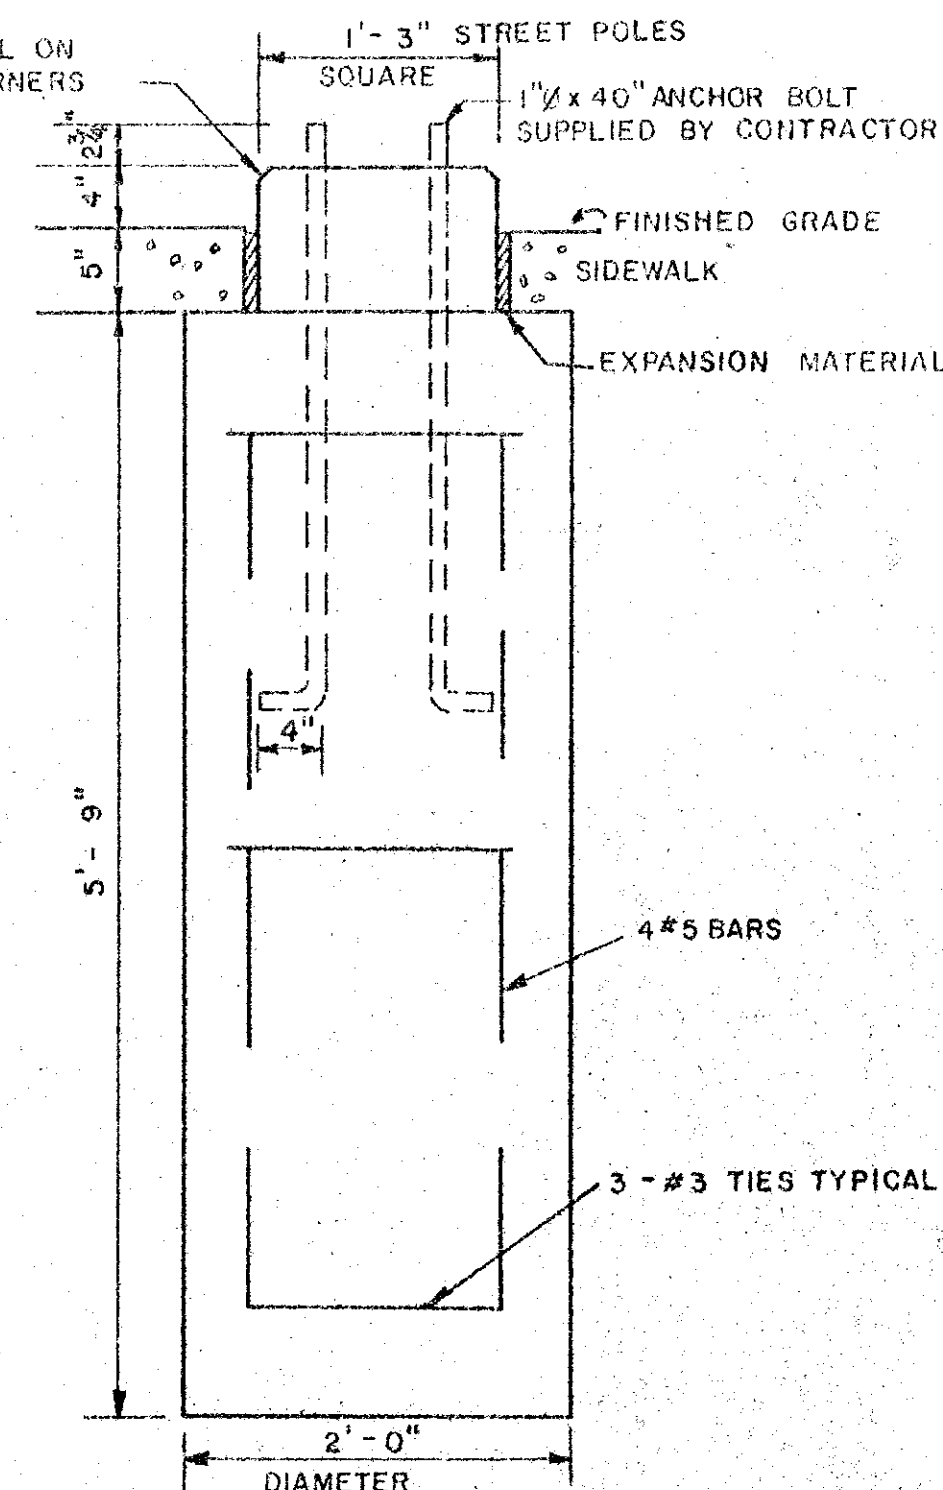




ANCHOR BASE FOR SPORTS LIGHT POLE

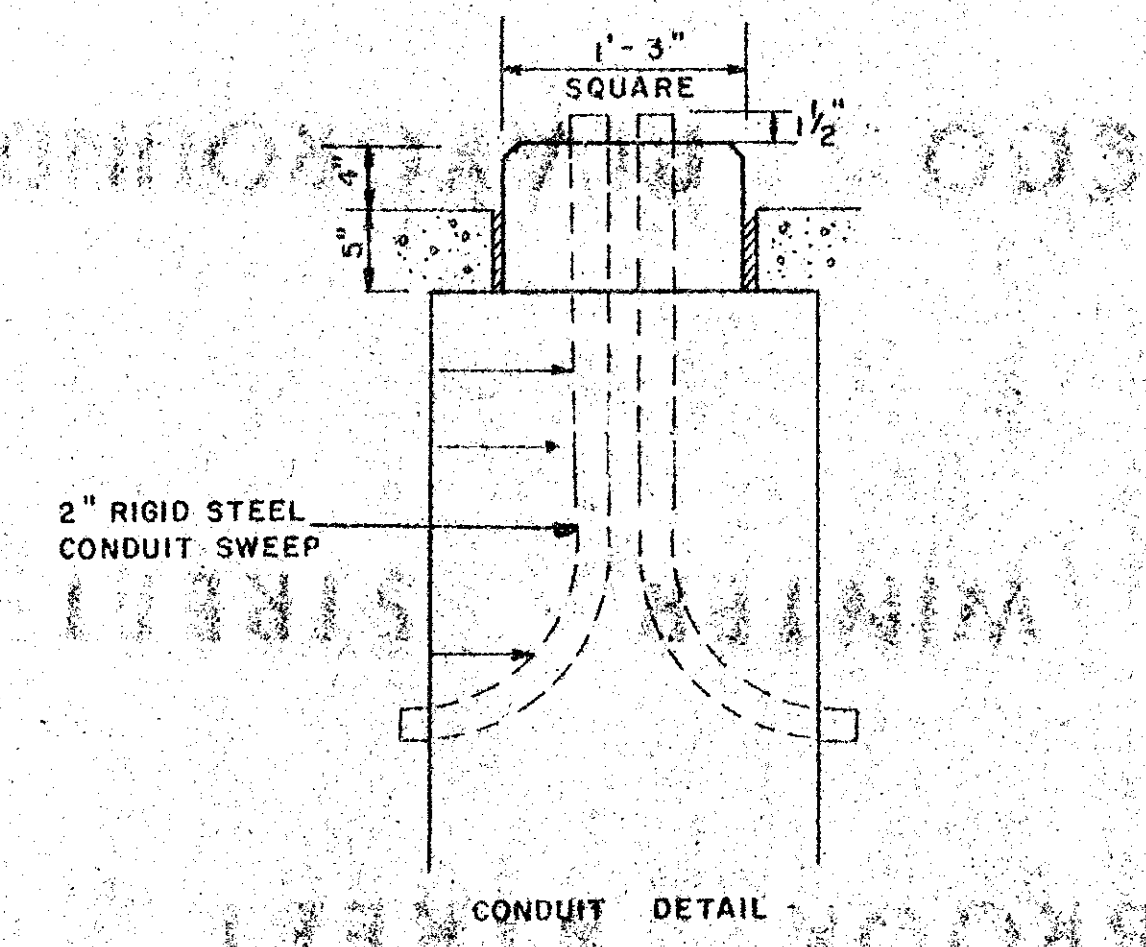

ANCHOR BASE FOR STREET LIGHT POLE

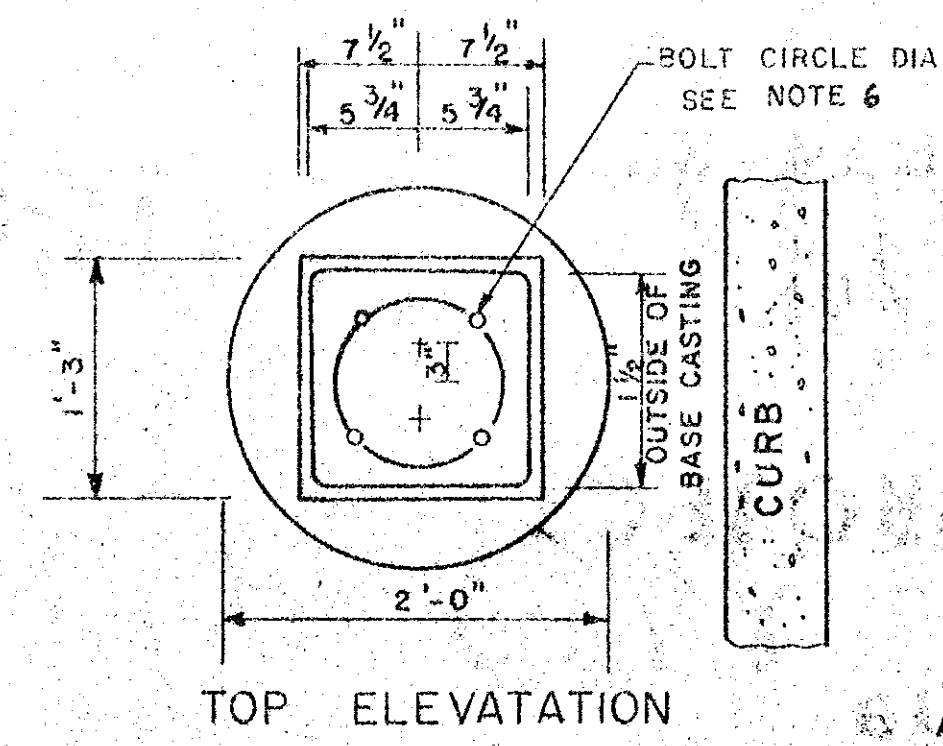


ANCHOR BASE ORNAMENTAL FOUNDATION DETAILS

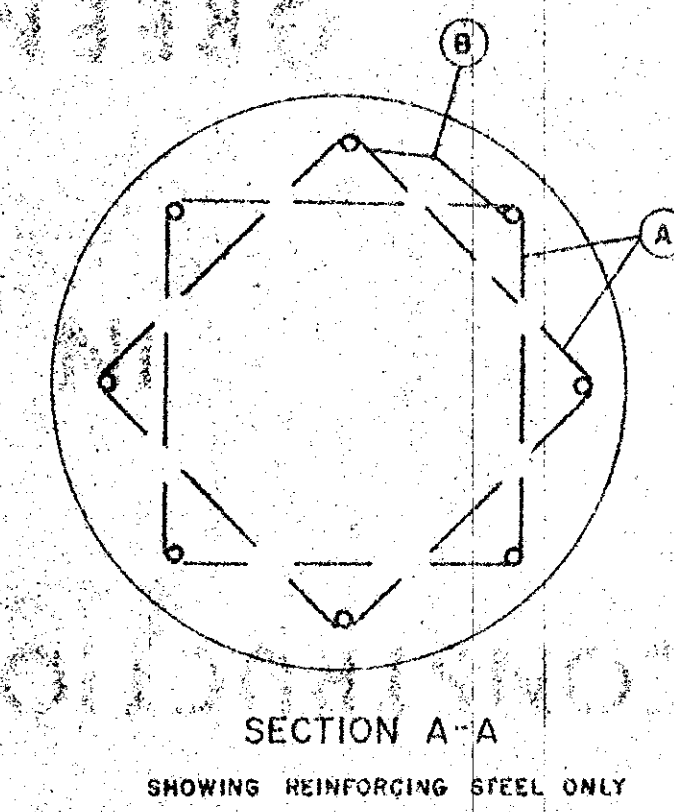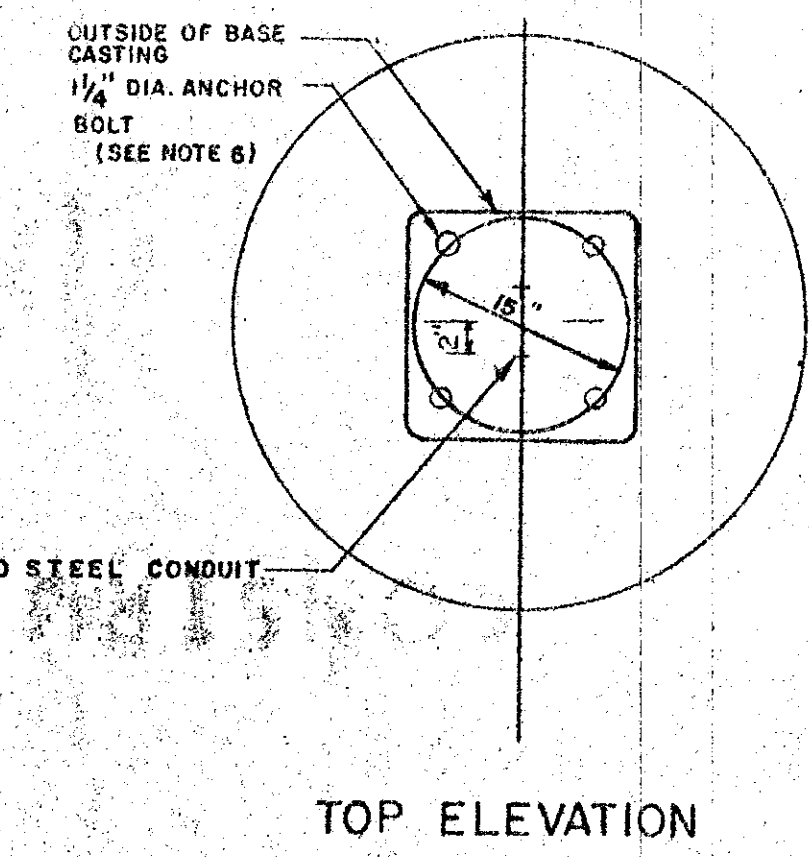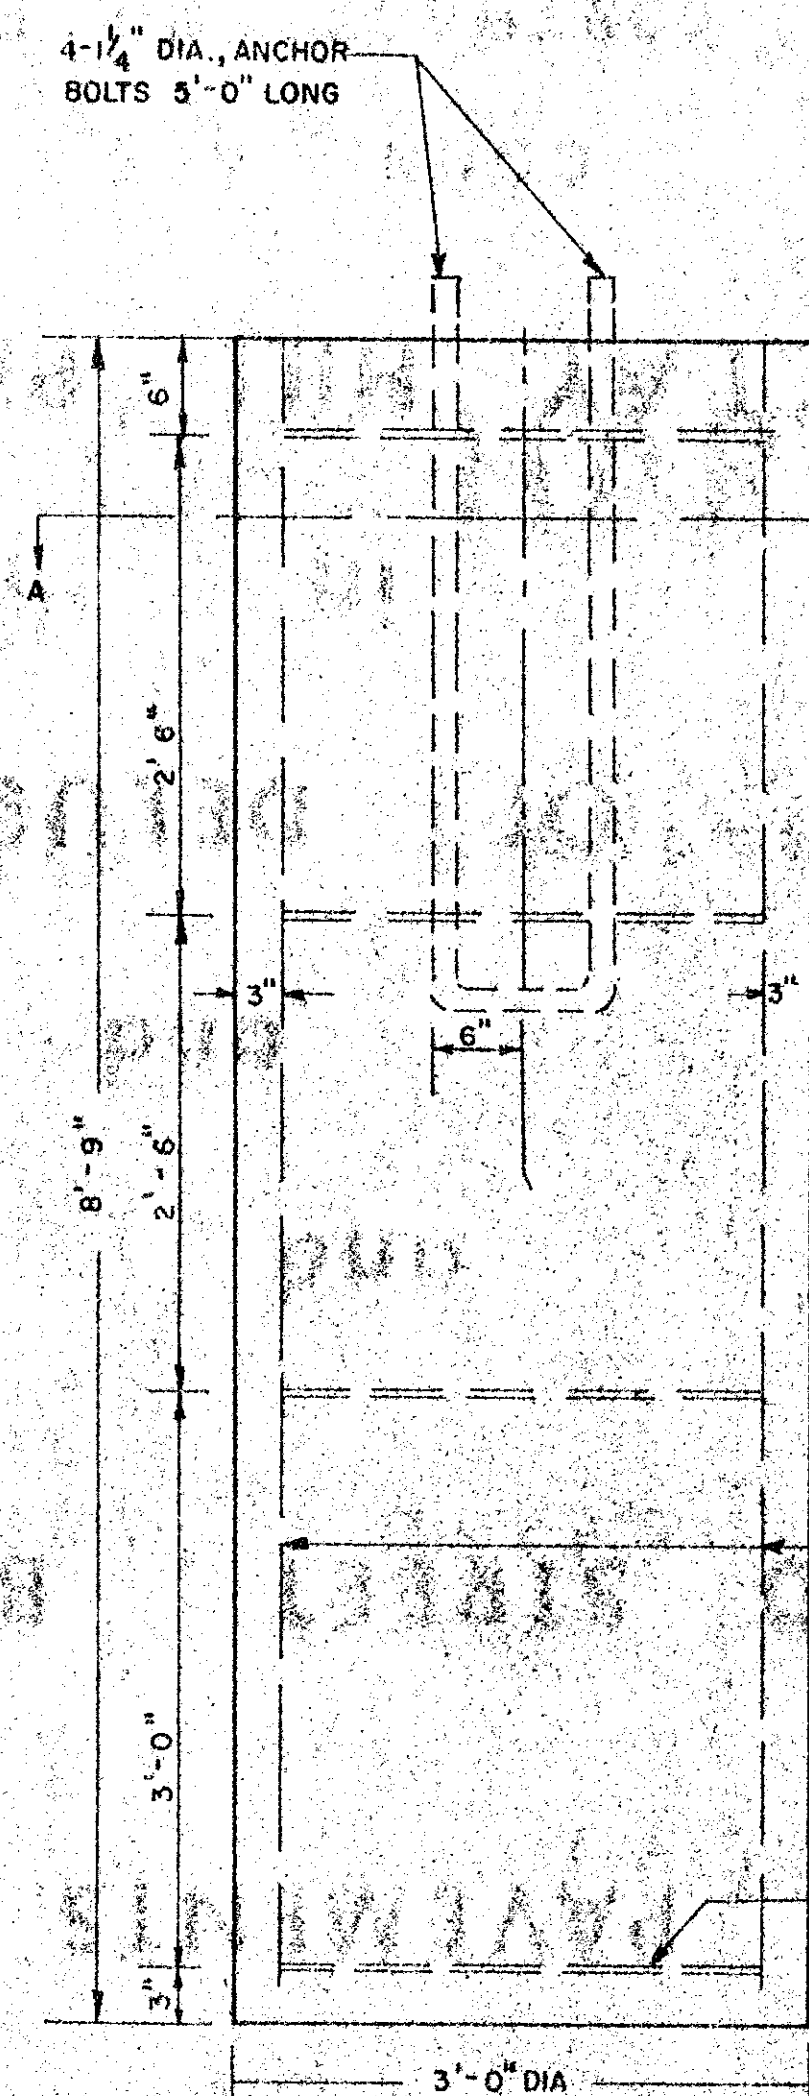


HEAVY DUTY ANCHOR BASE ORNAMENTAL POLE FOUNDATION (SECURITY LIGHT)

REINFORCING SCHEDULE				
FOUNDATION	ROD	DESCRIPTION	LENGTH	REQ'D
9'-6" DEPTH	A	1" x 40" ANCHOR BOLT	8'-0"	8
9'-6" DEPTH	B	#6 BAR STRAIGHT	8'-6"	8

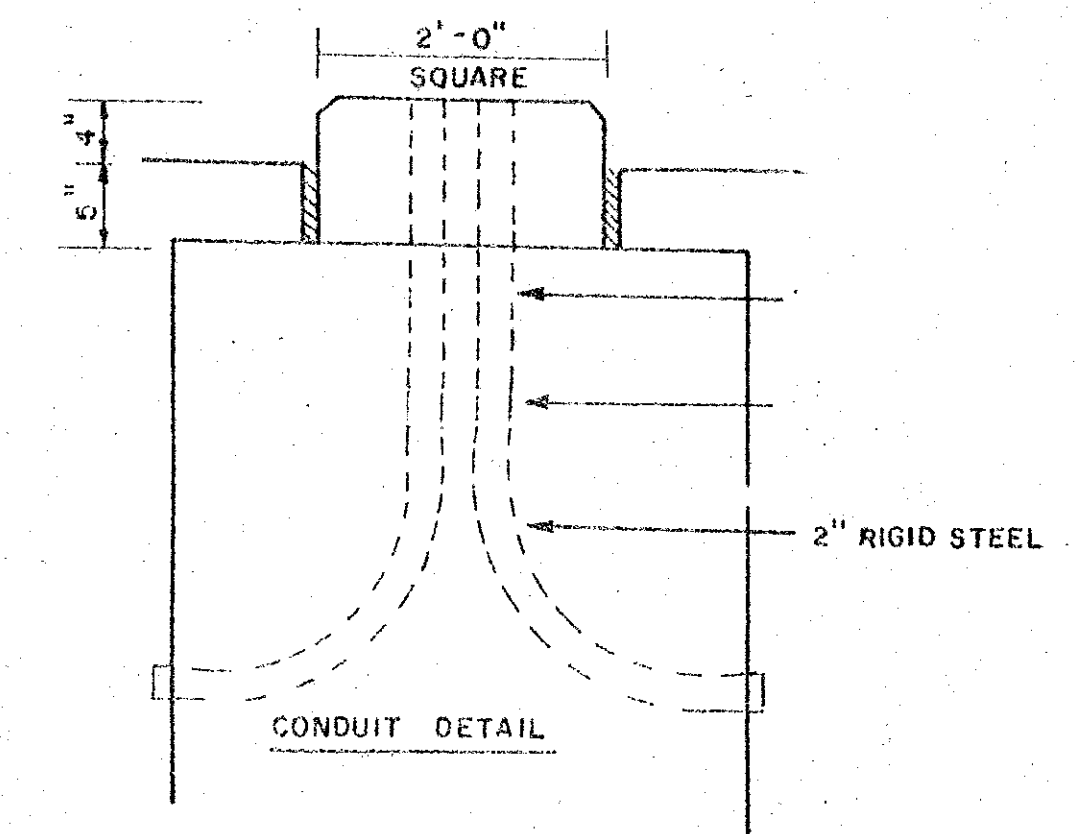

- NOTES
1. CONCRETE TO BE 3,000 P.S.I. MINIMUM AT 28 DAYS
 2. TOP OF FOUNDATION MUST BE LEVEL
 3. INSTALL 2 ADJACENT ANCHOR BOLTS PARALLEL TO STREET.
 4. THE HEAVY DUTY ANCHOR BASE ORNAMENTAL POLE FOUNDATION IS TO BE USED FOR SECURITY LIGHT POLE ONLY.
 5. FOR ANCHOR BASE ORNAMENTAL STREET LIGHT POLE FOUNDATION THE DESIGN LOADS ARE 300# HORIZONTAL WIRE LOAD APPLIED 30'-0" ABOVE TOP OF FOUNDATION, 50# STREET LIGHT ON 8' ARM, AND 8 PSF WIND ON THE POLE.
 6. LOCATION OF ANCHOR BOLTS TO BE ESTABLISHED BY TEMPLATE SUPPLIED BY POLE MANUFACTURER.
 7. THE ENGINEER MUST BE NOTIFIED IN ADVANCE OF ANY WORK ON HEAVY DUTY ANCHOR BASE ORNAMENTAL POLE FOUNDATION.

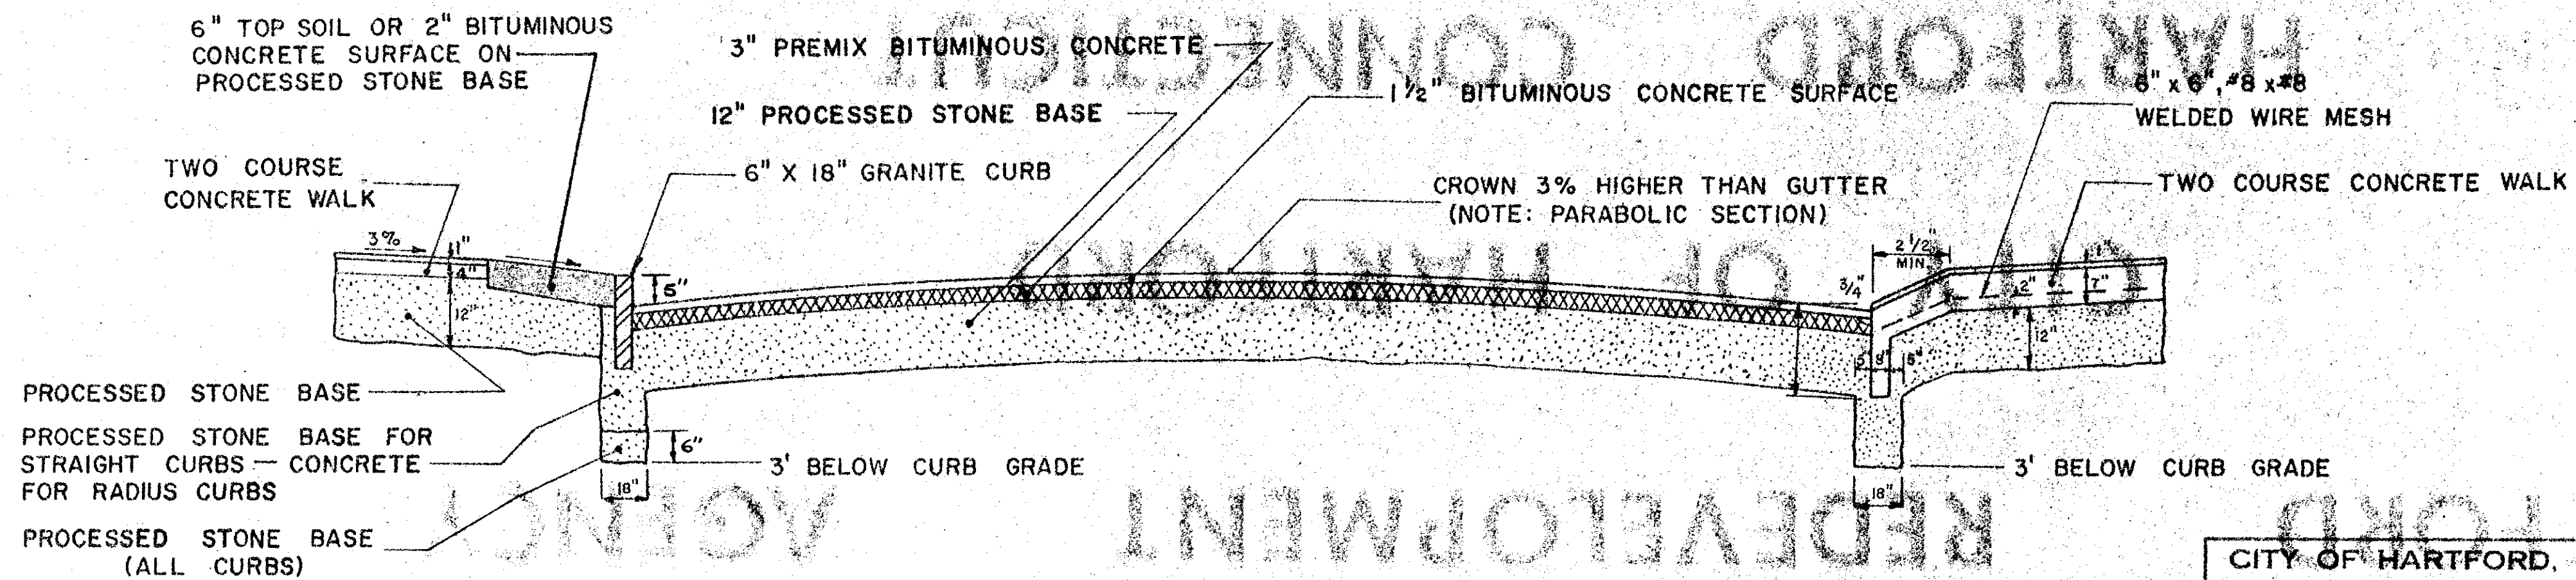

TYPICAL TYPE "B" CROSS-SECTION
SHOWING
SIDEWALK, CURB, and PAVEMENT

CITY OF HARTFORD, CONNECTICUT
DEPARTMENT OF PUBLIC WORKS
BUREAU OF ENGINEERING SERVICES

MISCELLANEOUS DETAILS

SUBMITTED _____ RECOMMENDED _____ APPROVED _____

DIVISION ENGINEER _____ CHIEF OF ENG. SERV. _____ ASST. CHIEF OF ENG. SERV. _____

DRAWN _____ SCALE _____ DAYBOOK NO. 010462-G

CHECKED _____ DATE MAY 24, 1974

CLAY HILL REDEVELOPMENT PROJECT
HARTFORD, CONN.

STORCH ENGINEERS
WETHERSFIELD, CONN.

MAY 1974

SHEET 7 OF 7

IN CHARGE OF JNC
DESIGNED BY JNC JWF
CHECKED BY FSR
DRAWN BY CD
CHECKED BY JNC