

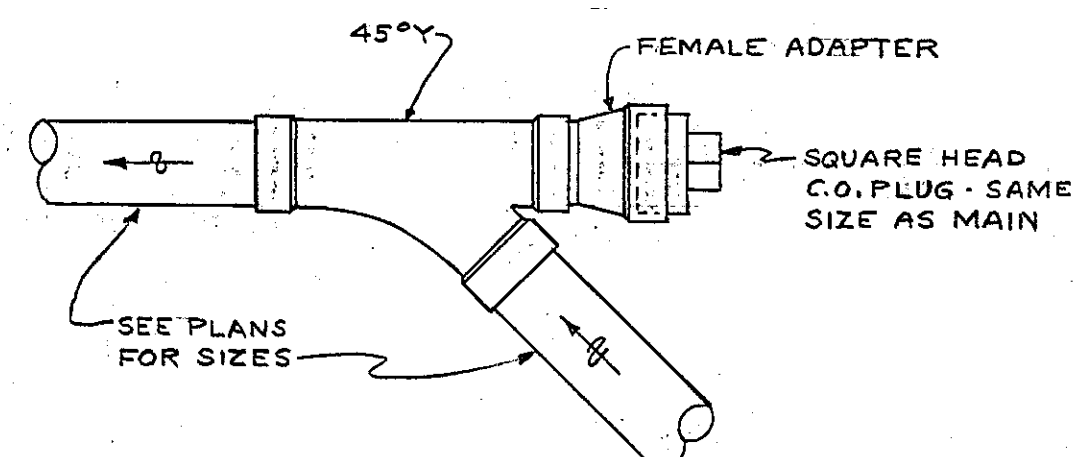


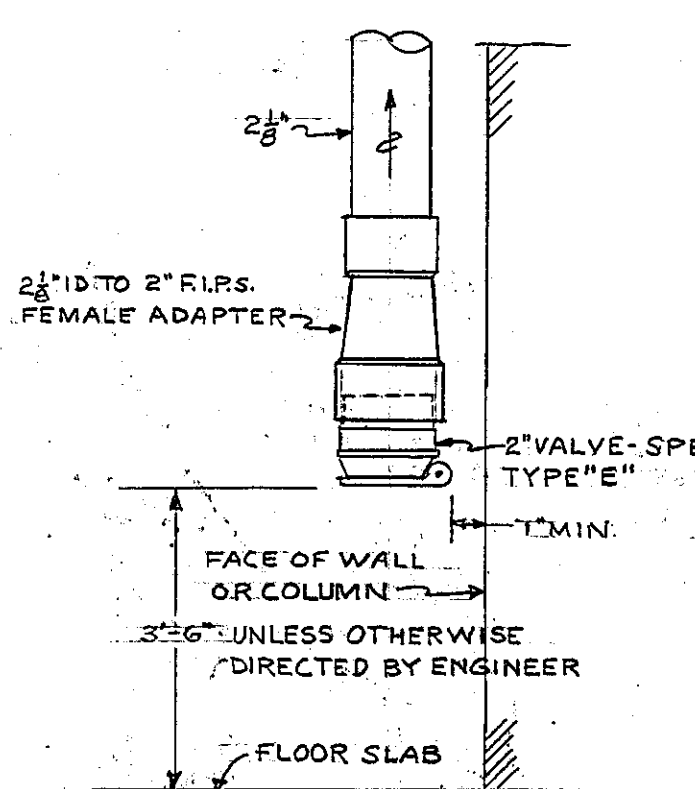


VALVES
CLEANOUTS

TYPICAL PIPING DETAILS - REGULAR DUTY SYSTEM

NO SCALE

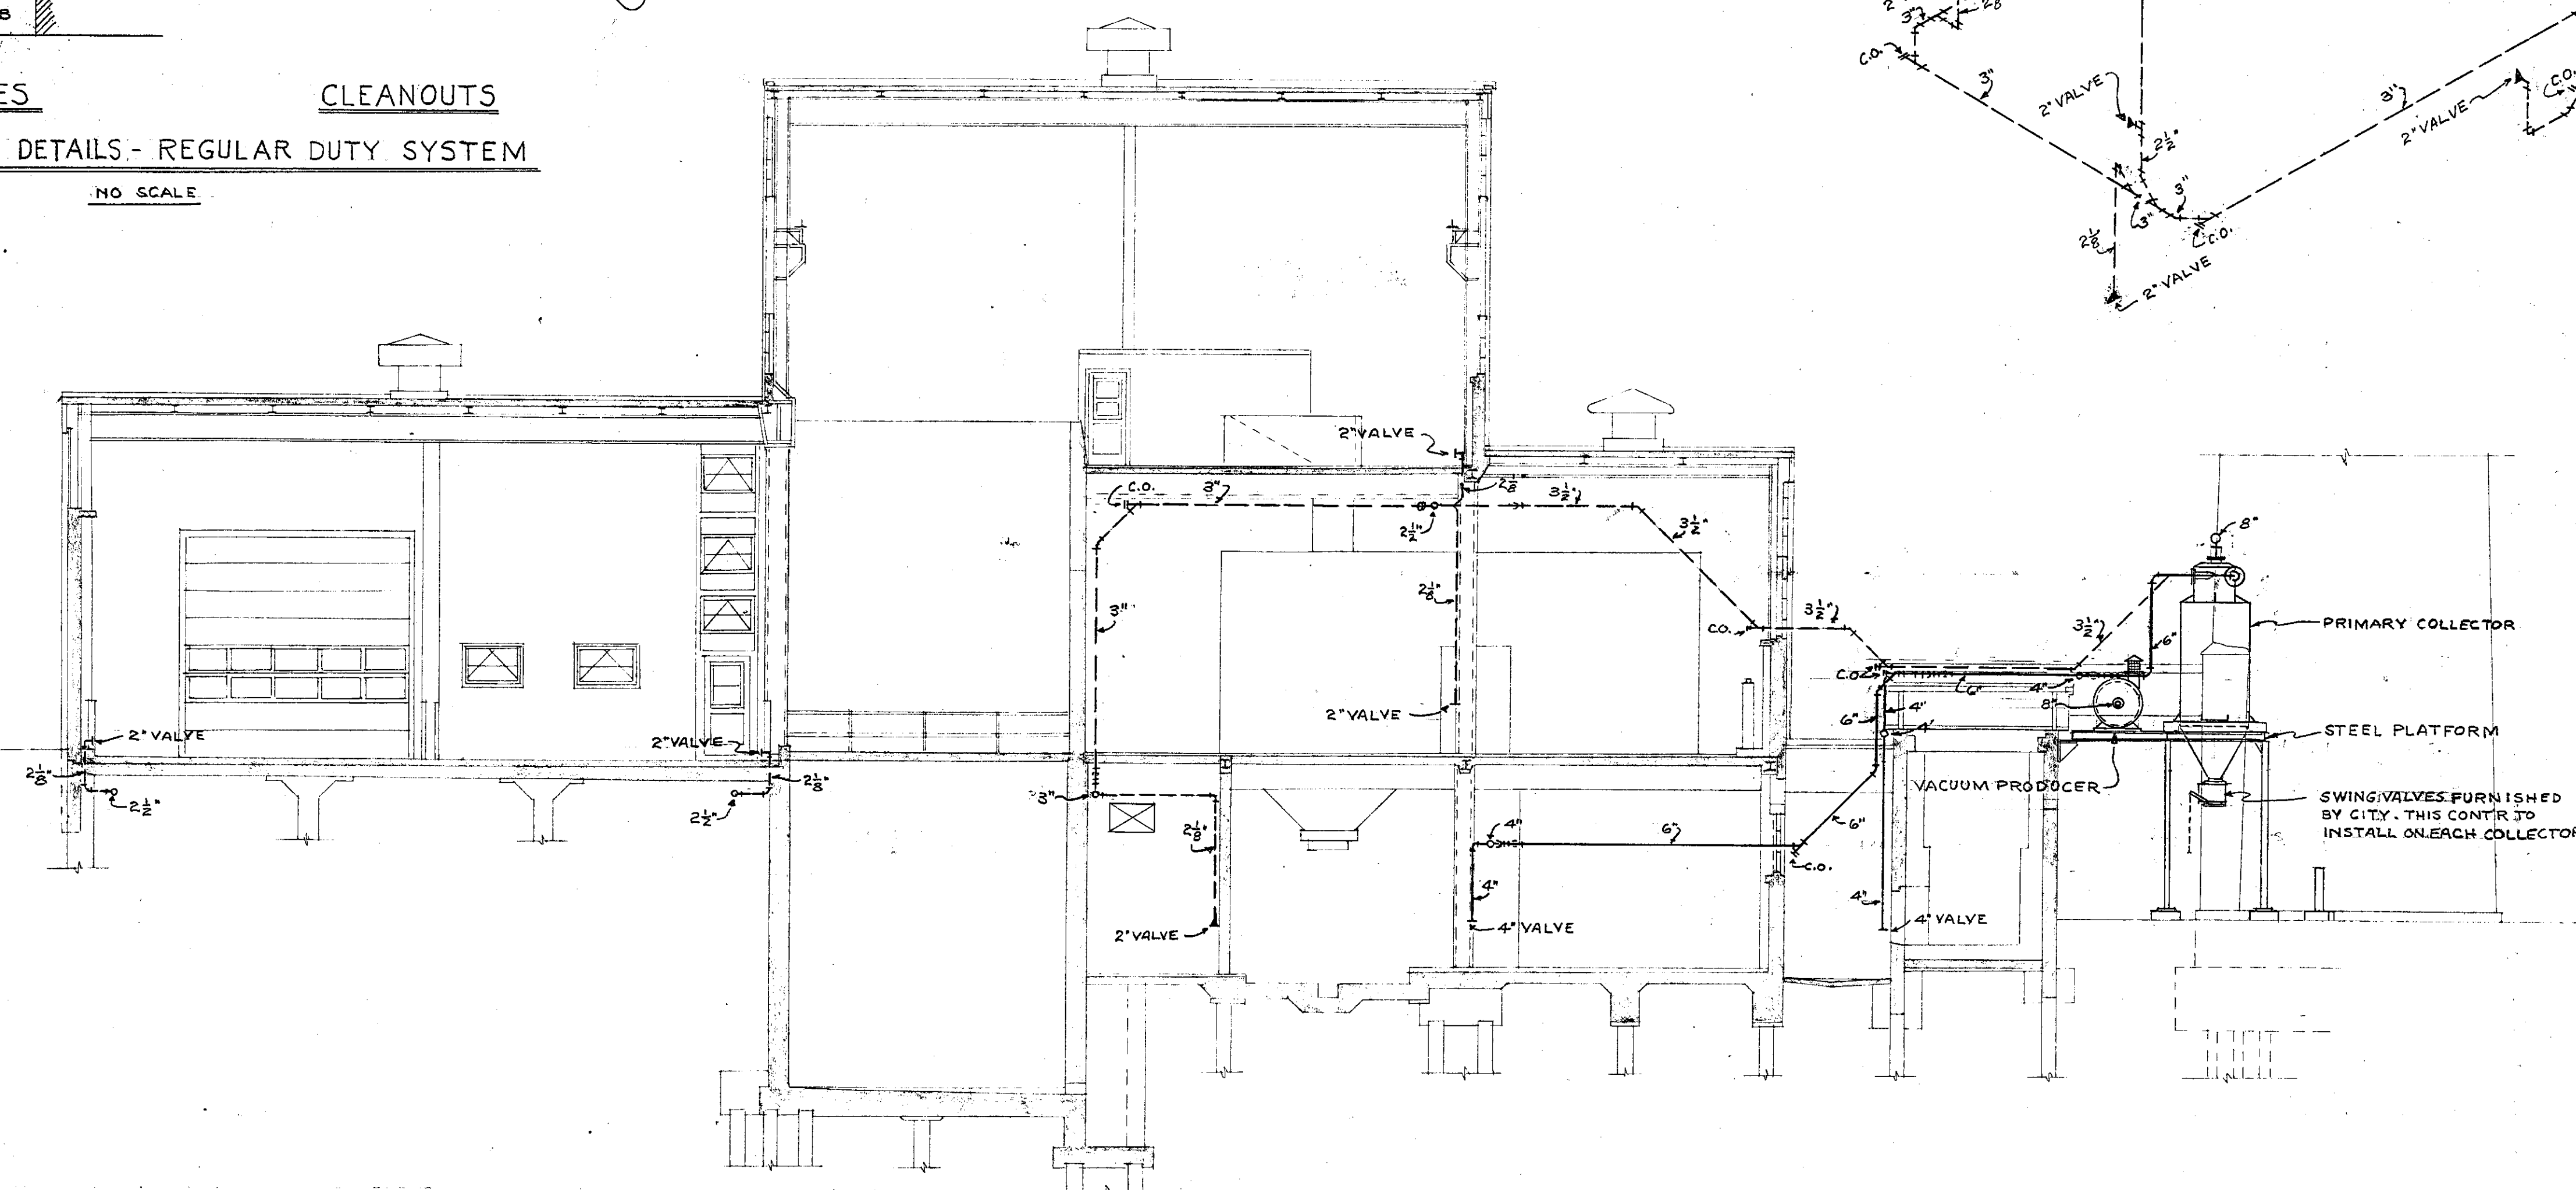

SECTION A-A
SCALE $\frac{1}{8}" = 1'-0"$

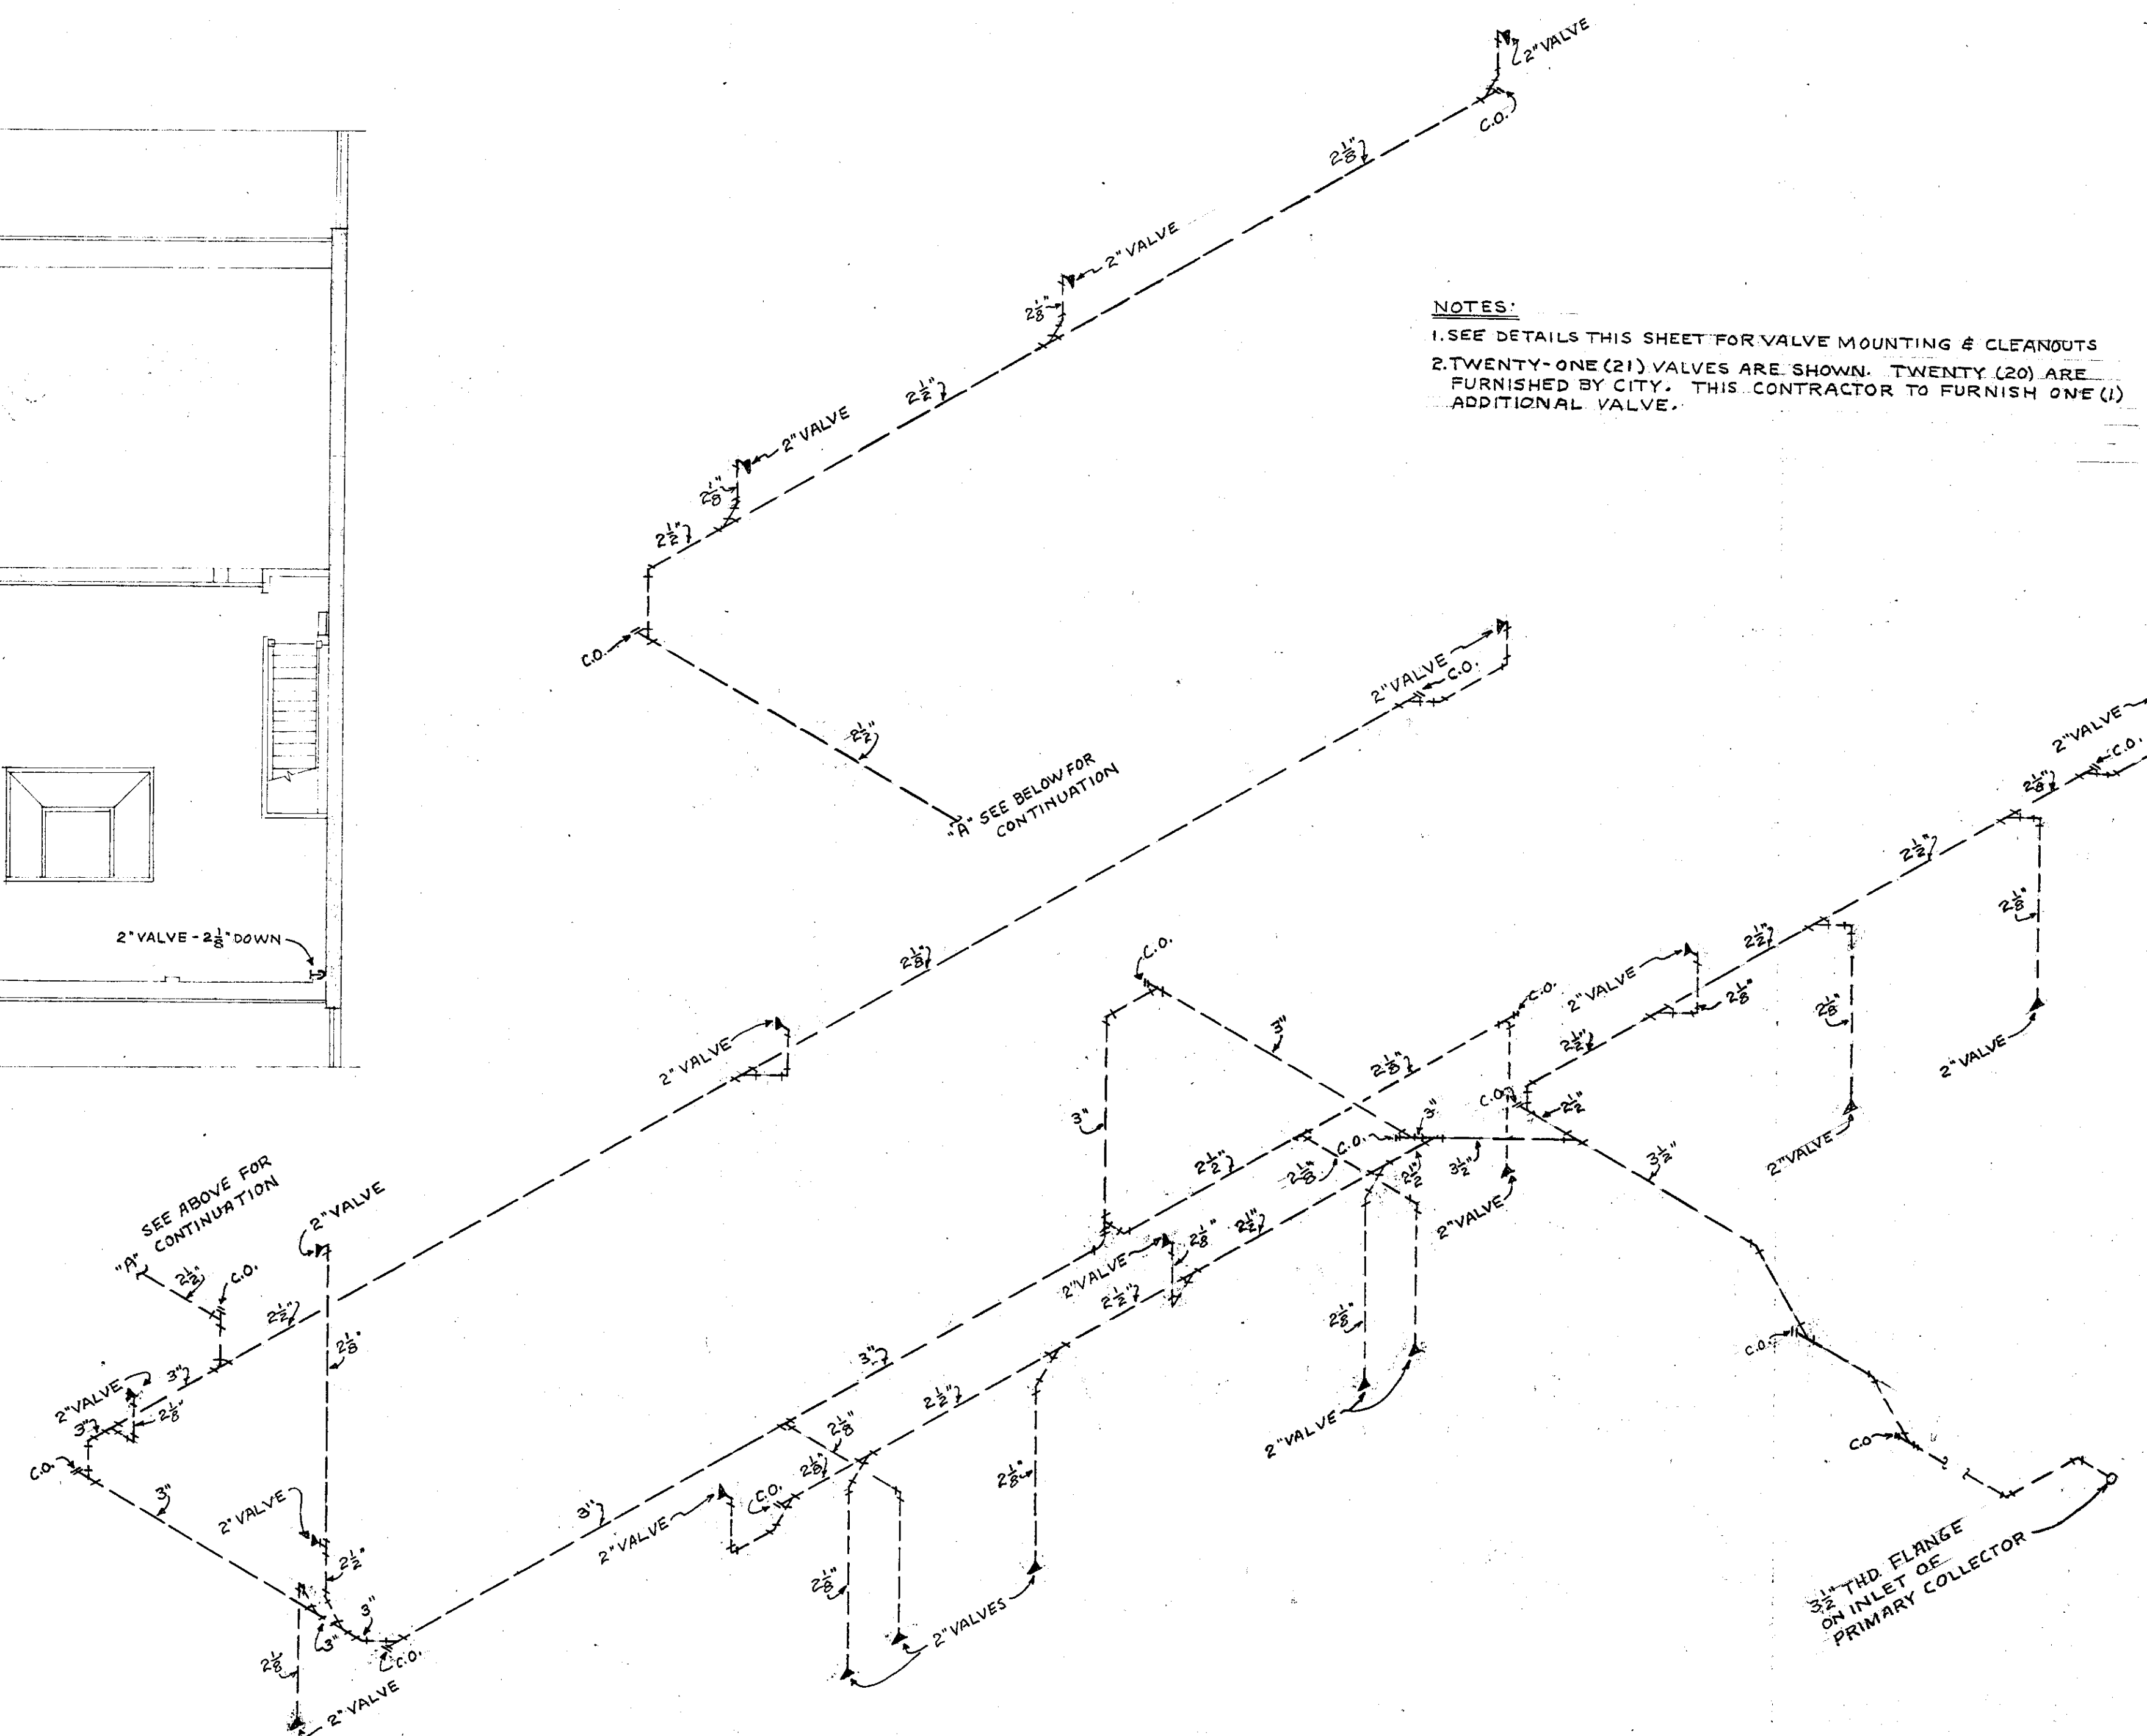

SCHEMATIC PIPING DIAGRAM-REGULAR DUTY VACUUM CLEANING SYSTEM
NO SCALE

- NOTES:
1. SEE DETAILS THIS SHEET FOR VALVE MOUNTING & CLEANOUTS
 2. TWENTY-ONE (21) VALVES ARE SHOWN. TWENTY (20) ARE FURNISHED BY CITY. THIS CONTRACTOR TO FURNISH ONE (1) ADDITIONAL VALVE.

CITY OF HARTFORD, CONNECTICUT
DEPARTMENT OF ENGINEERING

VACUUM CLEANER SYSTEM

INCINERATOR
INCINERATOR ROAD NORTH MEADOWS
HARTFORD CONNECTICUT

SUBMITTED	RECOMMENDED	APPROVED
DIVISION ARCHITECT	<i>Daniel J. Tamm</i>	<i>W. J. Williams</i>
	CITY ARCHITECT	CITY ENGINEER

DESIGN P.D.P. DRAWN P.D.P. DAYBOOK NO. 09649-C

TRACED _____ CHECK _____ DATE DEC 22, 1960