



TREATMENTS FOR SIDEWALK RAMPS
NOT TO SCALE


FWA REGION NO.	STATE	TOWN	FED. AID PROJ. NO.	PROJ. NO.	YEAR	ROUTE NO.	SHEET NO.	TOTAL SHEETS
1	CONN.	HARTFORD	IXM-1063(31)	63-354	1983		21	26

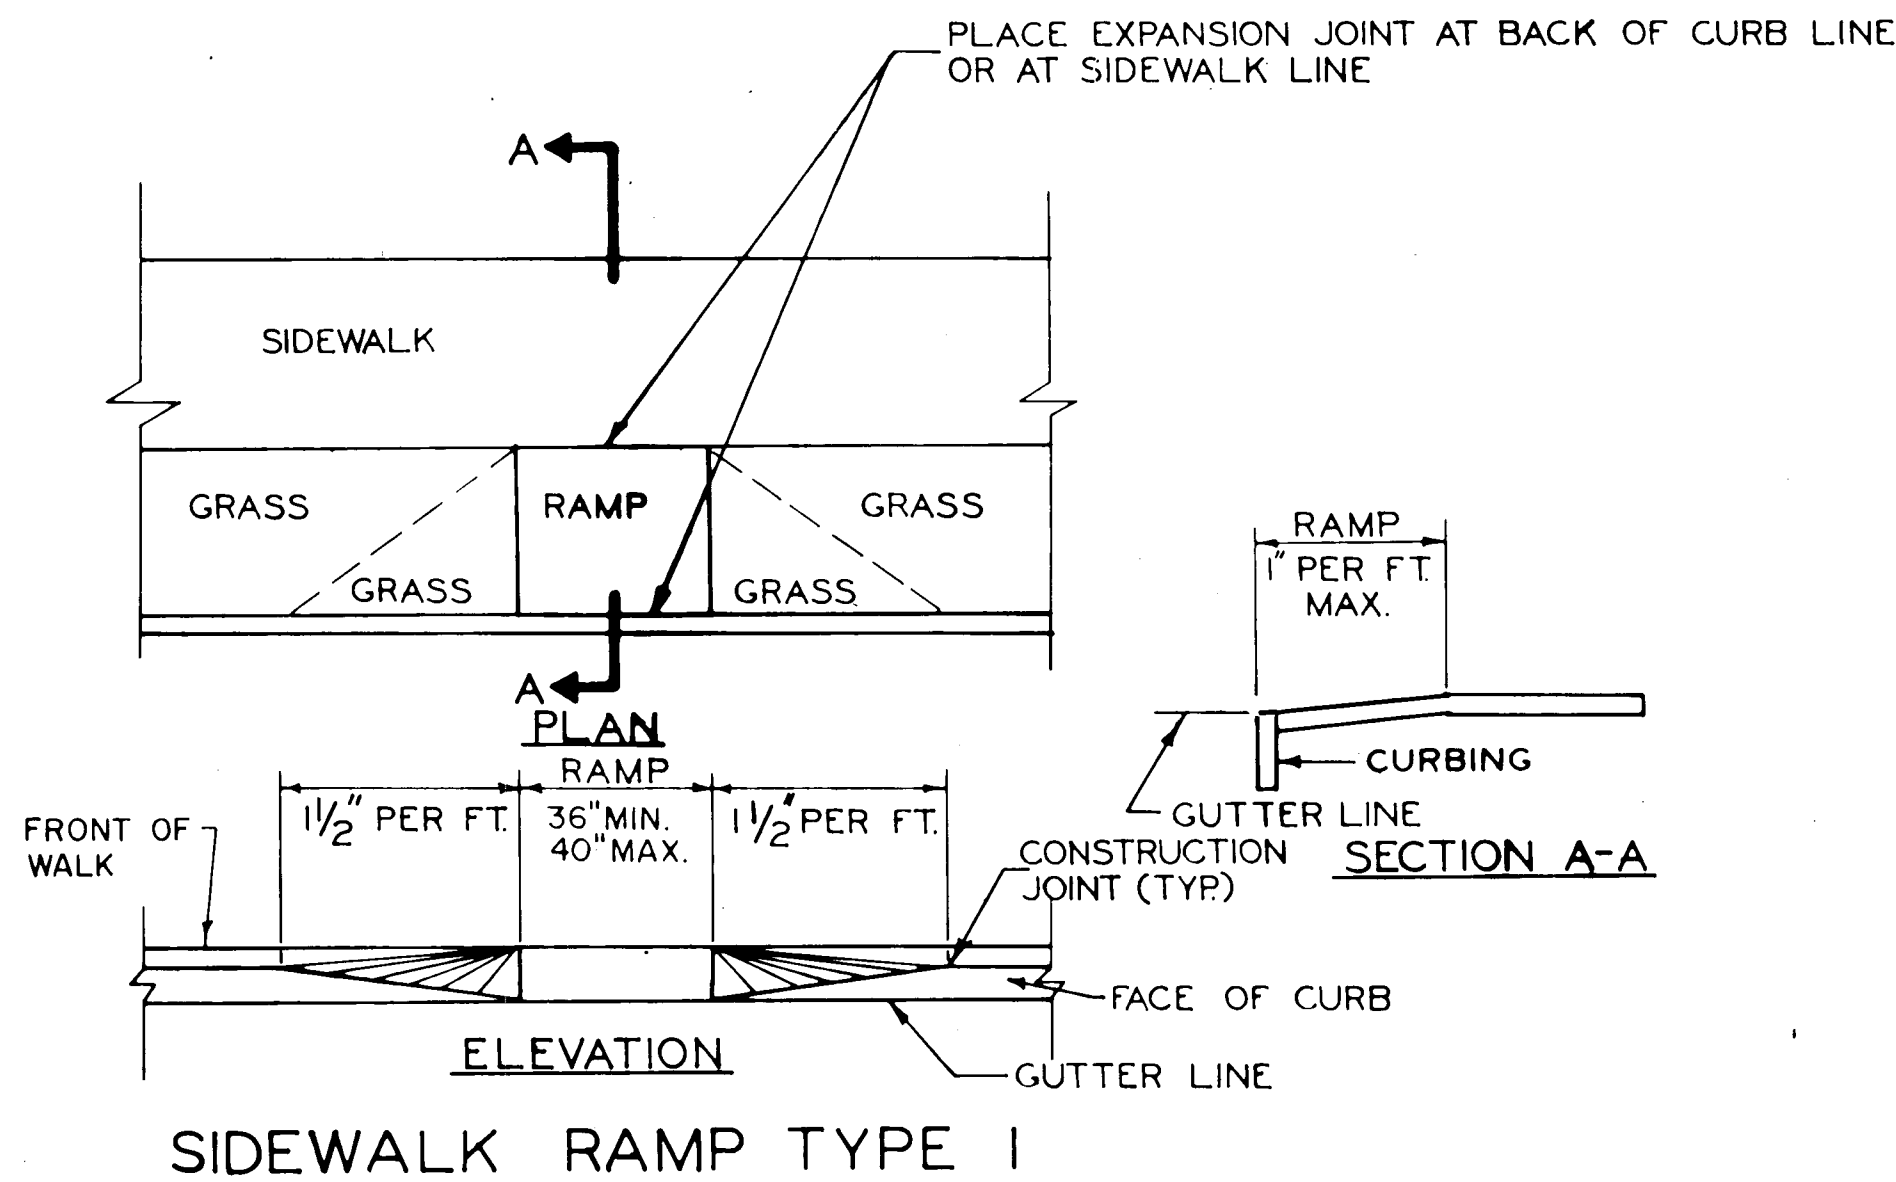


SIDEWALK RAMP TYPE 1

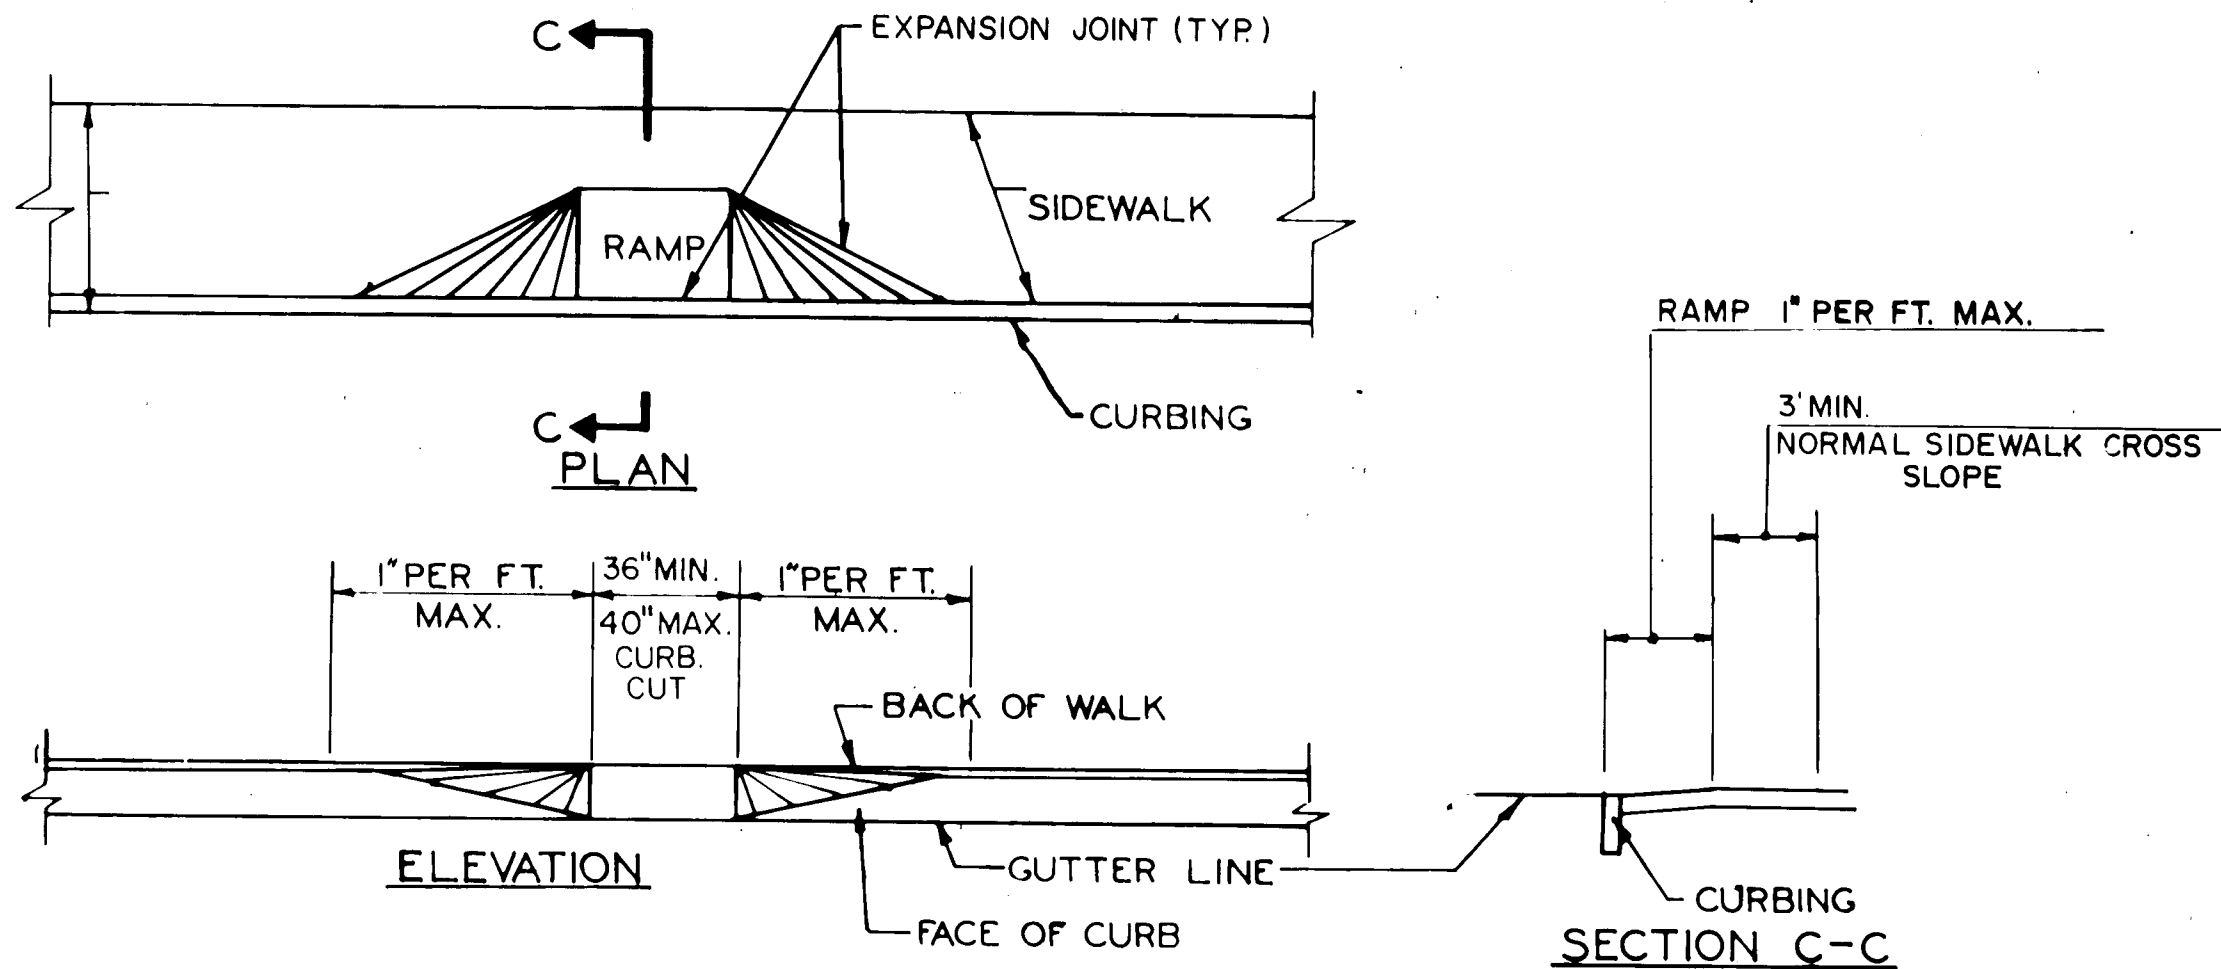


SIDEWALK RAMP TYPE 4

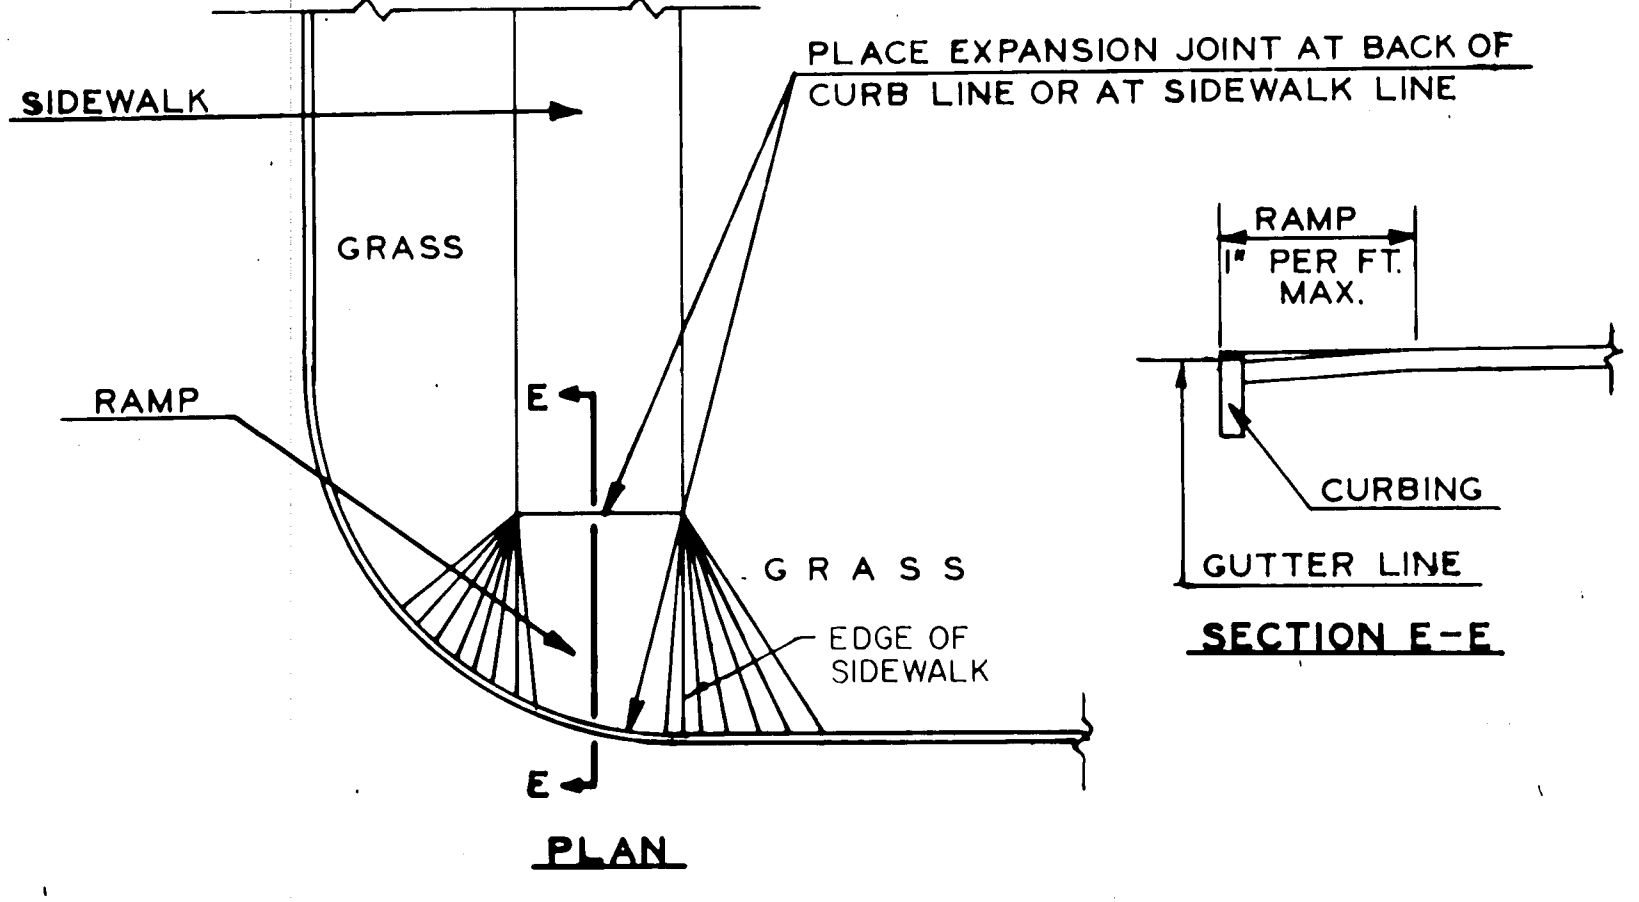


SIDEWALK RAMP TYPE 5

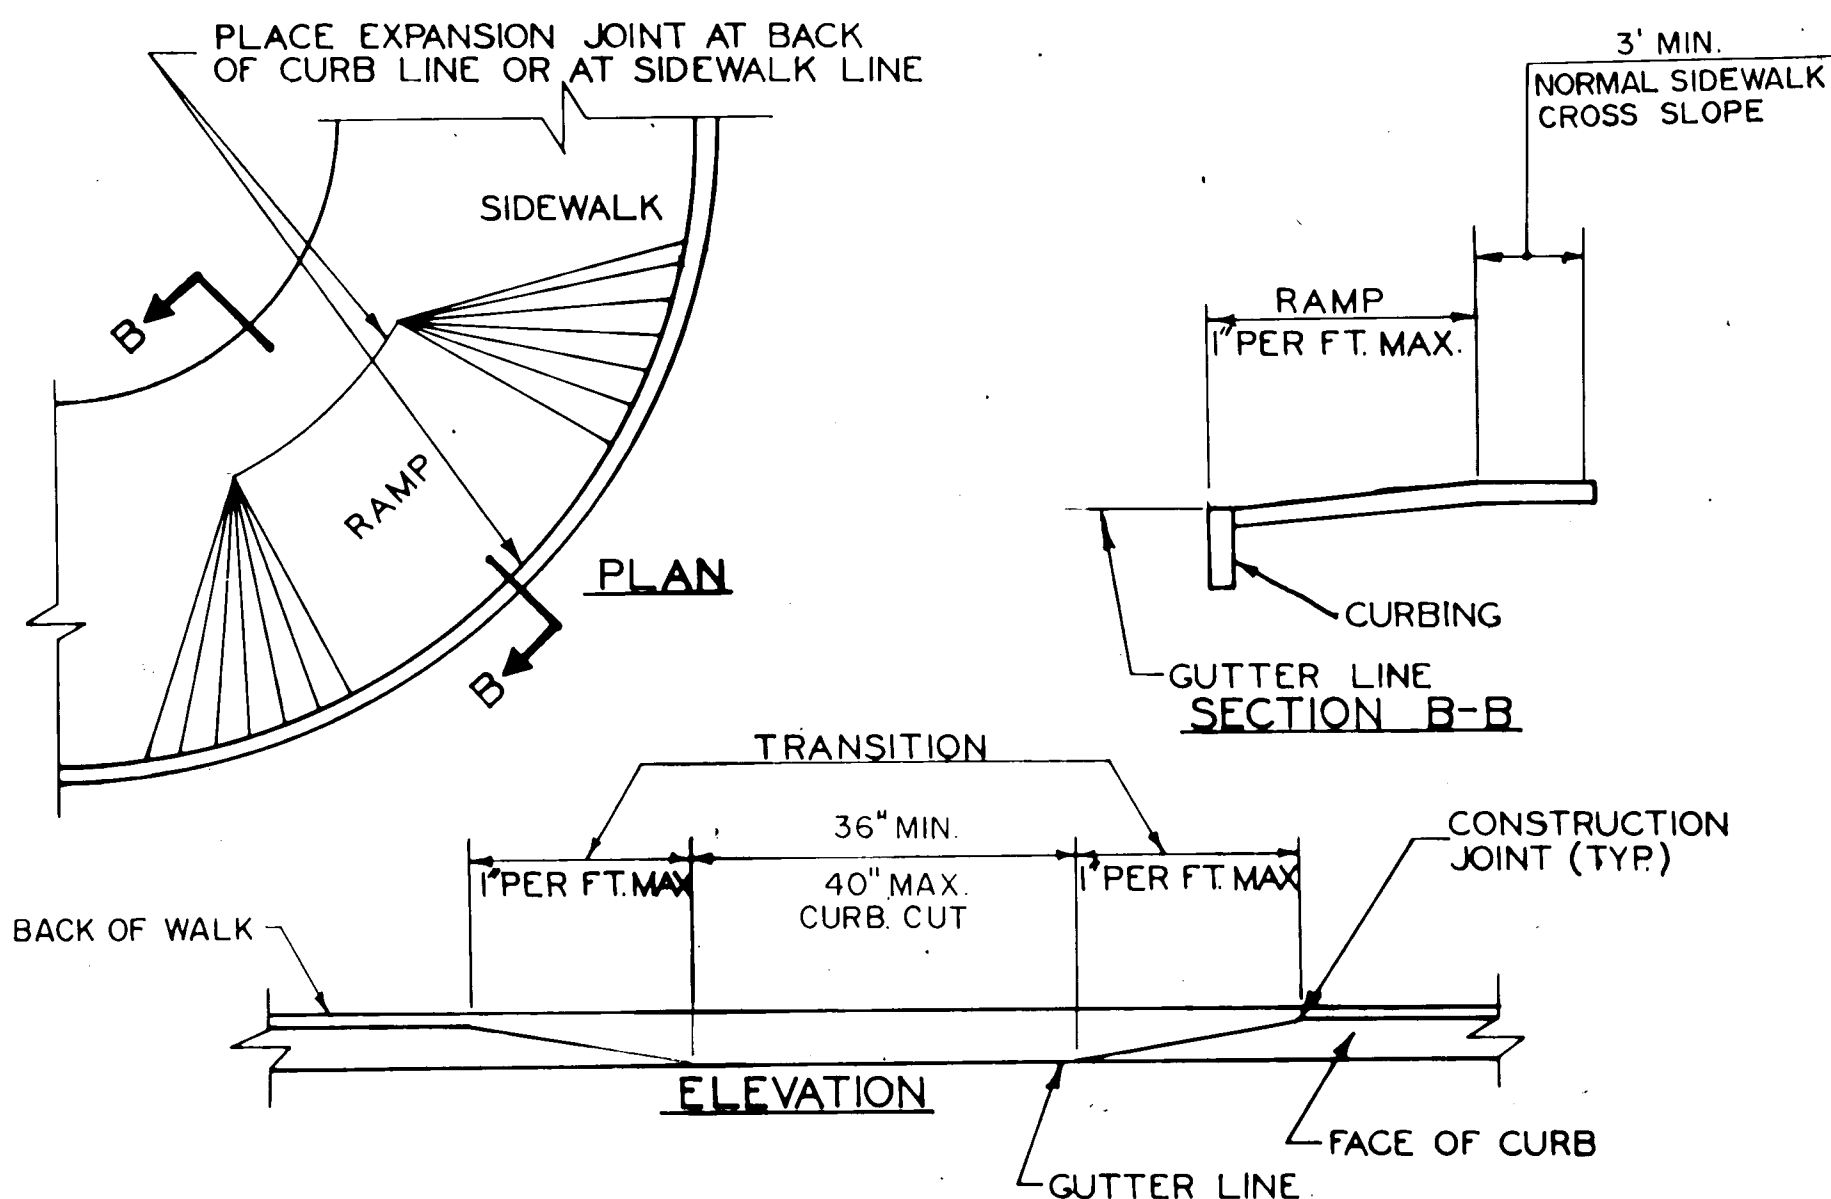

SIDEWALK RAMP TYPE 2

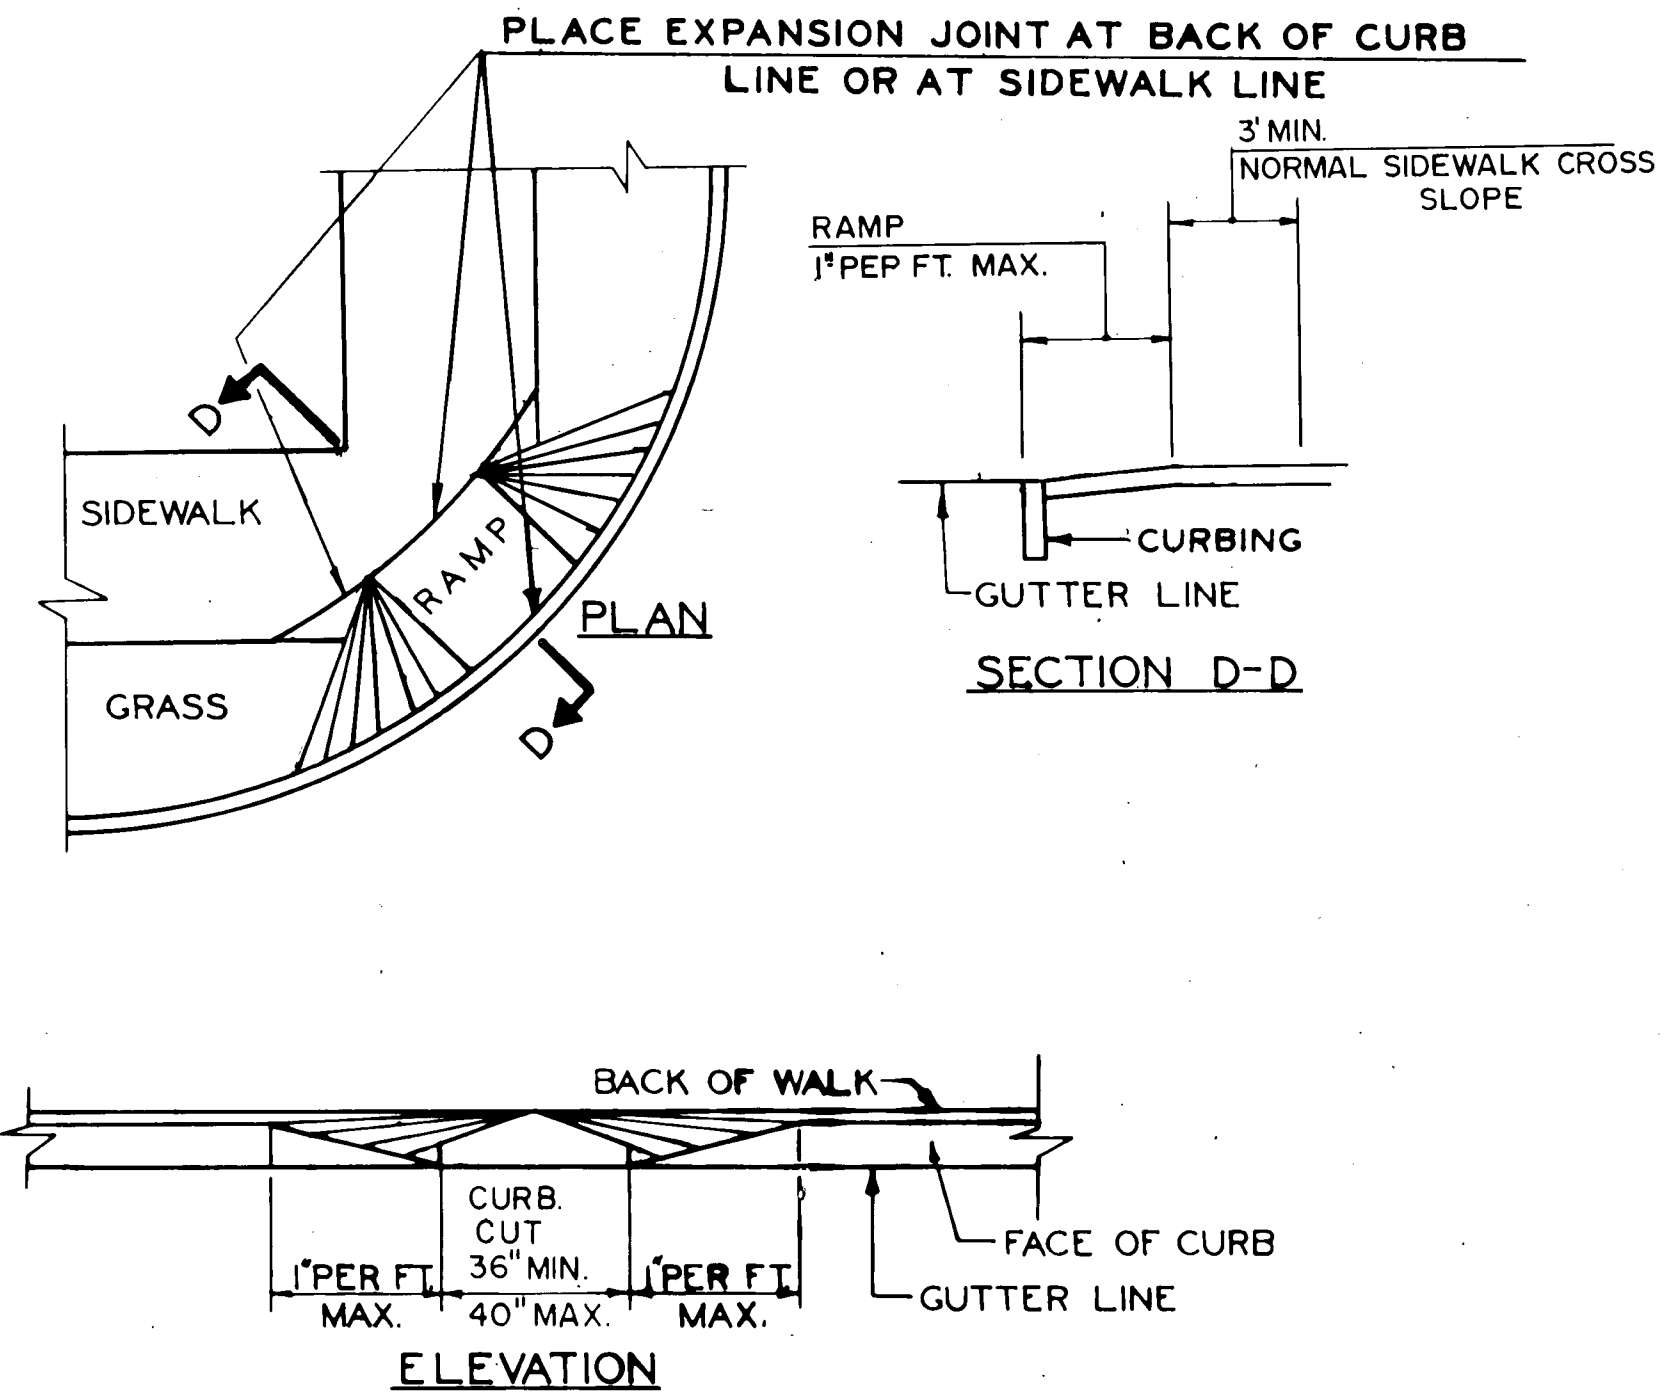

SIDEWALK RAMP TYPE 3

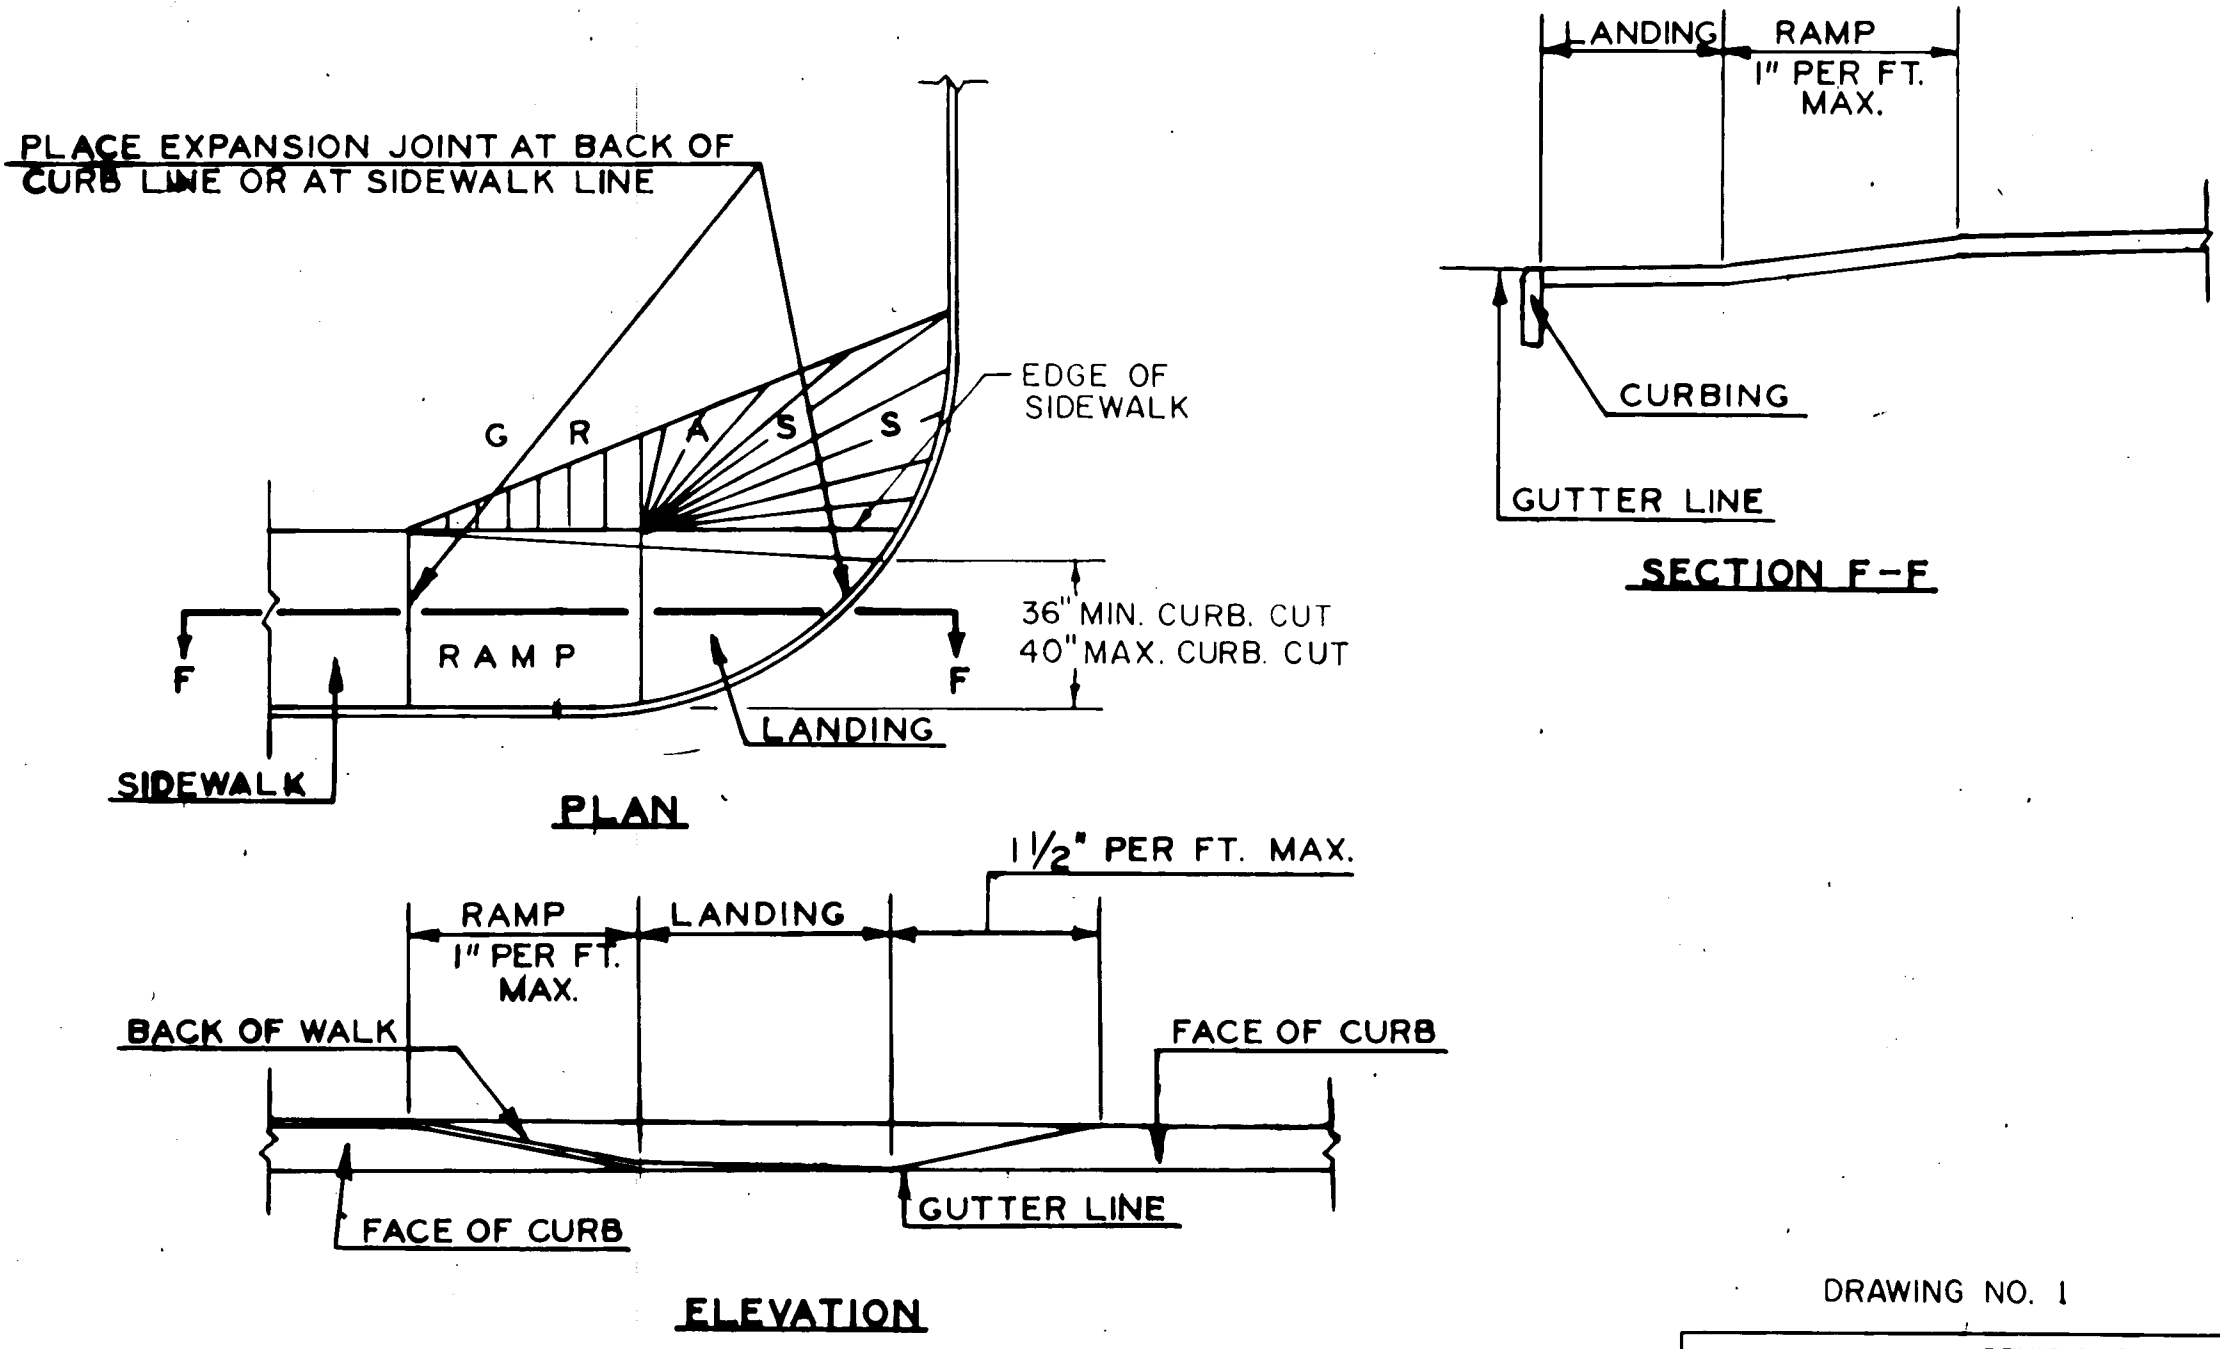

SIDEWALK RAMP TYPE 6

GENERAL NOTES

- 1) SIDEWALK RAMPS SHALL BE CONSTRUCTED AND PAID FOR UNDER BID ITEM 23A. THE FINAL TEXTURE OF THE RAMP SURFACE SHALL BE A COARSE BROOM FINISH TRANSVERSE TO THE SLOPE OF THE RAMP.
- 2) CARE SHALL BE TAKEN TO ASSURE A UNIFORM GRADE ON THE RAMP, FREE OF SAGS AND SHORT GRADE CHANGES.
- 3) THE BOTTOM OF THE RAMP SHALL MEET THE GUTTER LINE AT THE CURB FACE.
- 4) DEPRESS APPROACH SIDEWALK AND CURBING AS REQUIRED TO CONFORM TO RAMP DETAILS.
- 5) ALL SIDEWALK RAMPS SHALL BE CONSTRUCTED OF PORTLAND CEMENT CONCRETE.

DRAWING NO. 1

REVISIONS			
NO.	DATE	DESCRIPTION	REV. SHEET NO.
1	12-76	Remove 5/8" Ramp Lip	
2	5-78	Max. & Min. Width of Curb Cuts	
3	1-79	Minor Changes	