

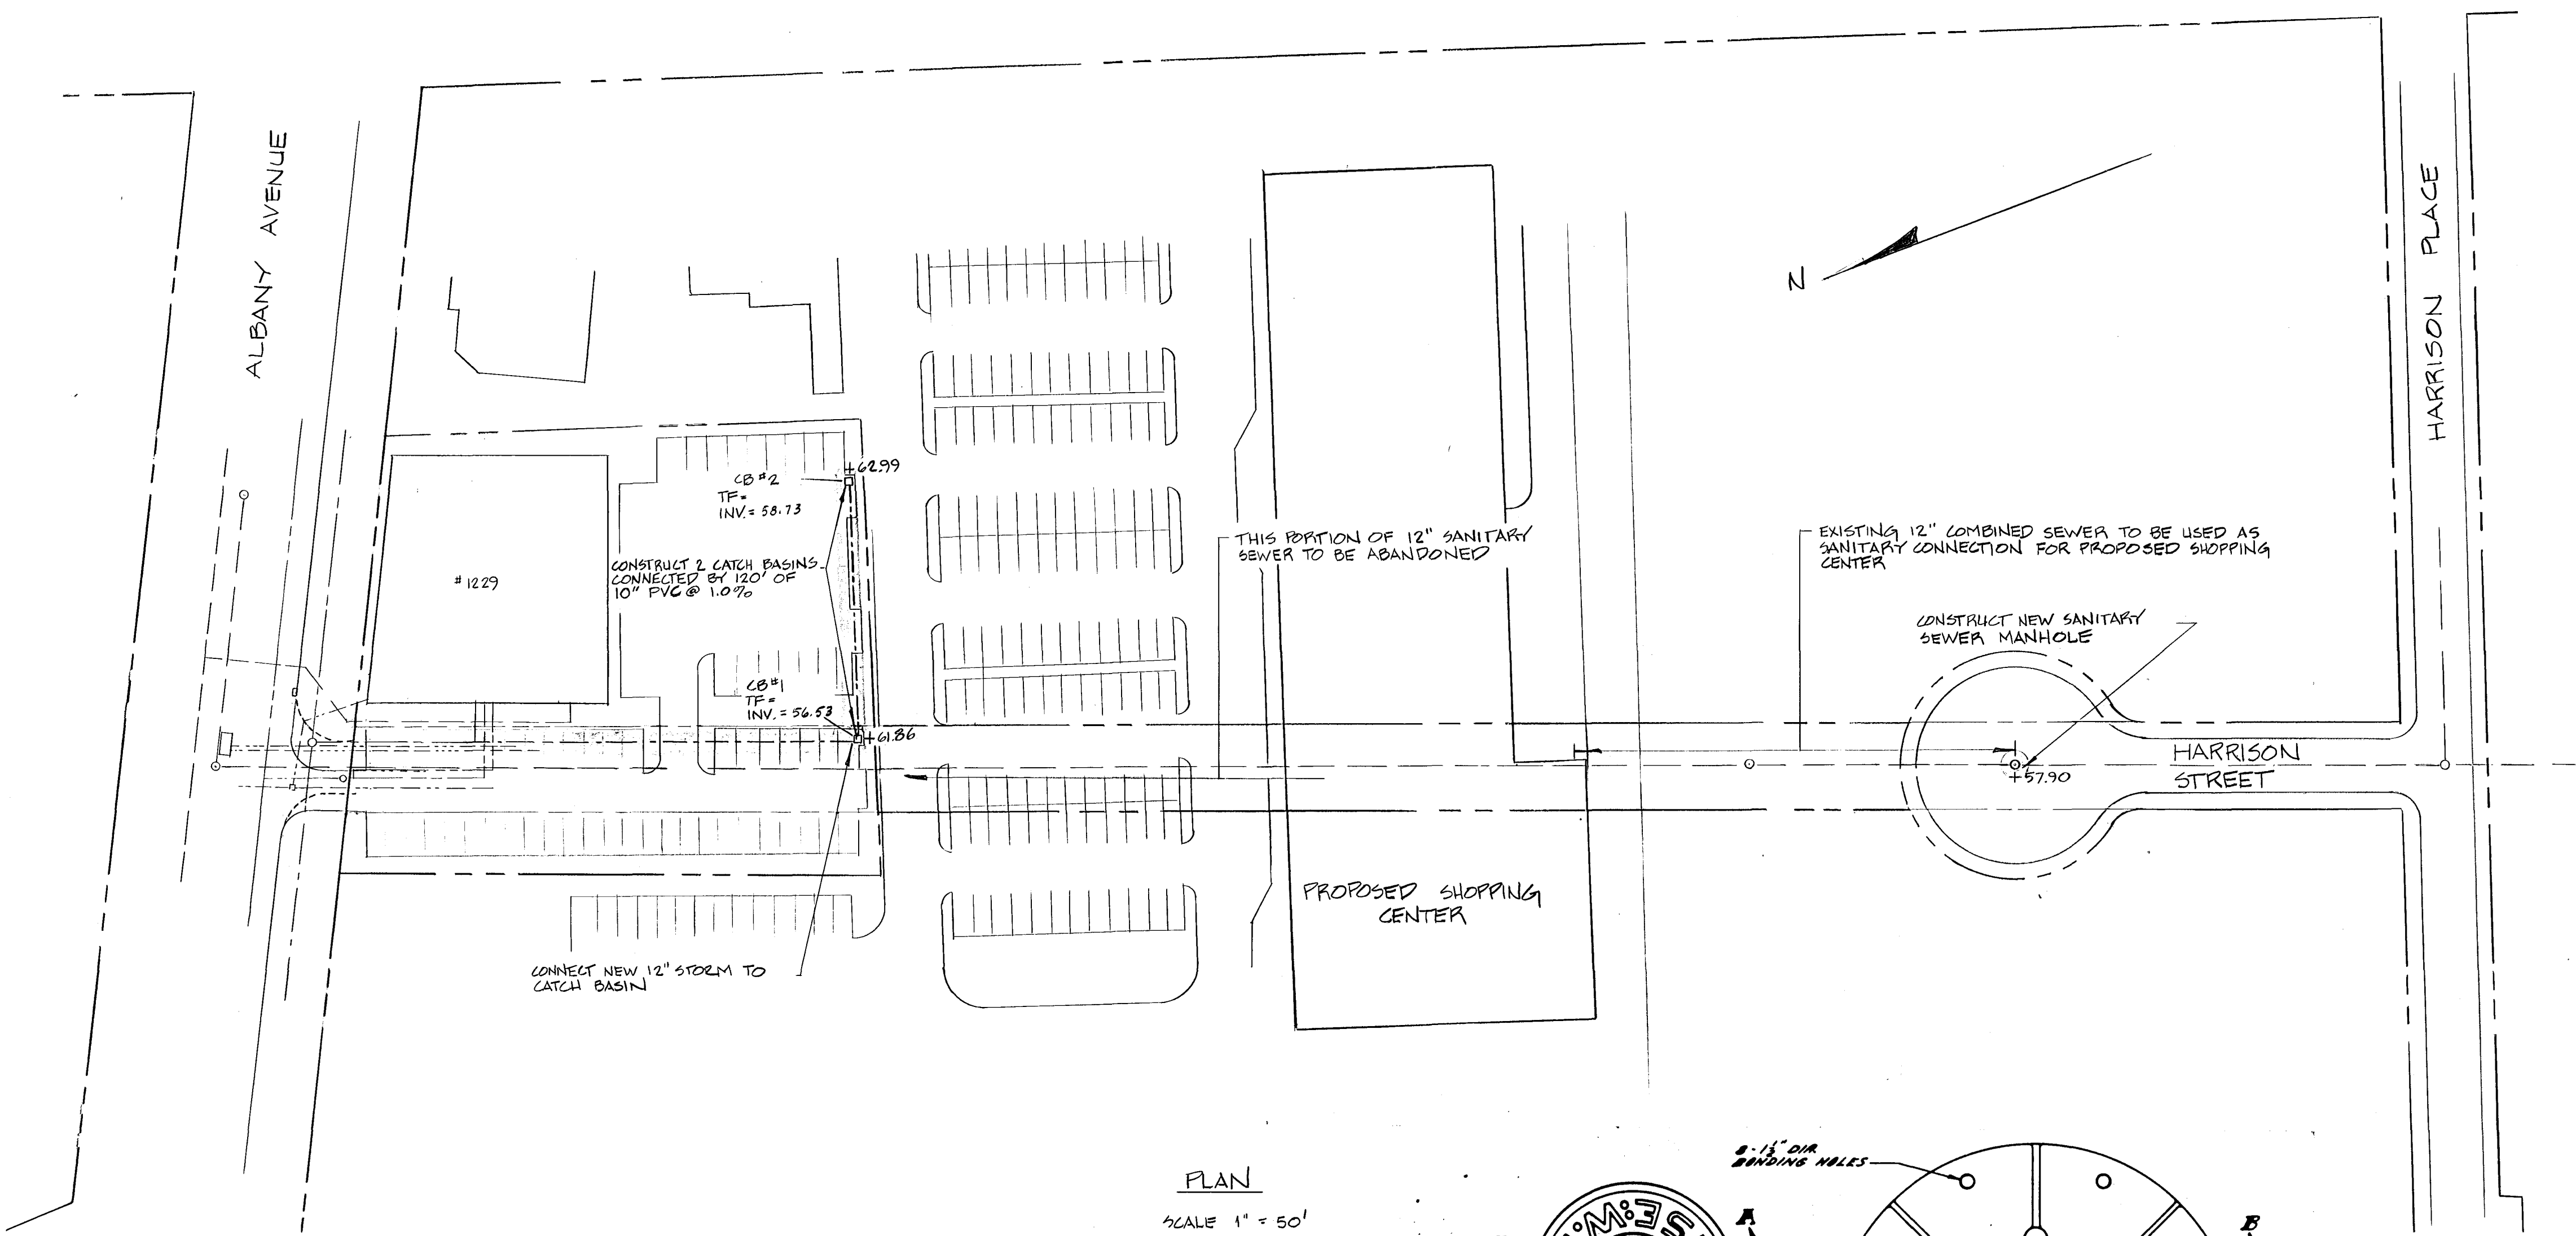
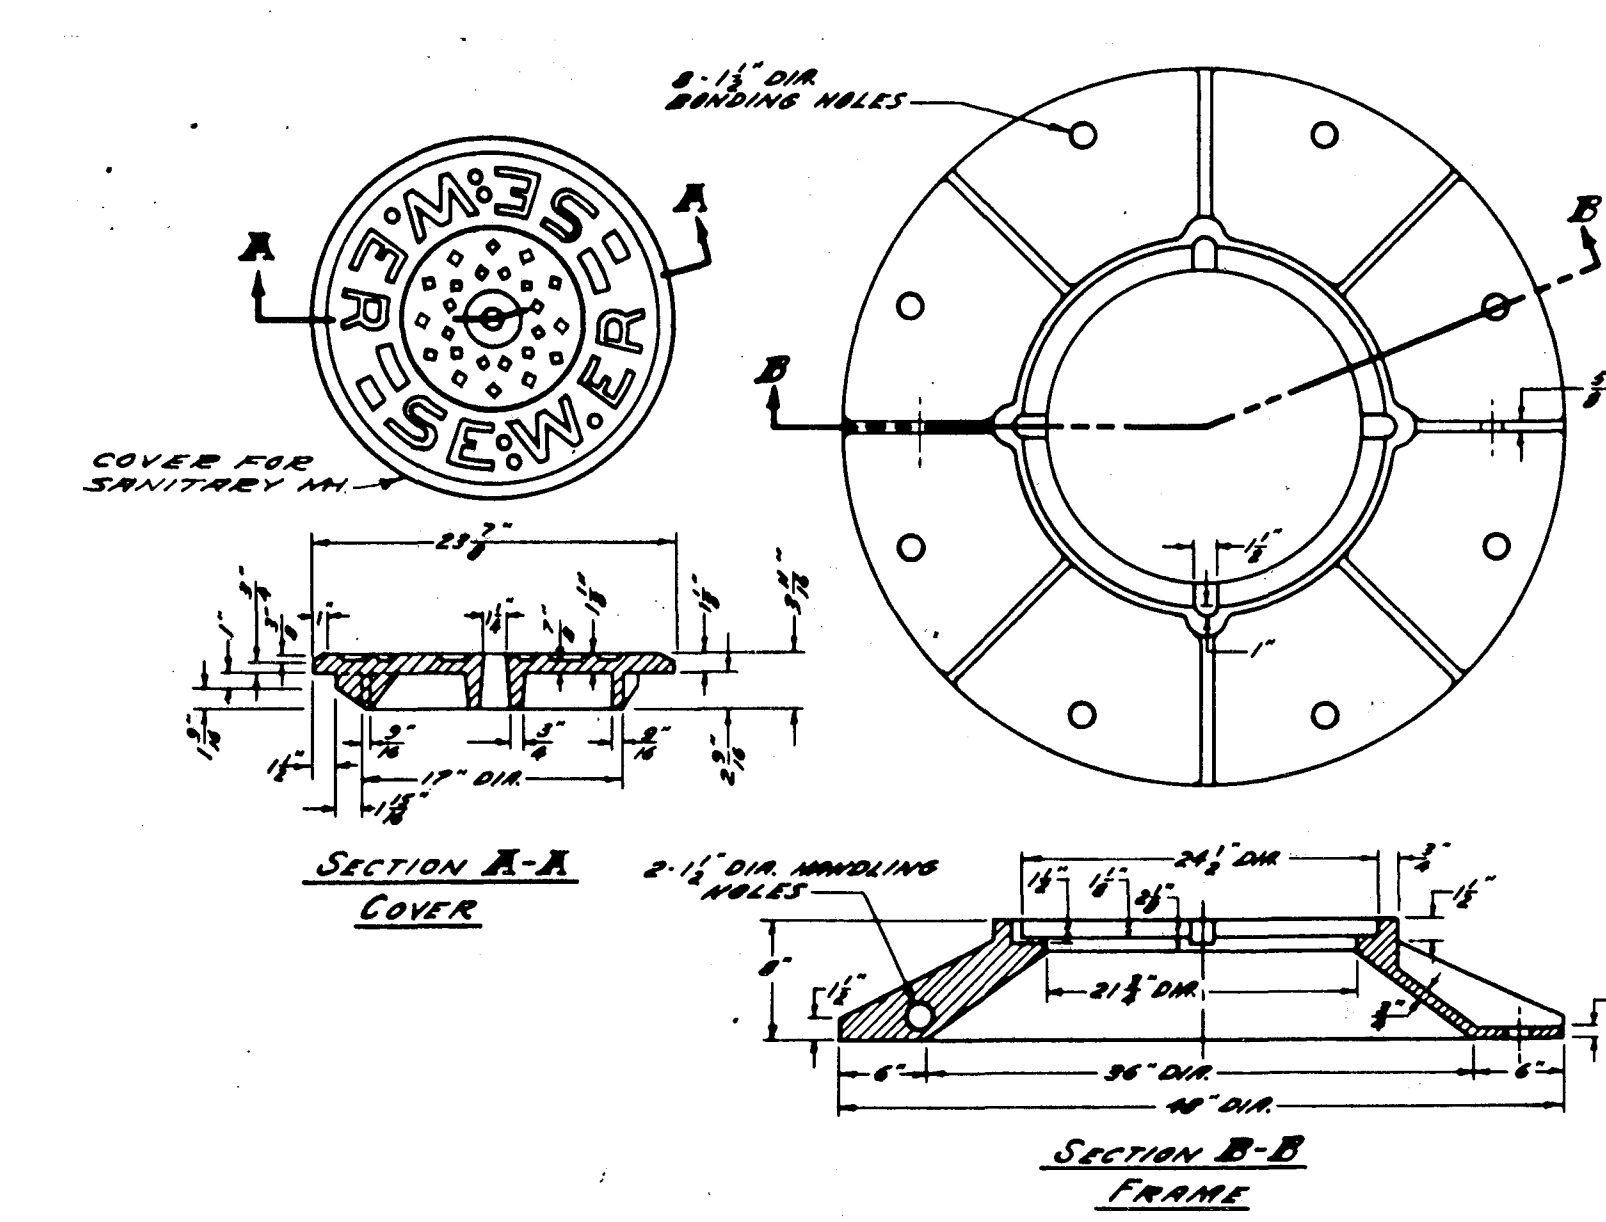



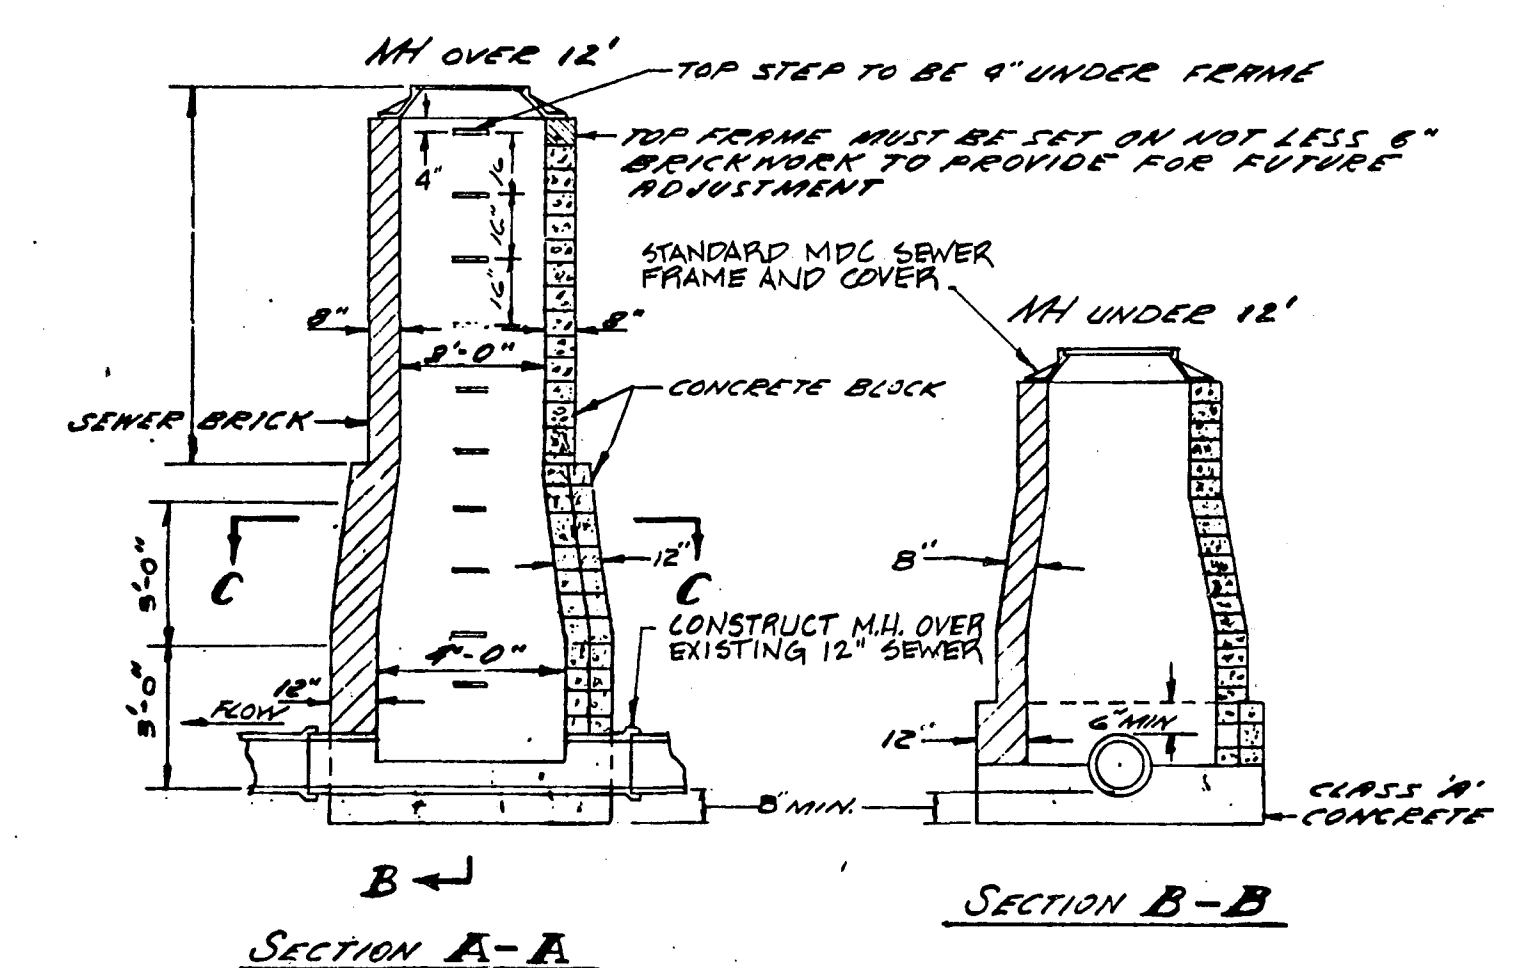


- NOTES:
1. SUMP AND ELBOW TRAP NEED ONLY BE PROVIDED FOR CATCH BASIN #1.
 2. 2" WATER SERVICE SHALL BE TYPE K COPPER PIPE. 4" WATER SERVICE SHALL BE DUCTILE IRON - SCHEDULE 150.
 3. ABANDONED MANHOLES IN ALBANY AVENUE SHALL BE SAND FILLED AND SHALL BE DEMOLISHED TO THE BOTTOM OF THE CONCRETE ROADWAY BASE.
 4. ALL PIPES TO BE ABANDONED SHALL BE SAND FILLED AND BULKHEADED AT PIPE ENDS.

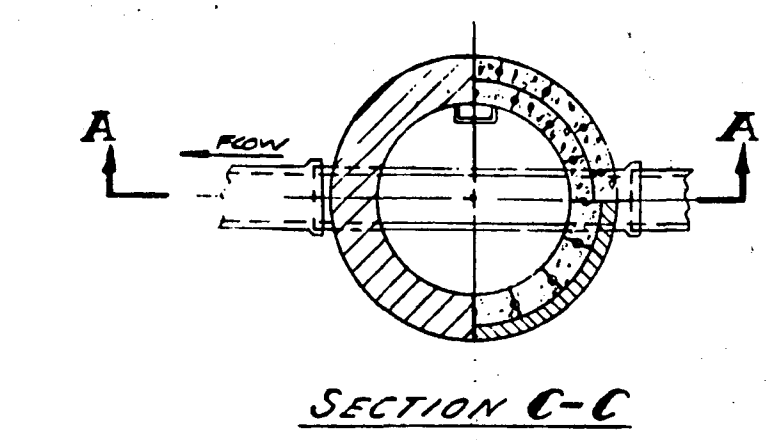

LEGEND

---	P---	PROPERTY LINE
---	SS---	SANITARY SEWER
---	SD---	STORM DRAIN
---	W---	WATER MAIN
---	G---	GAS MAIN
---	E---	ELECTRIC
---	T---	TELEPHONE
W6	W6	WATER GATE
CB	CB	CATCH BASIN
MH	MH	MANHOLE
+	+	NEW CONSTRUCTION
TF	TF	TOP OF FRAME
INV.	INV.	GROUND ELEVATION
		INVERT

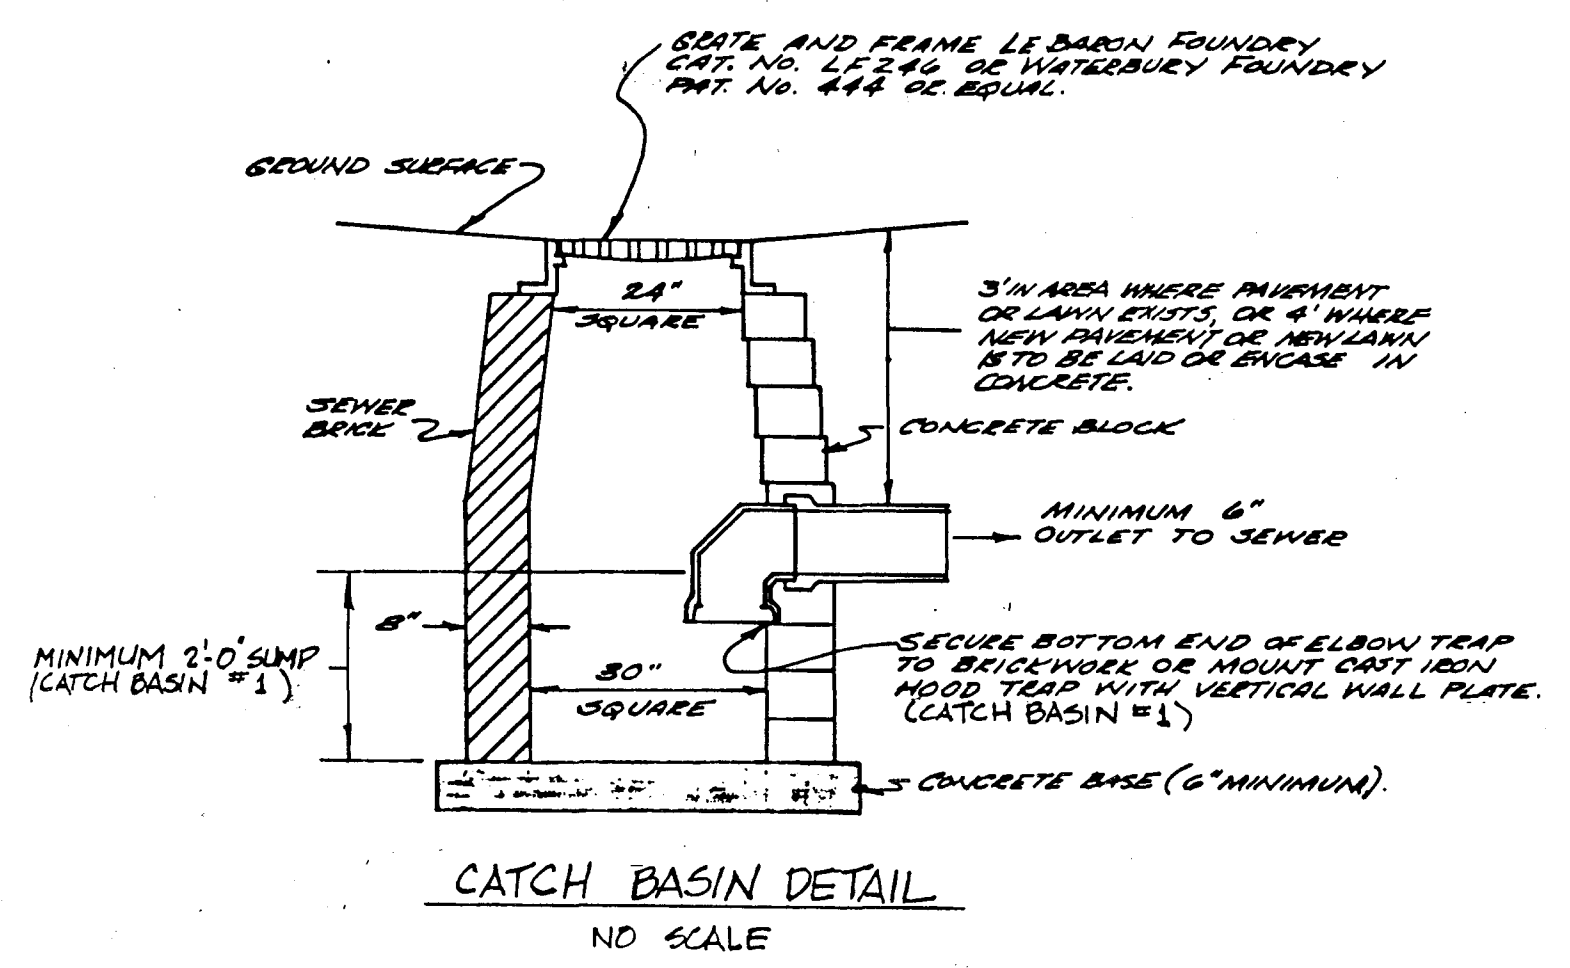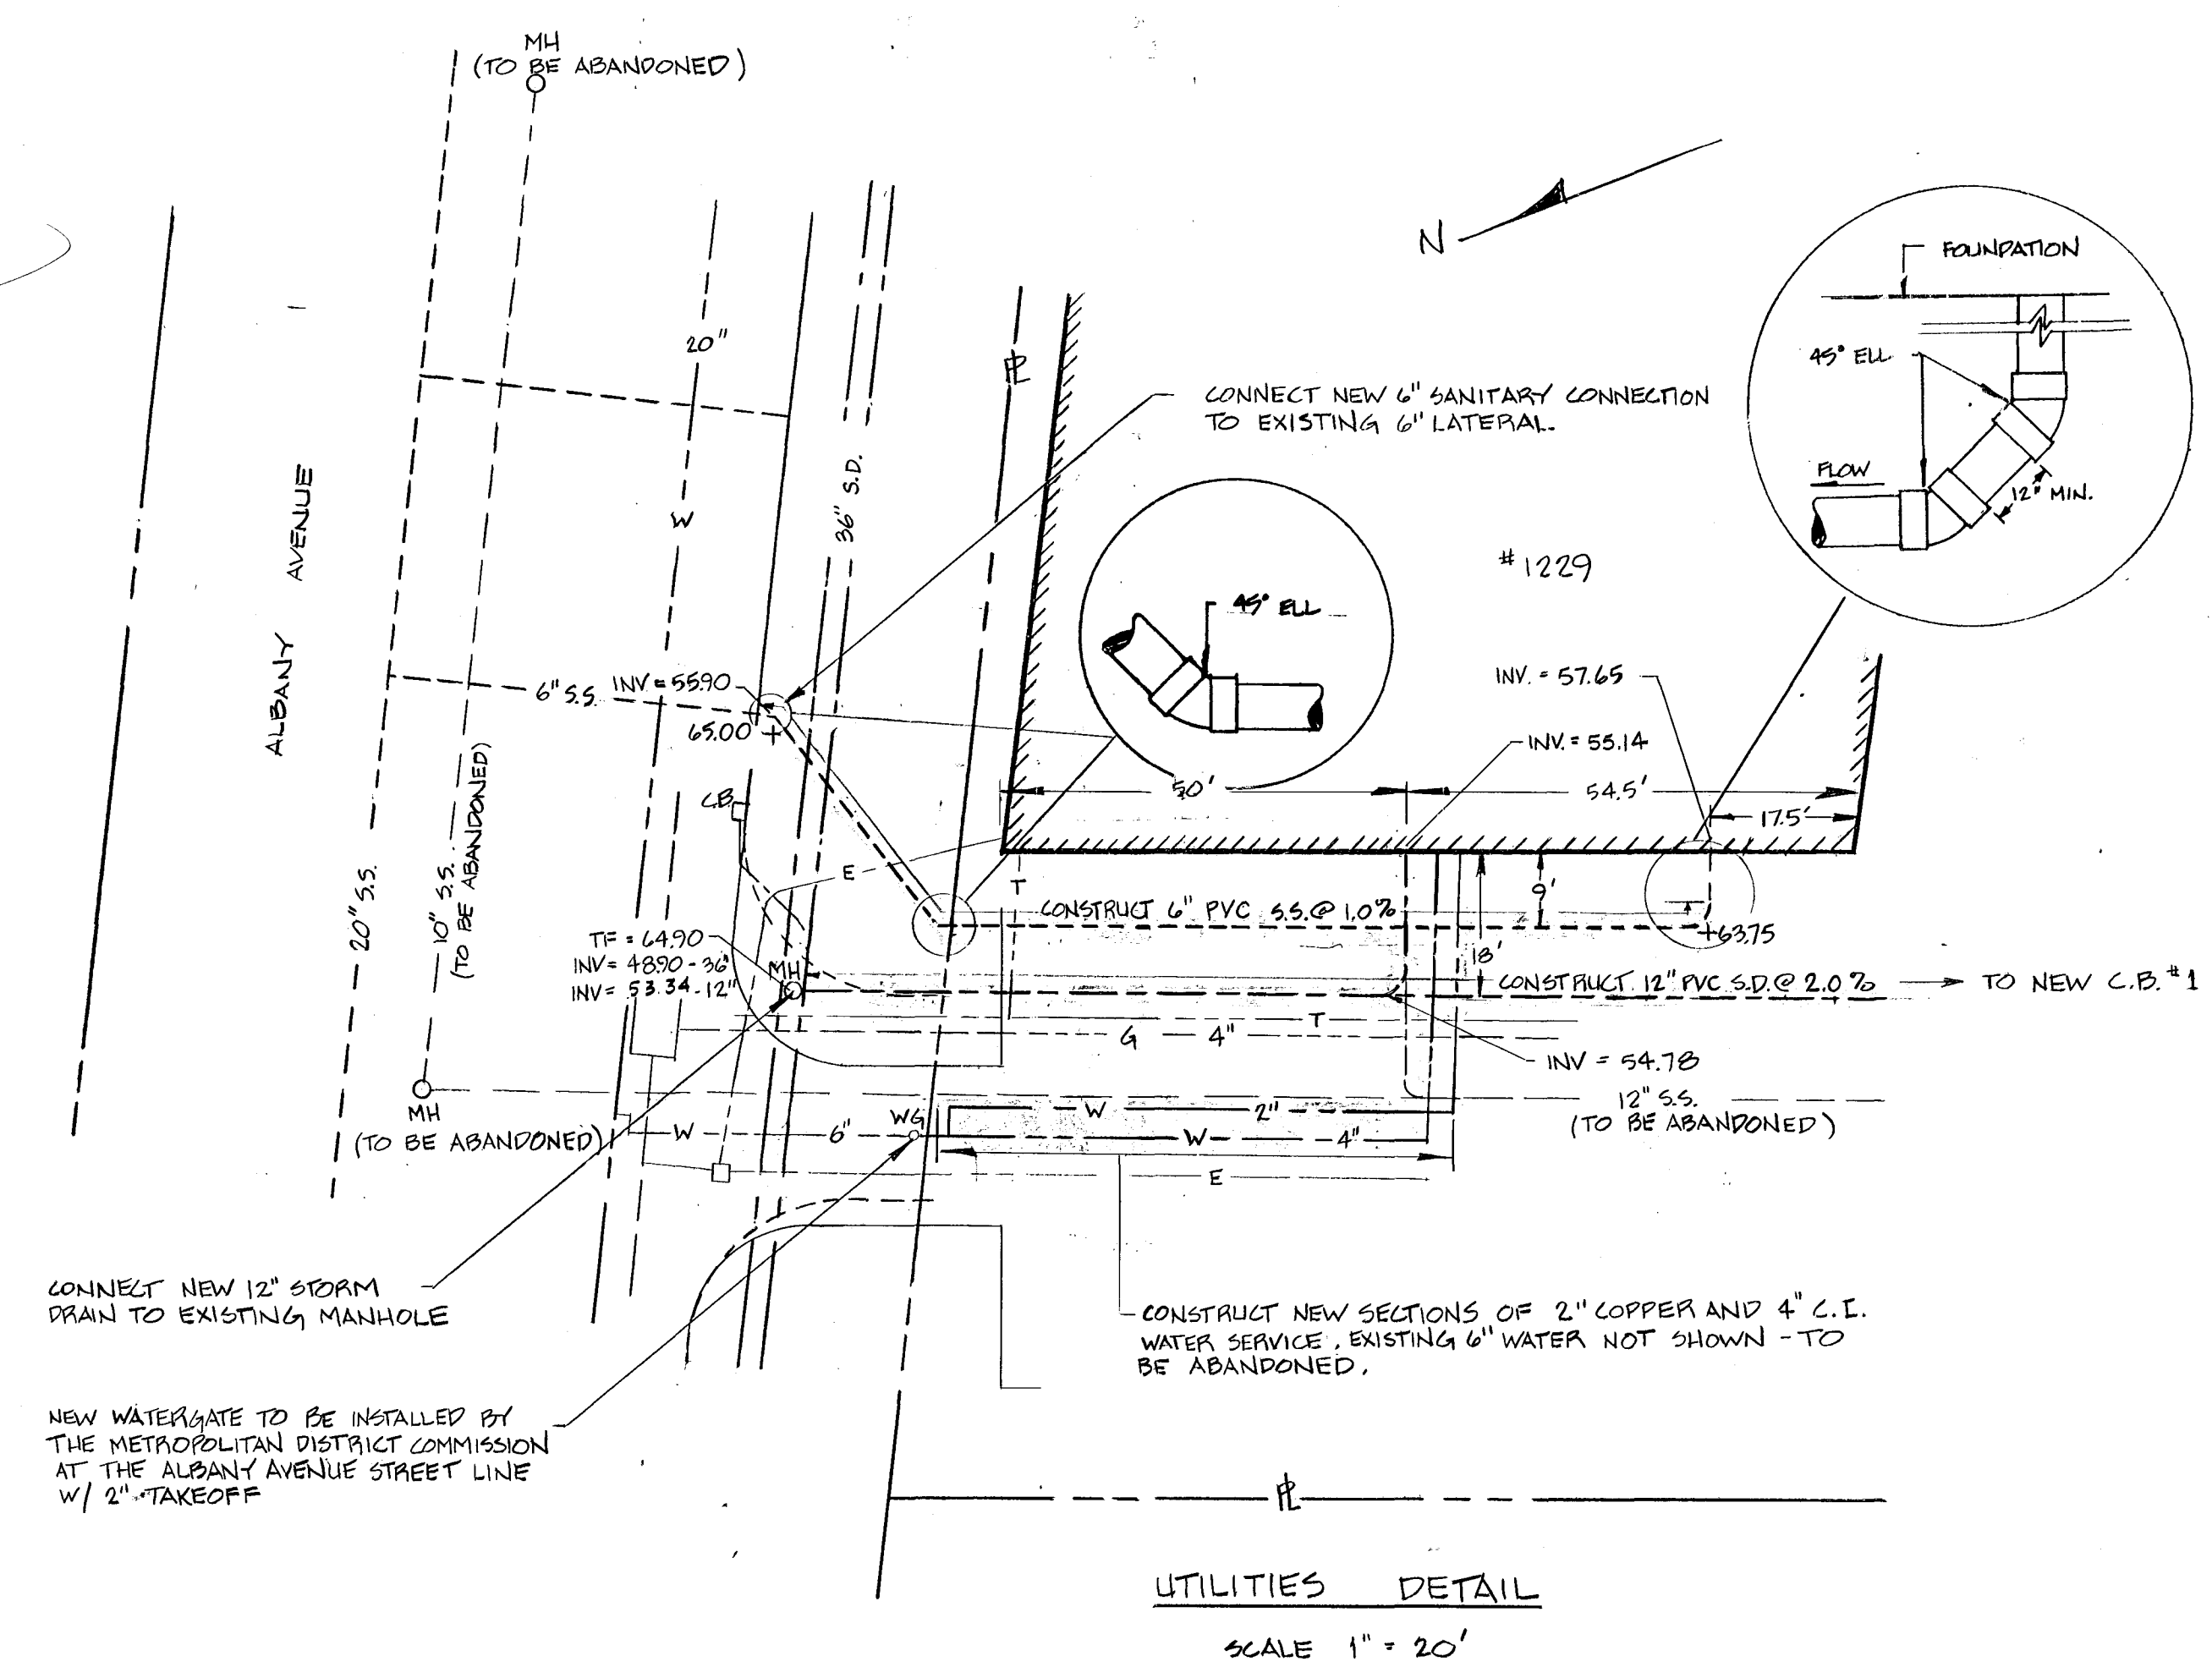

CITY OF HARTFORD, CONNECTICUT
DEPARTMENT OF PUBLIC WORKS
BUREAU OF ENGINEERING SERVICES

**HARRISON STREET
UTILITY IMPROVEMENTS**

SUBMITTED	RECOMMENDED	APPROVED
DIVISION ENGINEER	CHIEF OF ENG. SERV.	ASST. DIR. & CITY ENG.
DRAWN JS	SCALE	DAYBOOK NO. 010913
CHECKED		DATE 5/23/83