





SCALE: $\frac{1''}{4} = 1'-0$

HEADWALL BAR SCHEDULE

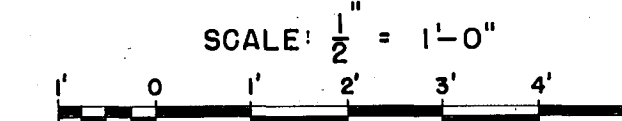

This valve chamber was requested by and constructed for the Hartford Electric Light Co. The minimum cover for main steel reinforcement shall be 3" except where concrete is poured against earth in which case it shall be 4". All elevations refer to Mean Sea Level datum.

CONNECTICUT RIVER FLOOD CONTROL
HARTFORD DIKE
 RIVERFRONT, MORGAN ST. TO STA. 97+05
 CONCRETE & STEEL DETAIL OF VALVE CHAMBER
 STATION 89+03.65

CONNECTICUT RIVER CONNECTICUT
 IN SHEETS SCALE: 1/4 IN. = 1 FT. SHEET NO. 68B

U. S. ENGINEER OFFICE, PROVIDENCE, R. I., SEPT. 1941

PREPARED BY AREA OFFICE
 HARTFORD, CONN.

FILE NO. CT-4-3920