



1000 GALLON HEATING
OIL TANK






2" FILL & GAGE PIPES

3000 GALLON GASOLINE TANK

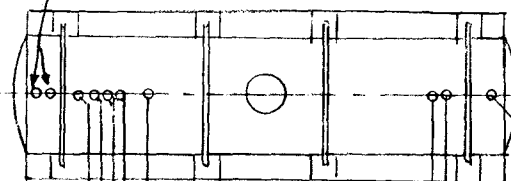

2" FILL & GAGE PIPES

1000 GALLON DIESEL
FUEL TANK

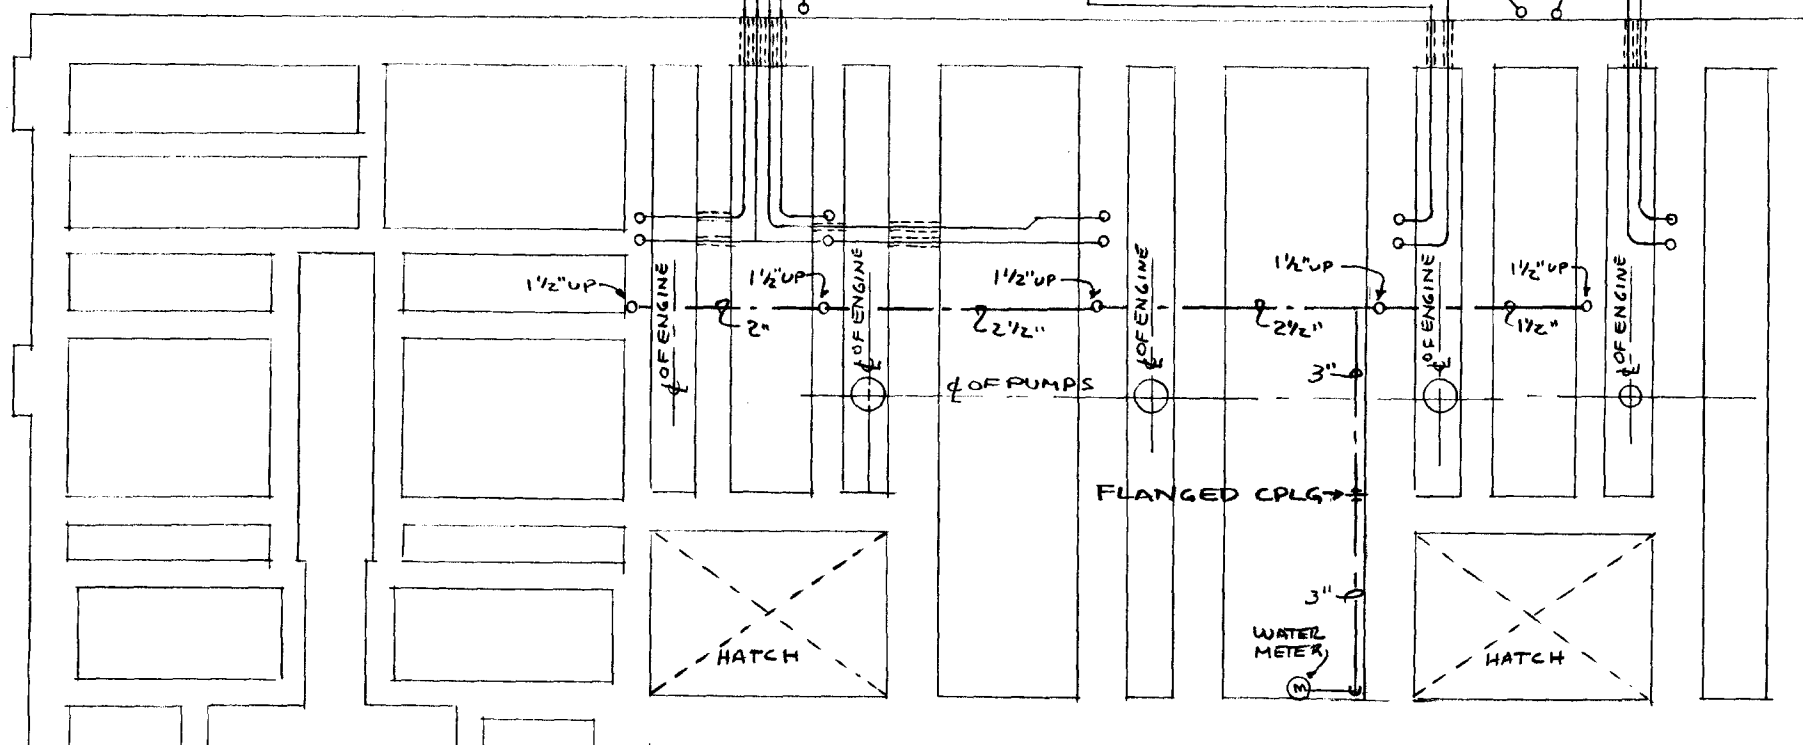

PLAN-UPPER PART OF PUMP ROOM
SCALE 1/8" = 1'-0"

CITY OF HARTFORD, CONNECTICUT
DEPARTMENT OF PUBLIC WORKS
BUREAU OF PUBLIC BUILDINGS

ENGINE REPLACEMENT
KENEY LANE PUMP STATION
KENEY LANE
HARTFORD, CONN.

M
2

VERIFY EXISTING
CONDITIONS AND
DIMENSIONS AT
BUILDING

SUBMITTED <i>P.D. Fenstermaker</i>	RECOMMENDED <i>Walter H. Reed</i>	APPROVED <i>George E. Heppner</i>
DRAWN P.D.P.	SCALE 1/8" = 1'-0"	DAYBOOK NO. 010430-B
CHECKED P.D.P.		DATE APRIL 15, 1974