


NOTES & SPECIFICATIONS.

1. NEW DIESEL OIL FUEL OIL TANK TO BE OWENS-CORNING FIBERGLASS NO C-2 4000 GALLON. PROVIDE STD 4" FIBERGLASS FILL TUBE, STD FIBERGLASS 22"Ø FLANGED MANWAY ON CENTER OF TANK. & FITTINGS FOR PIPING AS SHOWN ON PLANS. & STD ANCHOR STRAPS.
2. PROVIDE 10'-6" W X 22' L X 18" DEEP CONCRETE PAD BELOW TANK. WITH #5 BARS 12" OC EACH WAY IN SLAB 3" ABOVE BOTTOM & NECH ANCHOR BOLTS WITH PLATES IN SLAB.
3. INSTALL AS PER MANUFACTURERS INSTRUCTIONS. PROVIDE PEA GRAVEL & BACK FILL & SETTING BED.
4. ON EACH SUCTION LINE INSTALL NEW FOOT VALVE 3" ABOVE BOT. OF TANK.
5. PROVIDE NEW 4000 GALLON FUEL OIL TANK GAUGE CONTINUOUS READING - NON PUMPING TYPE EQUAL TO LIQUID OMETER.
6. PIPING, FITTING ETC AS PER BASIC SPEC.
7. ABANDONED TANK - CAP PIPE OPENINGS - BELOW GRADE - FILL COMPLETELY WITH SAND AFTER PUMPING OUT CONTENTS.
8. AREA OF EXCAVATIONS TO BE LEVELLED OUT TO EXISTING GRADES & BE RESEED.

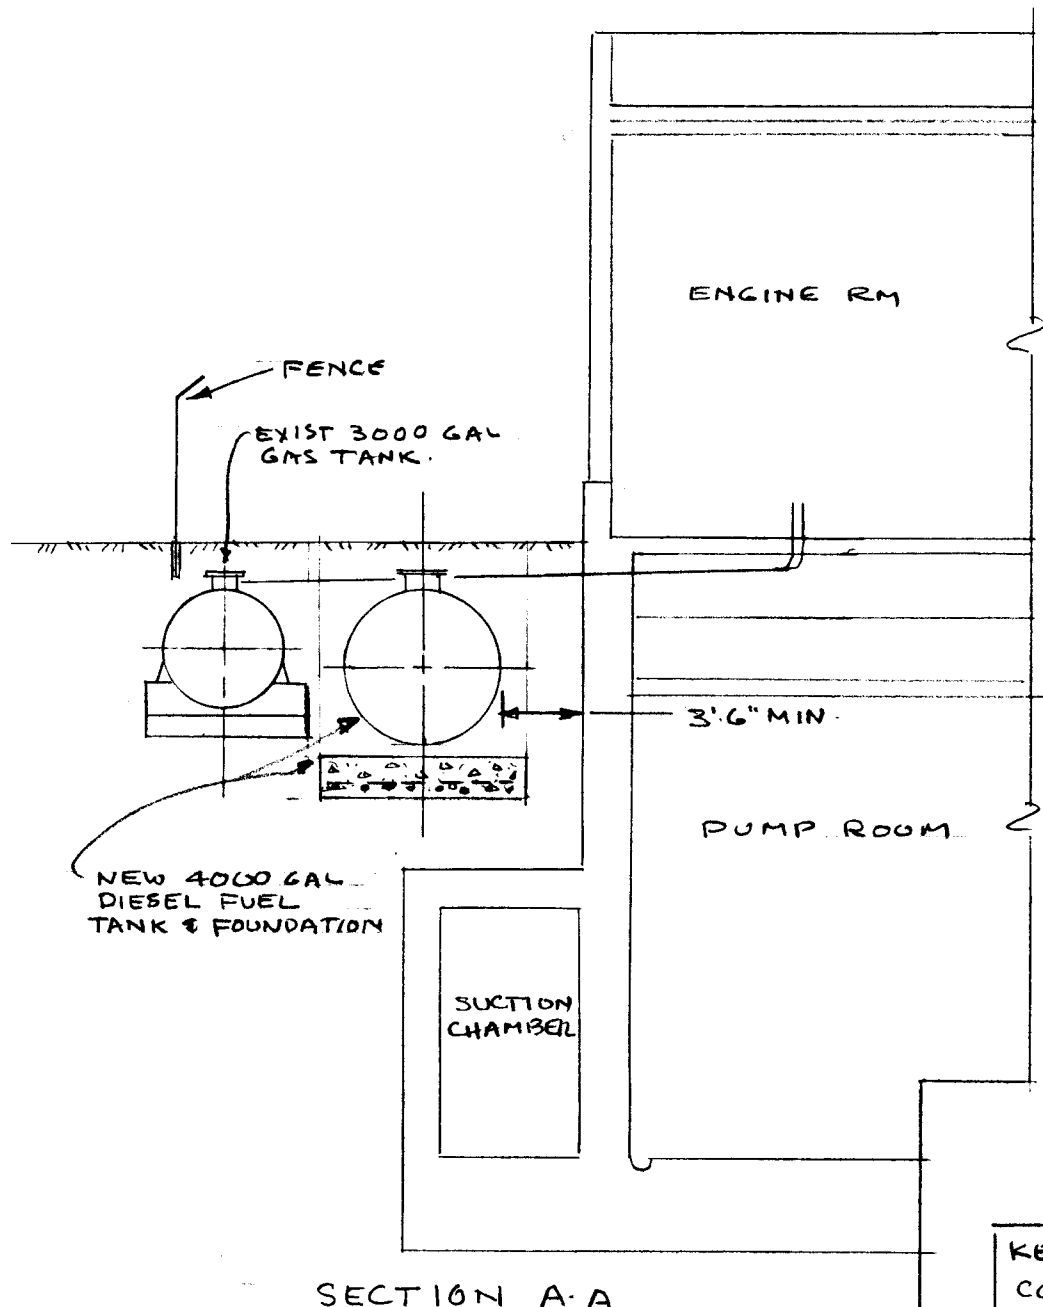

SECTION A-A

SCALE 1/8" = 1'-0"

DAYBOOK NO. 010430-G

SK-2

KEENEY LANE PUMP STA
CONTRACT E74-11
BY PDP DATE 6-18-74

CITY OF HARTFORD, CONN.
DEPARTMENT OF PUBLIC WORKS
BUREAU OF PUBLIC BUILDINGS