


MATERIAL SPECIFICATIONS

REINFORCED CONCRETE
 COMPRESSIVE STRENGTH: 3,000 PSI, MAX. 28 DAYS
 REINFORCEMENT: DEFORMED BARS (ASTM A305) GRADE 50
 1/2" MINIMUM CONC. COVER
 CURING: PROTECT WITH W.P. PAPER, SEALED LAPS, (5) DAY PERIOD
 VAPOR BARRIER: 4 MIL POLYETHYLENE

RAILINGS
 STEEL PIPE: (ASTM A35), 1 1/2" Ø STANDARD WT., SCHEDULE 40
 CONNECTIONS: WELDED, TYPE ETC WELD RODS, SMOOTH GROUND.
 BASE: SET 6" DEEP INTO PREFORMED ROUND HOLES.
 GROUT WITH "S-STAR" (OR EQUAL) NON-SHRINK GROUT WITH
 SLIGHT SLOPE ON TOP SURFACE, TO DRAIN WATER.


PAINTING
 THOROUGHLY CLEAN METAL SURFACES
 PRIME PAINT: (1) COAT ZINC CHROMATE
 FINISH PAINT: (2) COATS "RUSTOLEUM" OR EQUAL.
 COLOR: TO BE SELECTED BY ARCHITECT.

CONCRETE FINISH
 TRAFFIC SURFACES TO RECEIVE BROOM FINISH
 IN DIRECTION OF REBARS (SEE FOUNDATION PLAN).
 EXPOSED, VERTICAL SURFACES TO RECEIVE RUBBED FINISH.

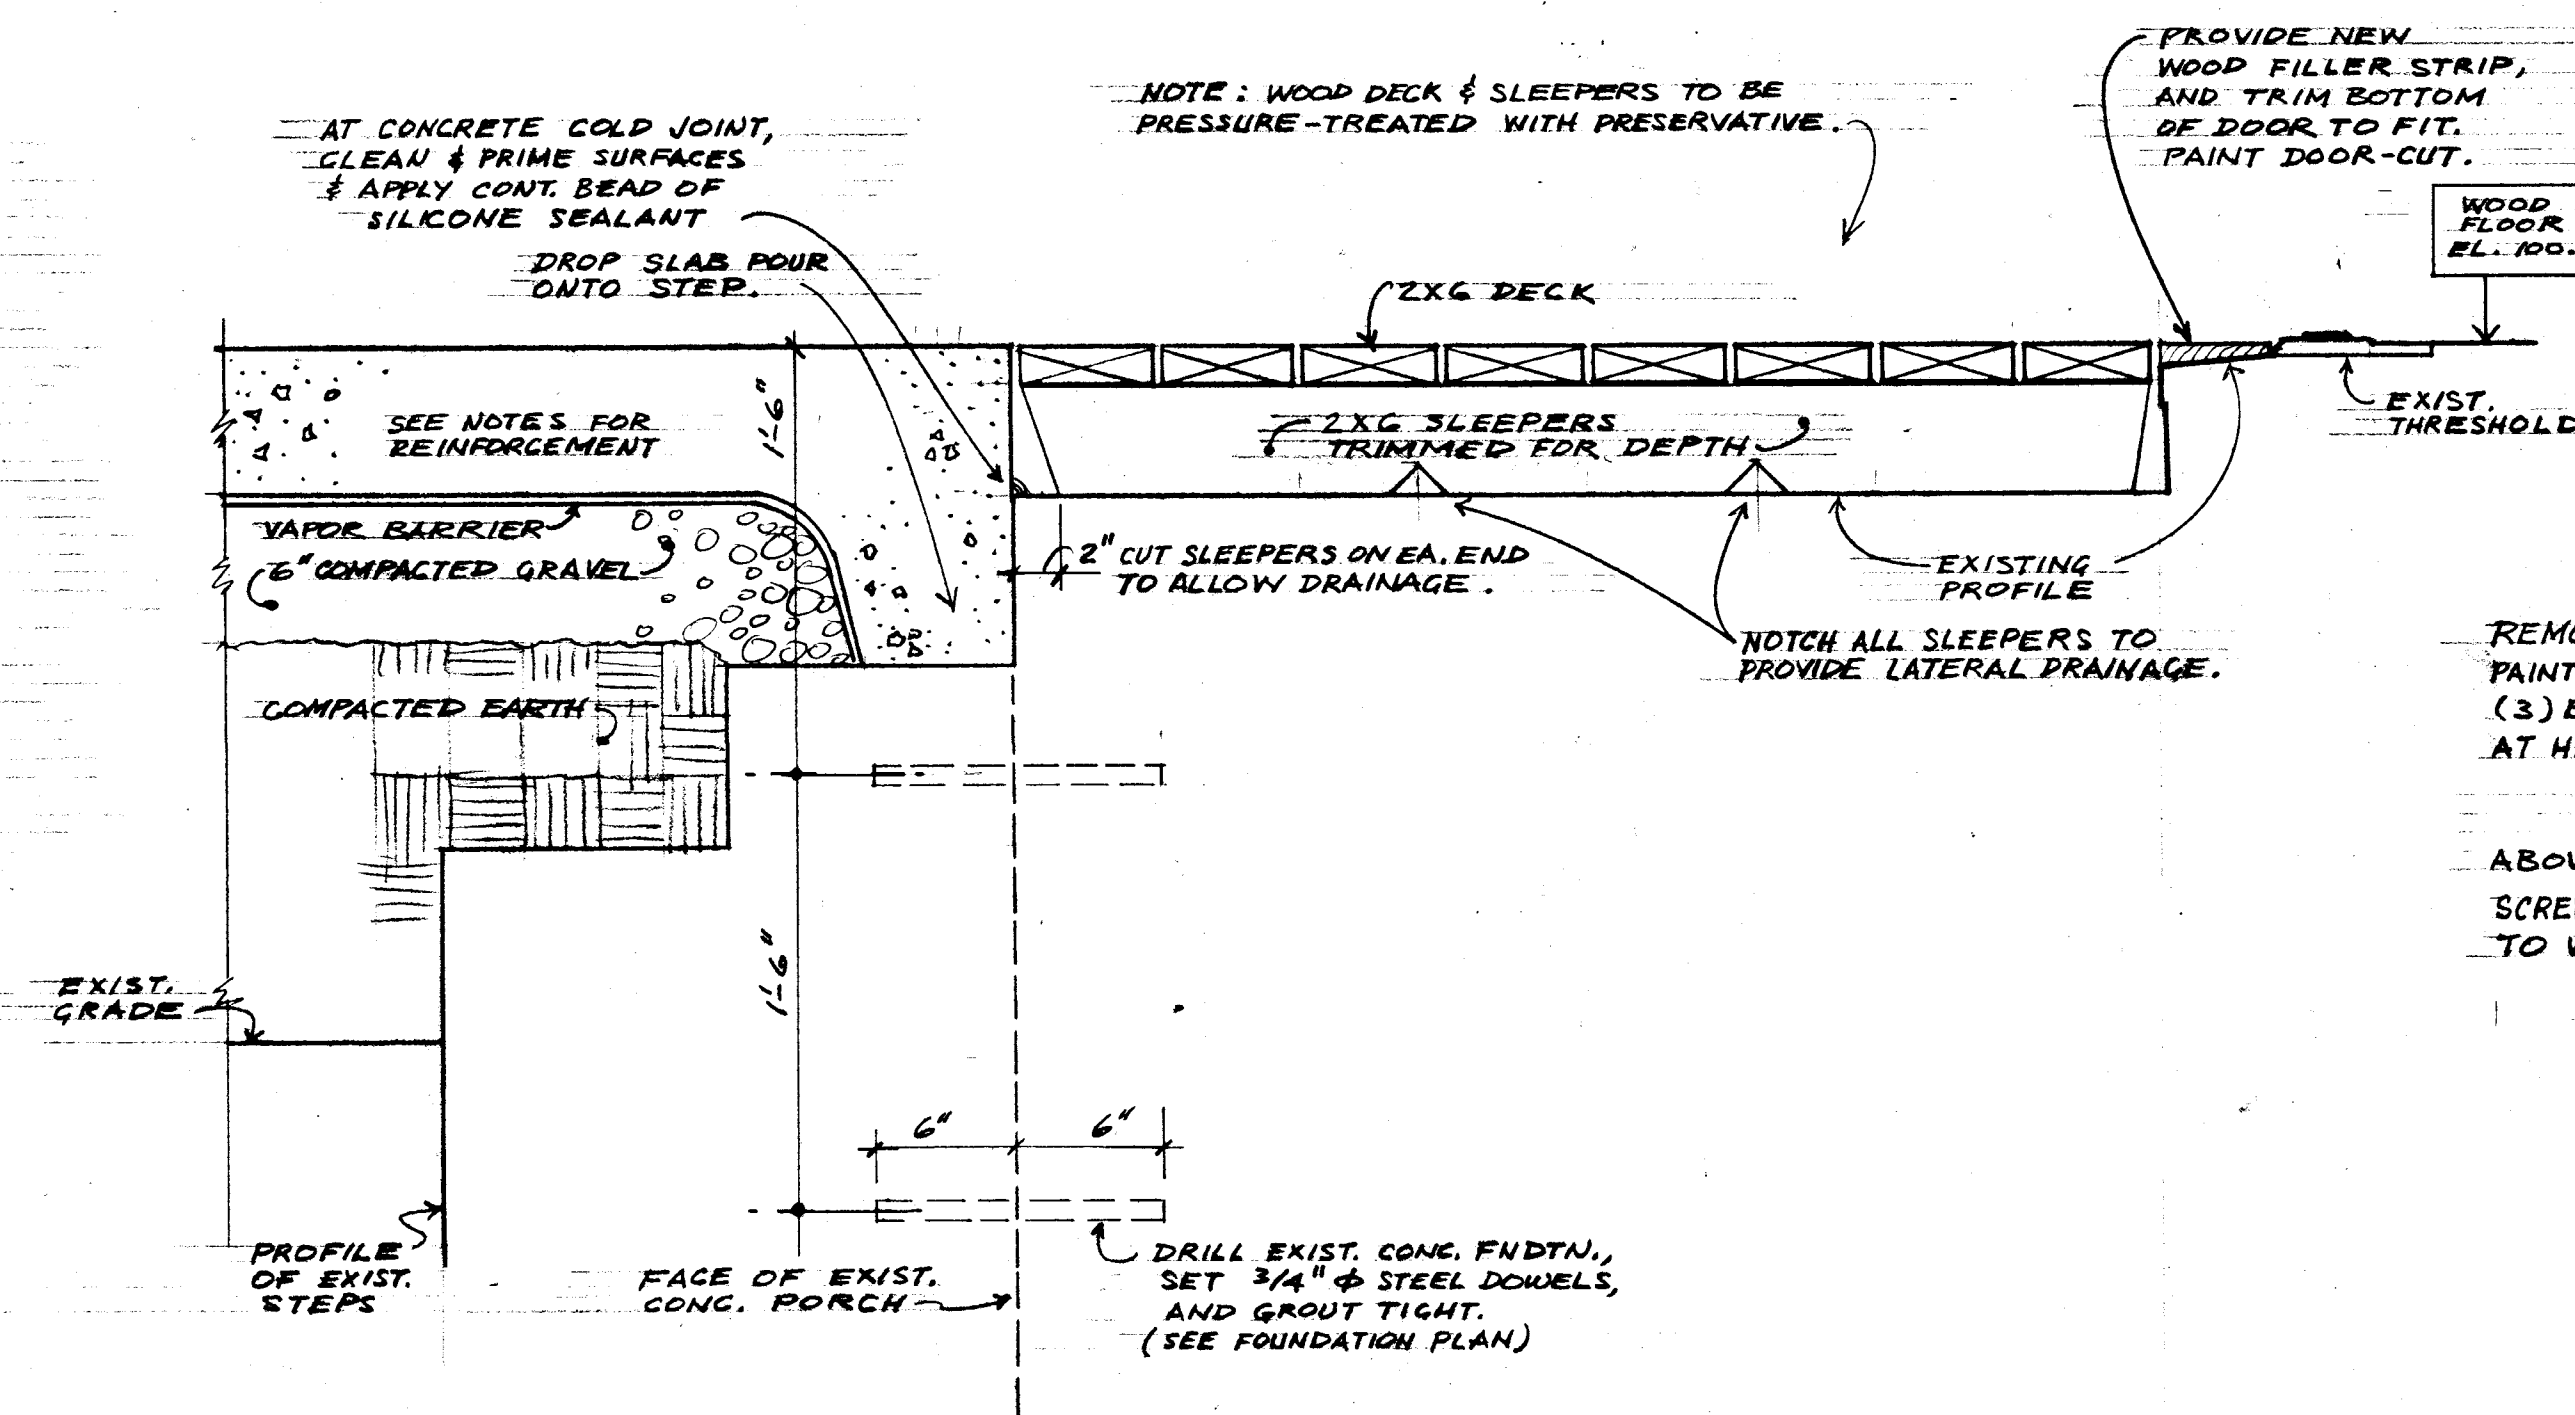



SECTION AT EXISTING PORCH

SCALE: 1/2" = 1'-0"

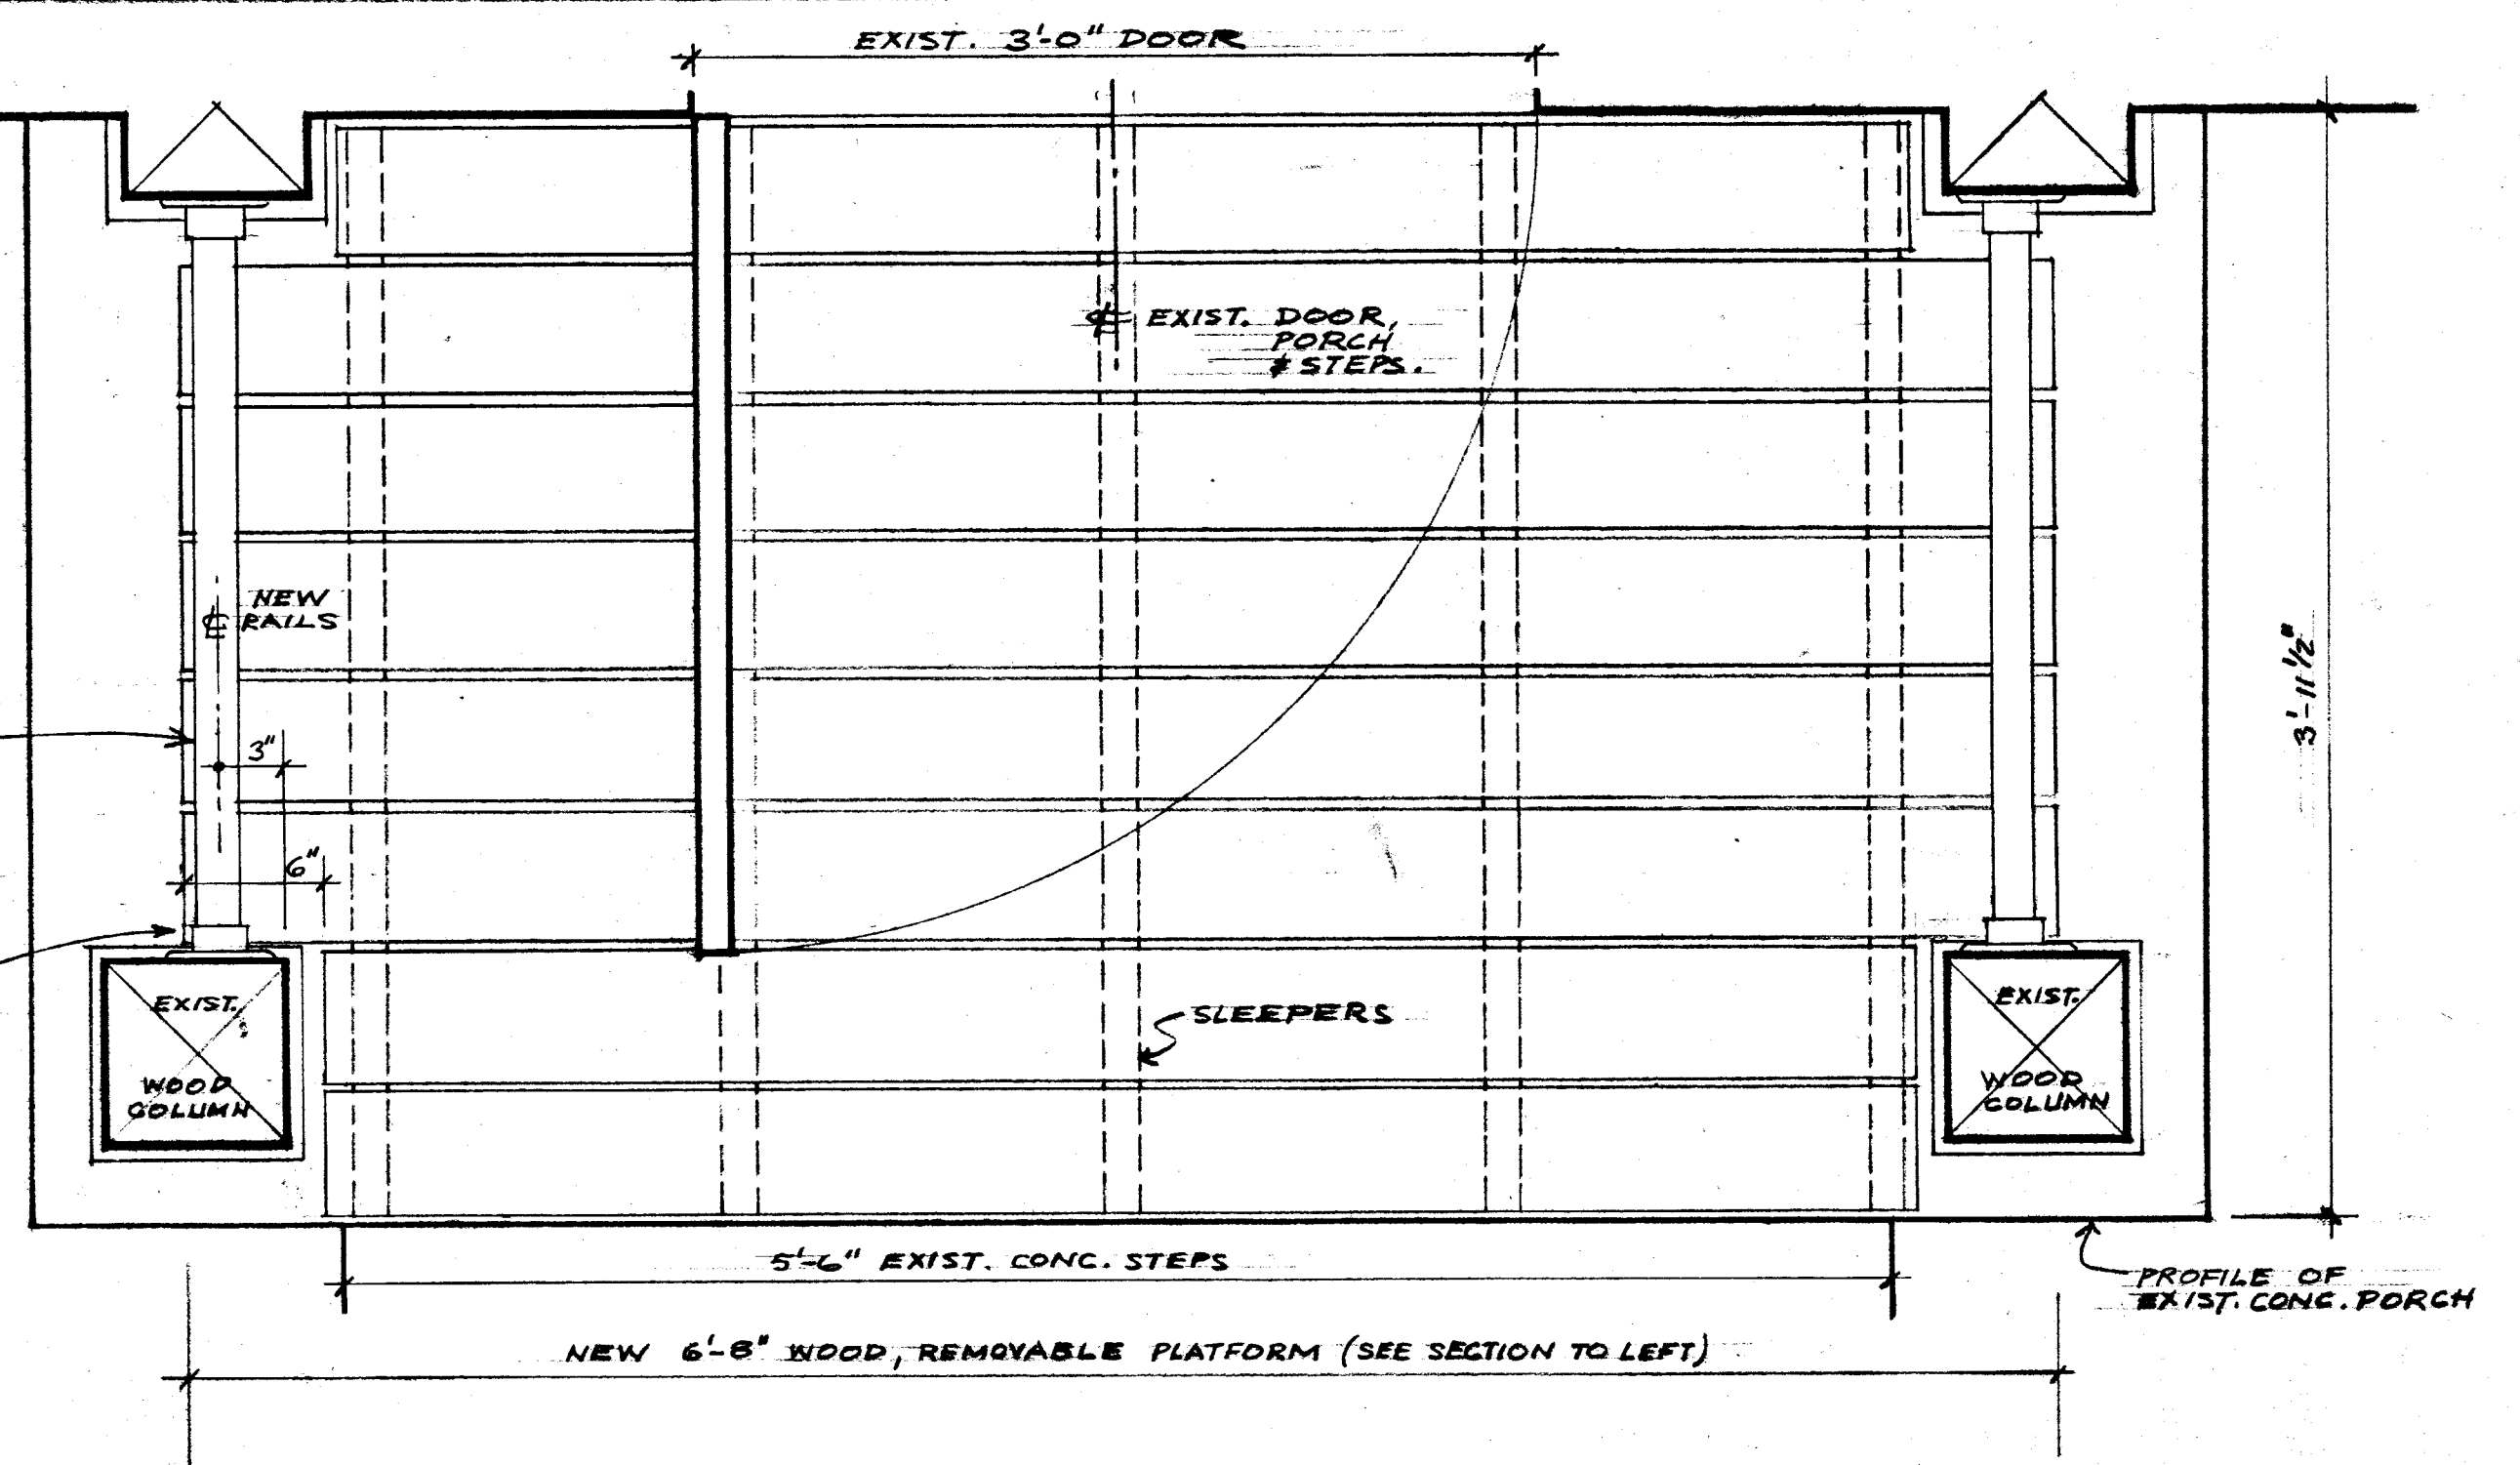


PLAN AT EXISTING PORCH

SCALE: 1/2" = 1'-0"

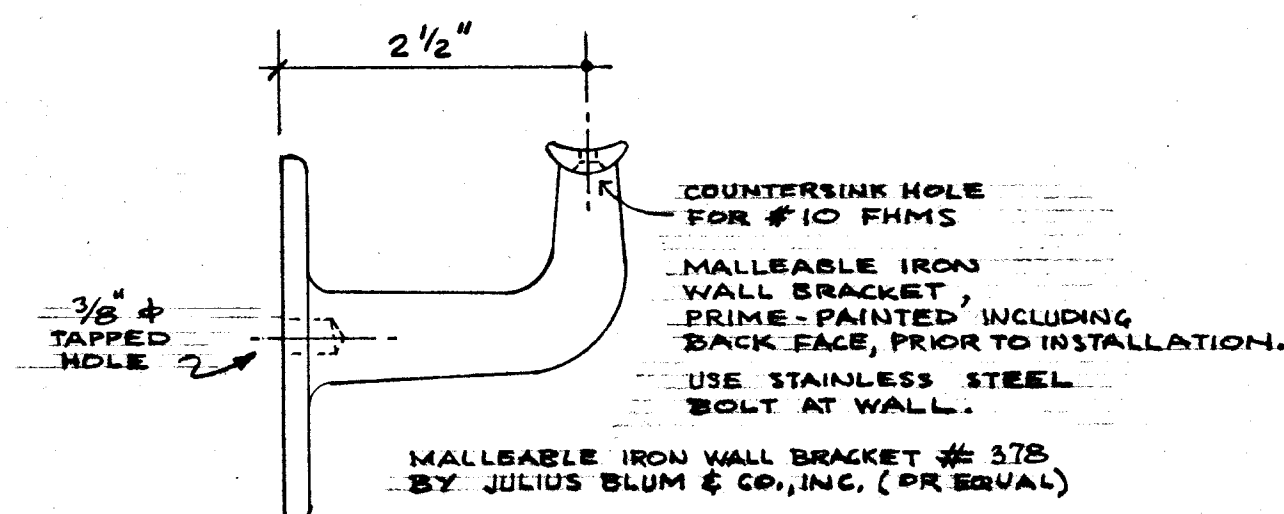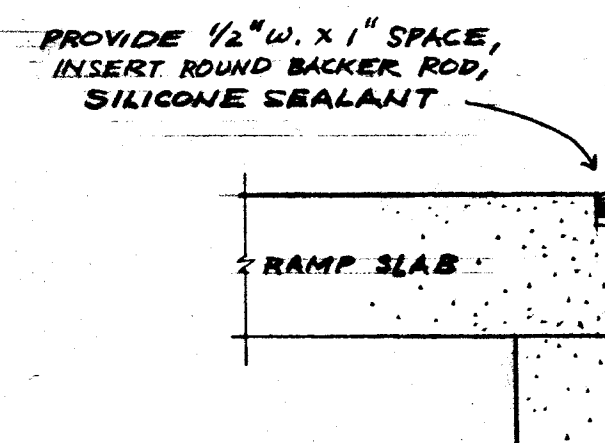
WALL BRACKET FOR TOE RAIL
AT LOW RAMPDETAIL OF JOINT
AT LOW RAMP

SCALE: 1/2" = 1'-0"

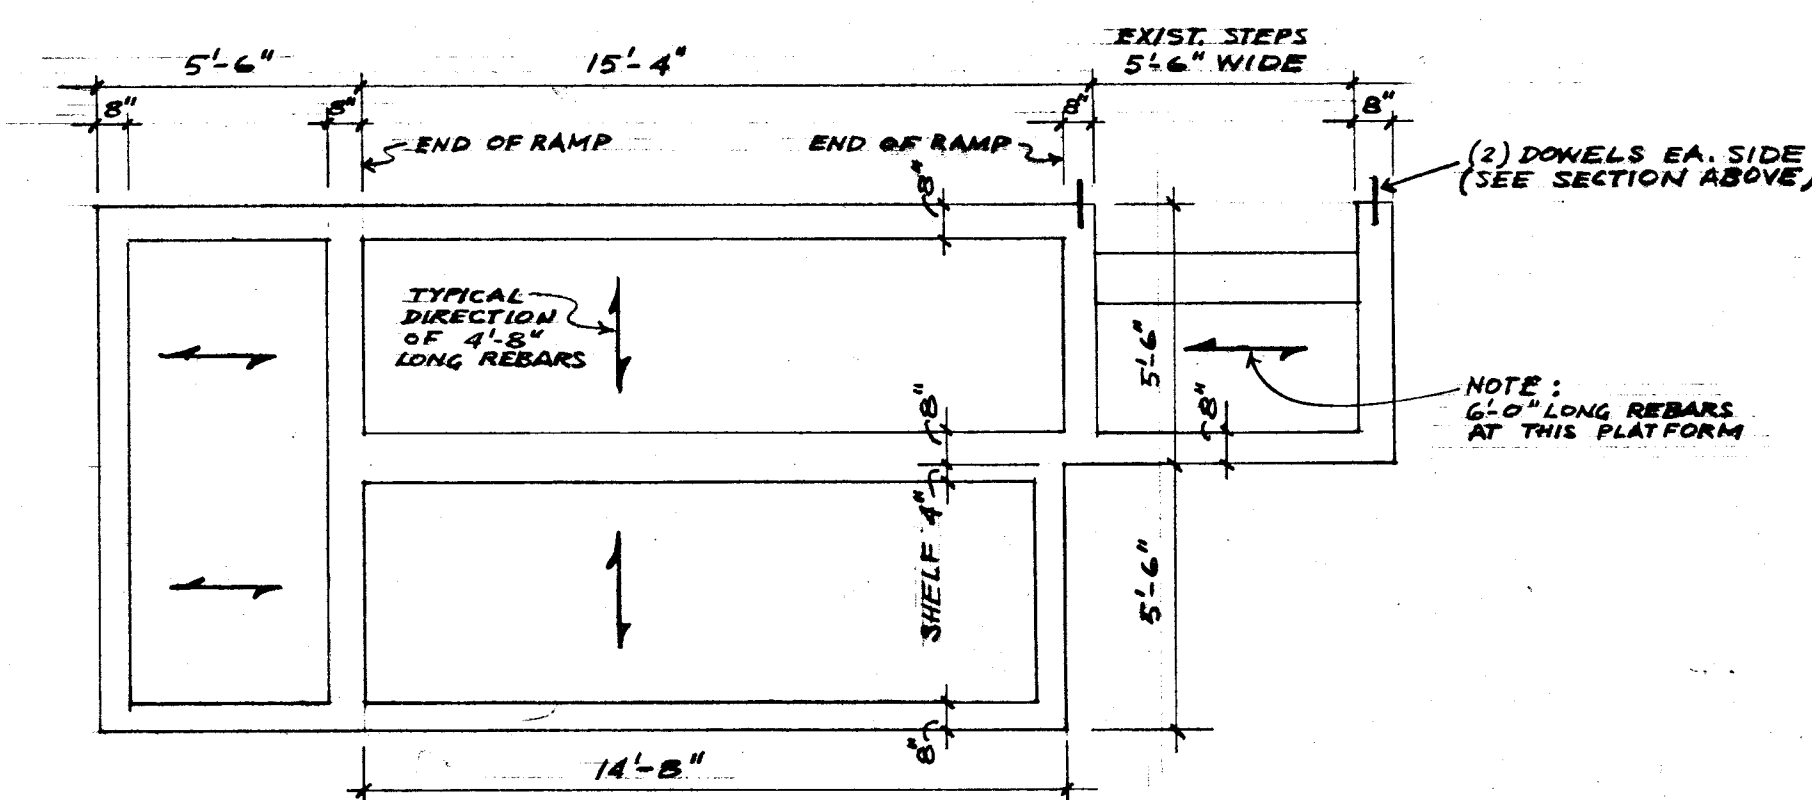


FOUNDATION PLAN

SCALE: 1/4" = 1'-0"

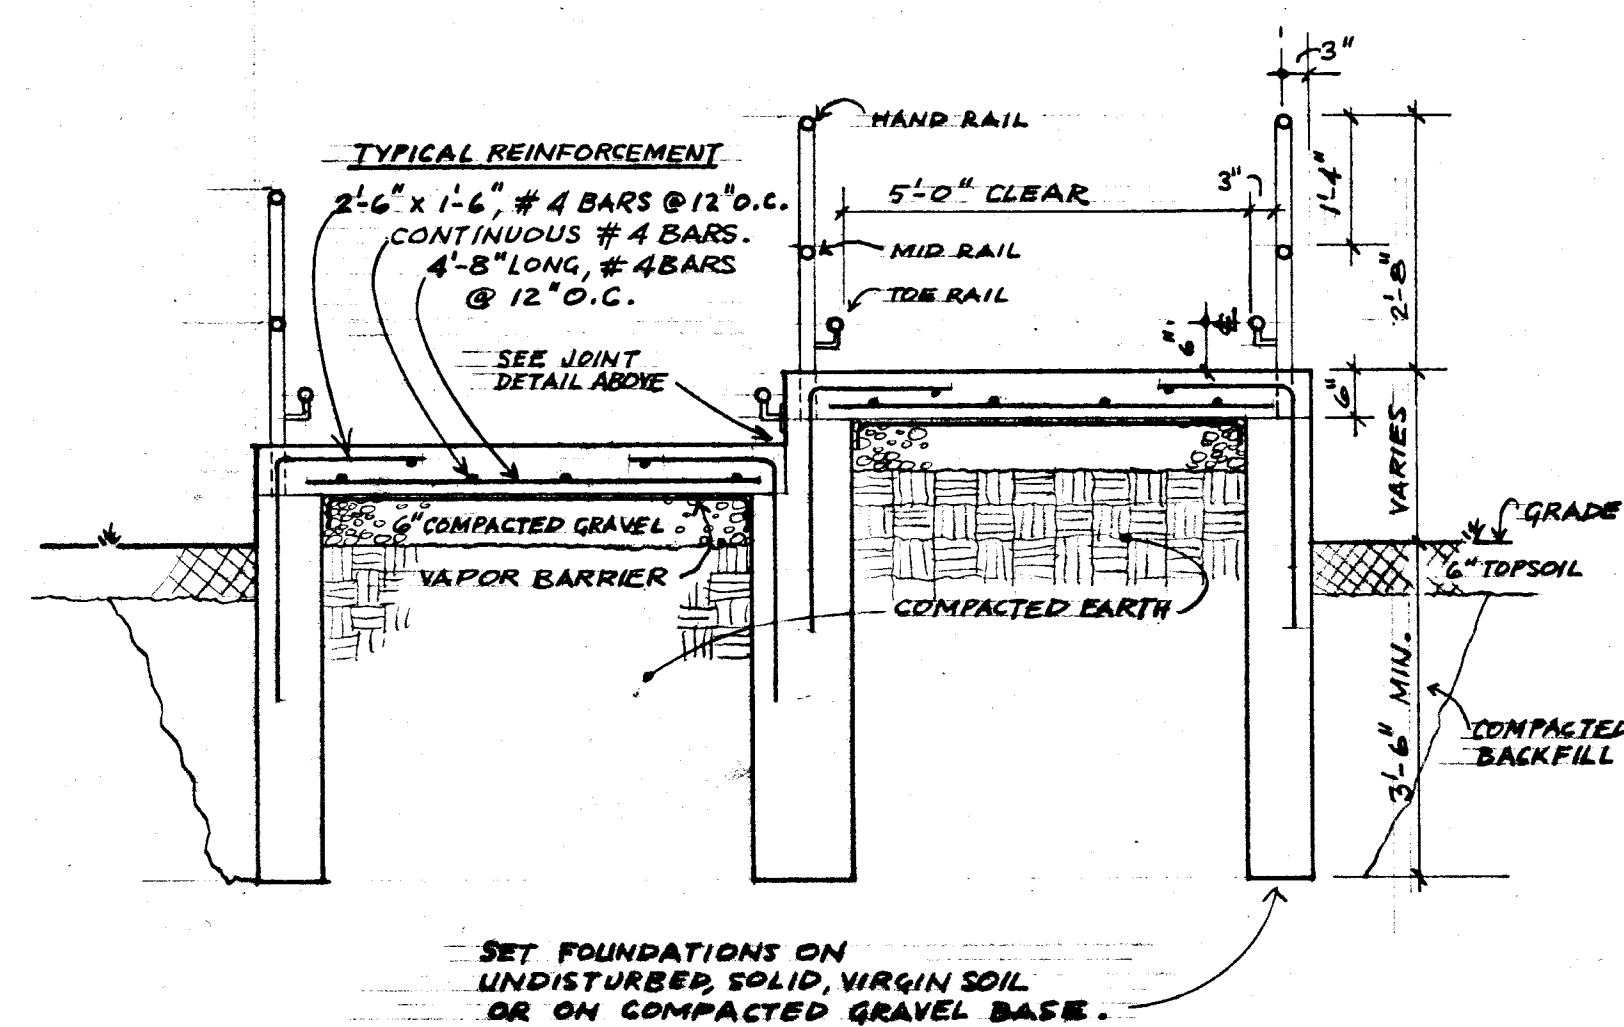


TYPICAL CROSS SECTION AT RAMPS

SCALE: 1/2" = 1'-0"

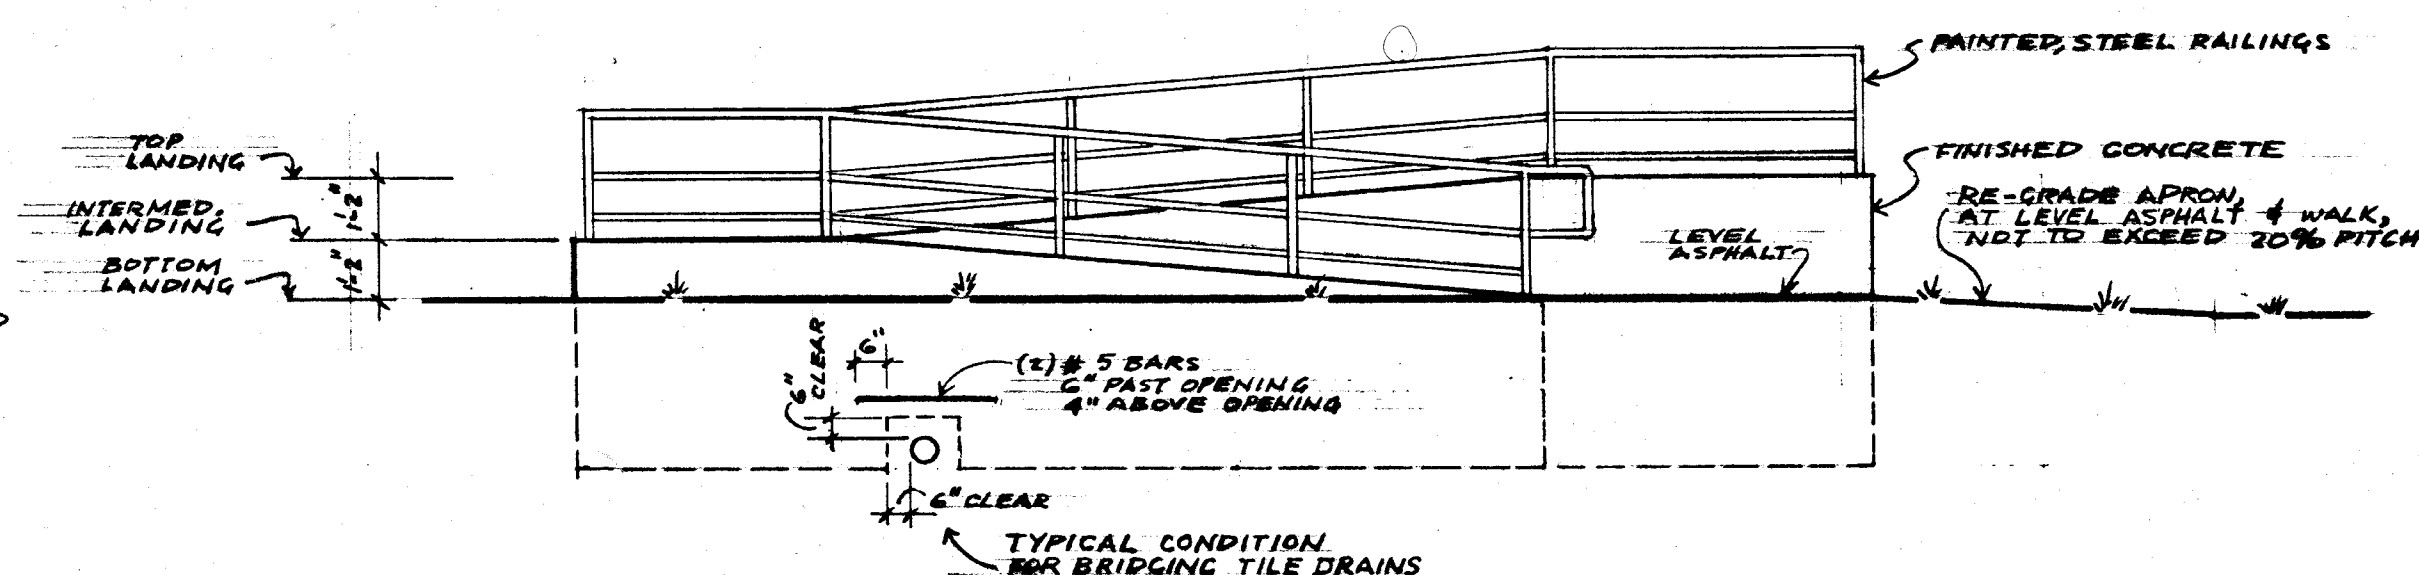

EAST ELEVATION

SCALE: 1/4" = 1'-0"

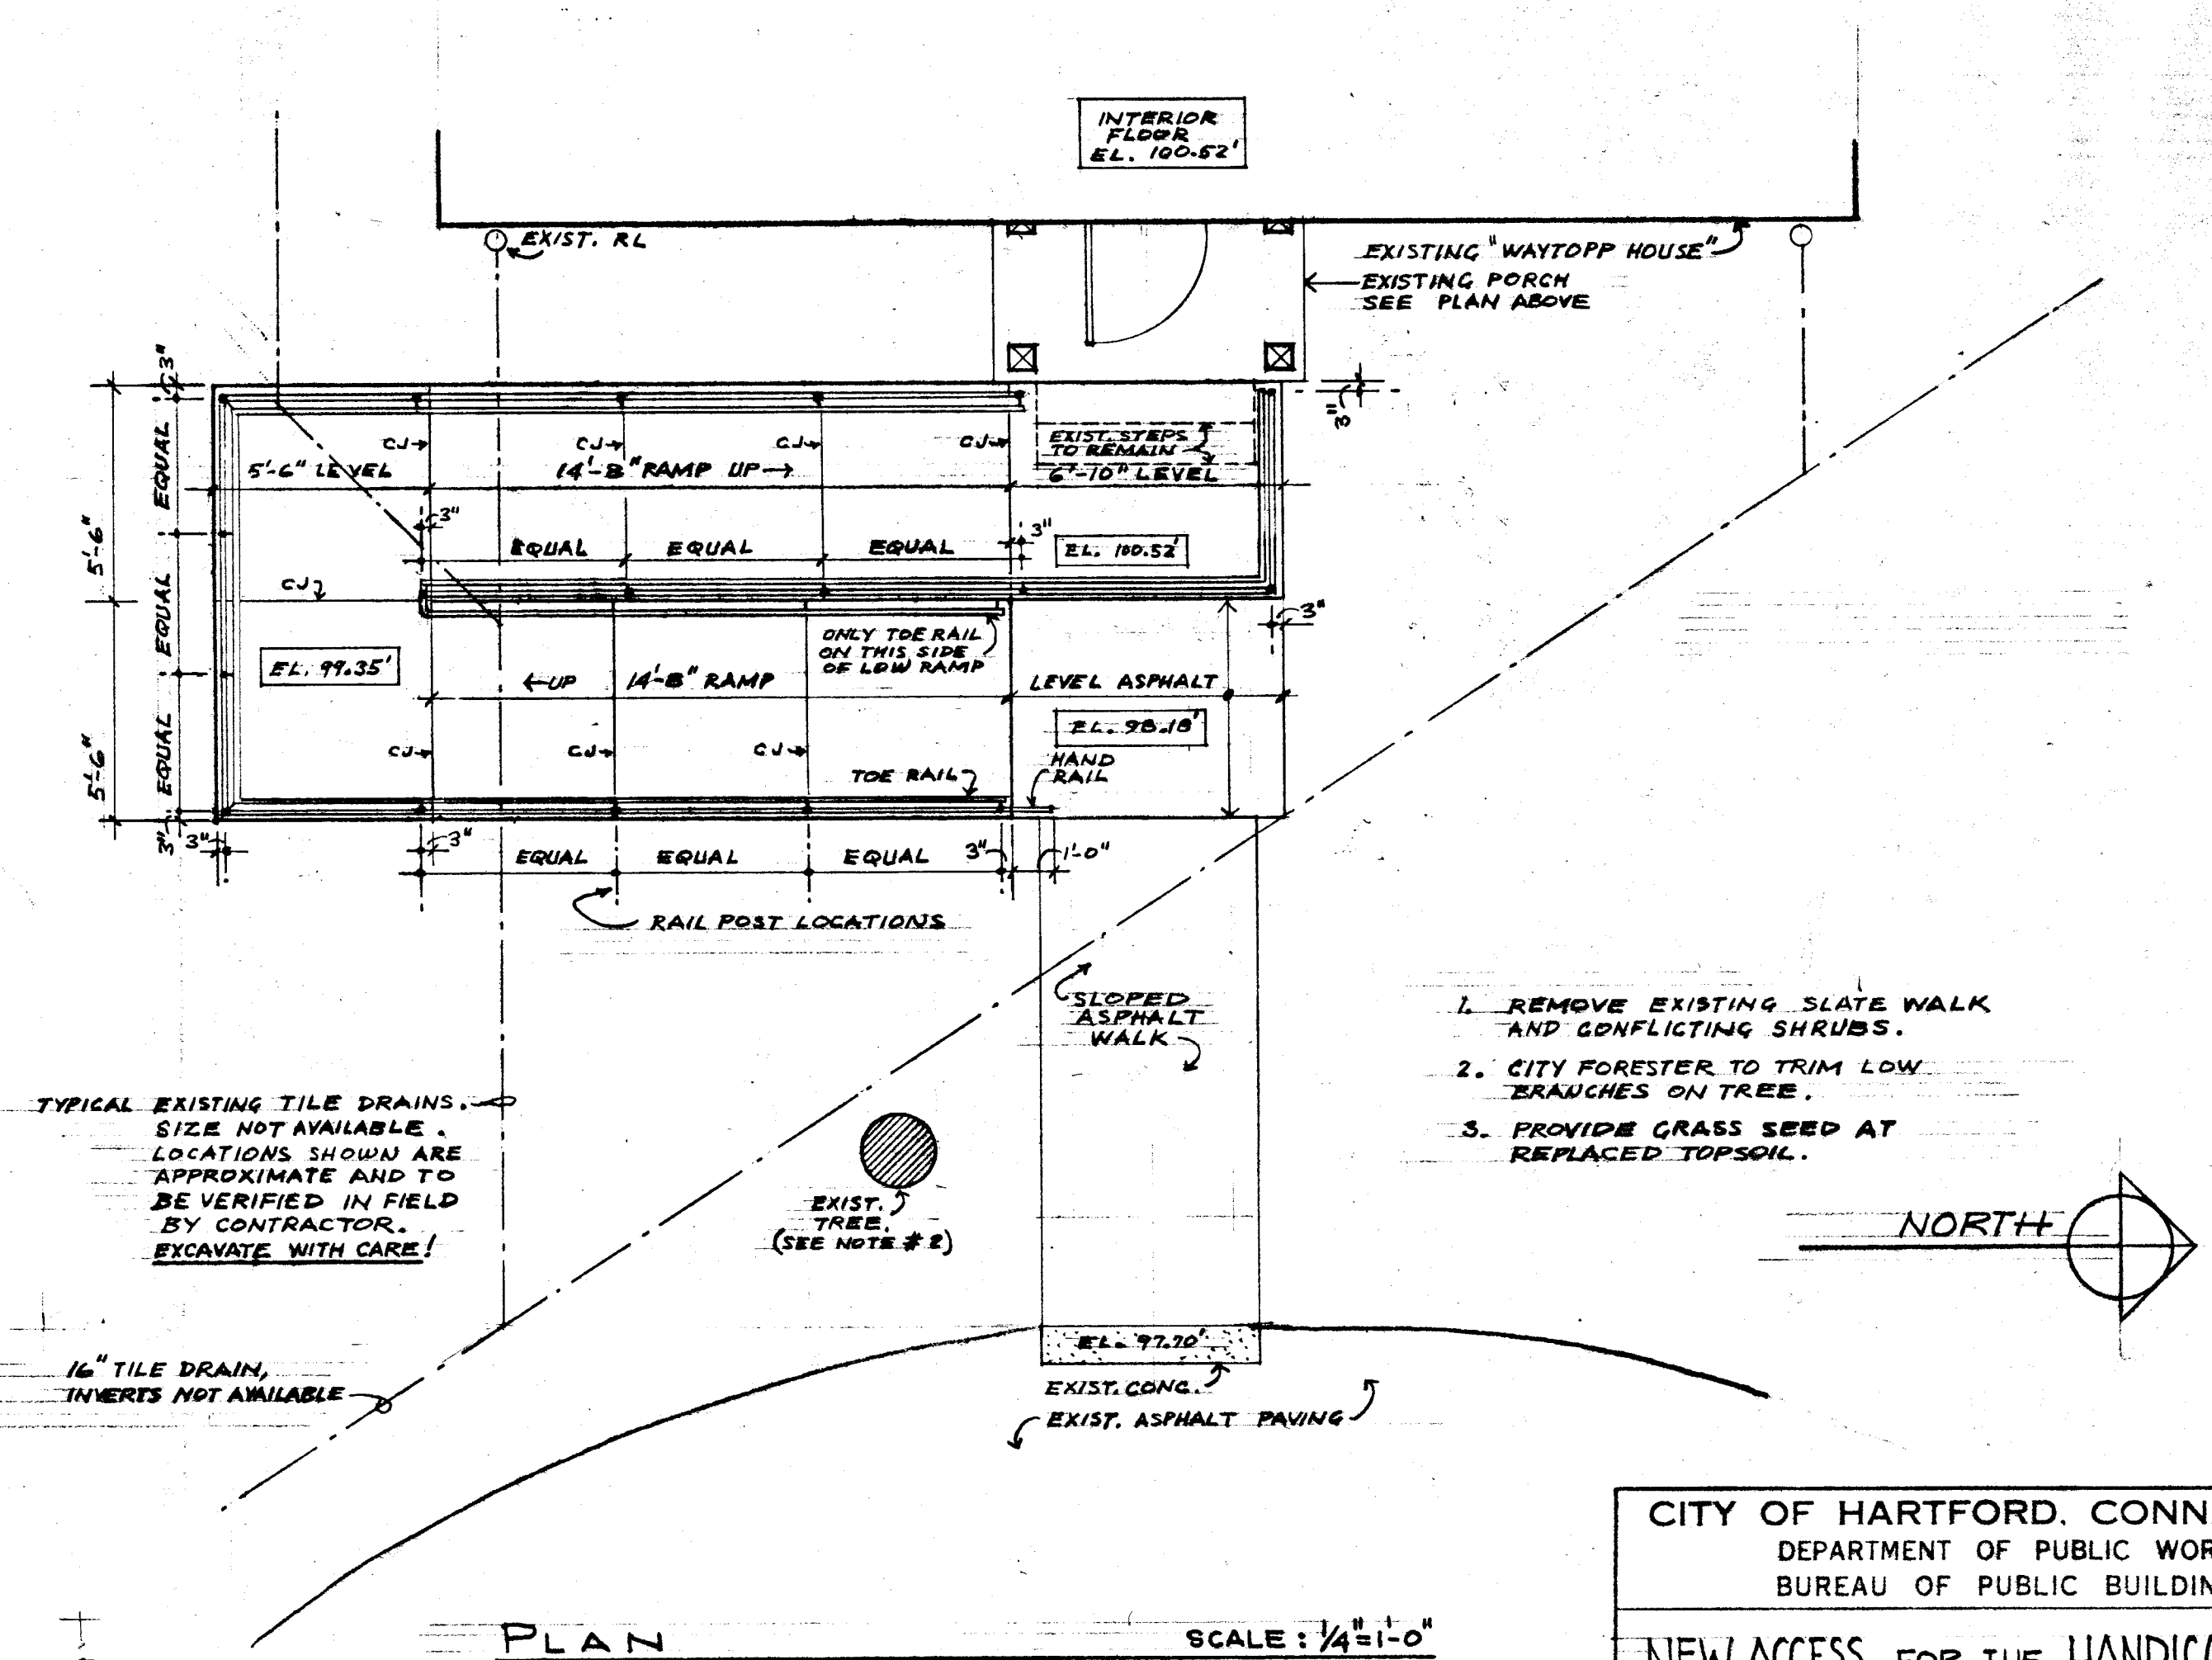

PLAN

SCALE: 1/4" = 1'-0"

1. REMOVE EXISTING SLATE WALK AND CONFLICTING SHRUBS.
2. CITY FORESTER TO TRIM LOW BRANCHES ON TREE.
3. PROVIDE GRASS SEED AT REPLACED TOPSOIL.



CITY OF HARTFORD, CONNECTICUT
 DEPARTMENT OF PUBLIC WORKS
 BUREAU OF PUBLIC BUILDINGS

NEW ACCESS FOR THE HANDICAPPED
 WORKFORCE ADMINISTRATION HQTRS.

MCCOOK COMPLEX - 2 HOLCOMBE ST.
 HARTFORD, CONNECTICUT

SUBMITTED J. H. H. H.	RECOMMENDED A. J. J. J.	APPROVED A. J. J. J.
DRAWN F. J. J.	SCALE AS SHOWN	DAYBOOK NO. 010764
CHECKED	DATE	09/SEPT/1981