
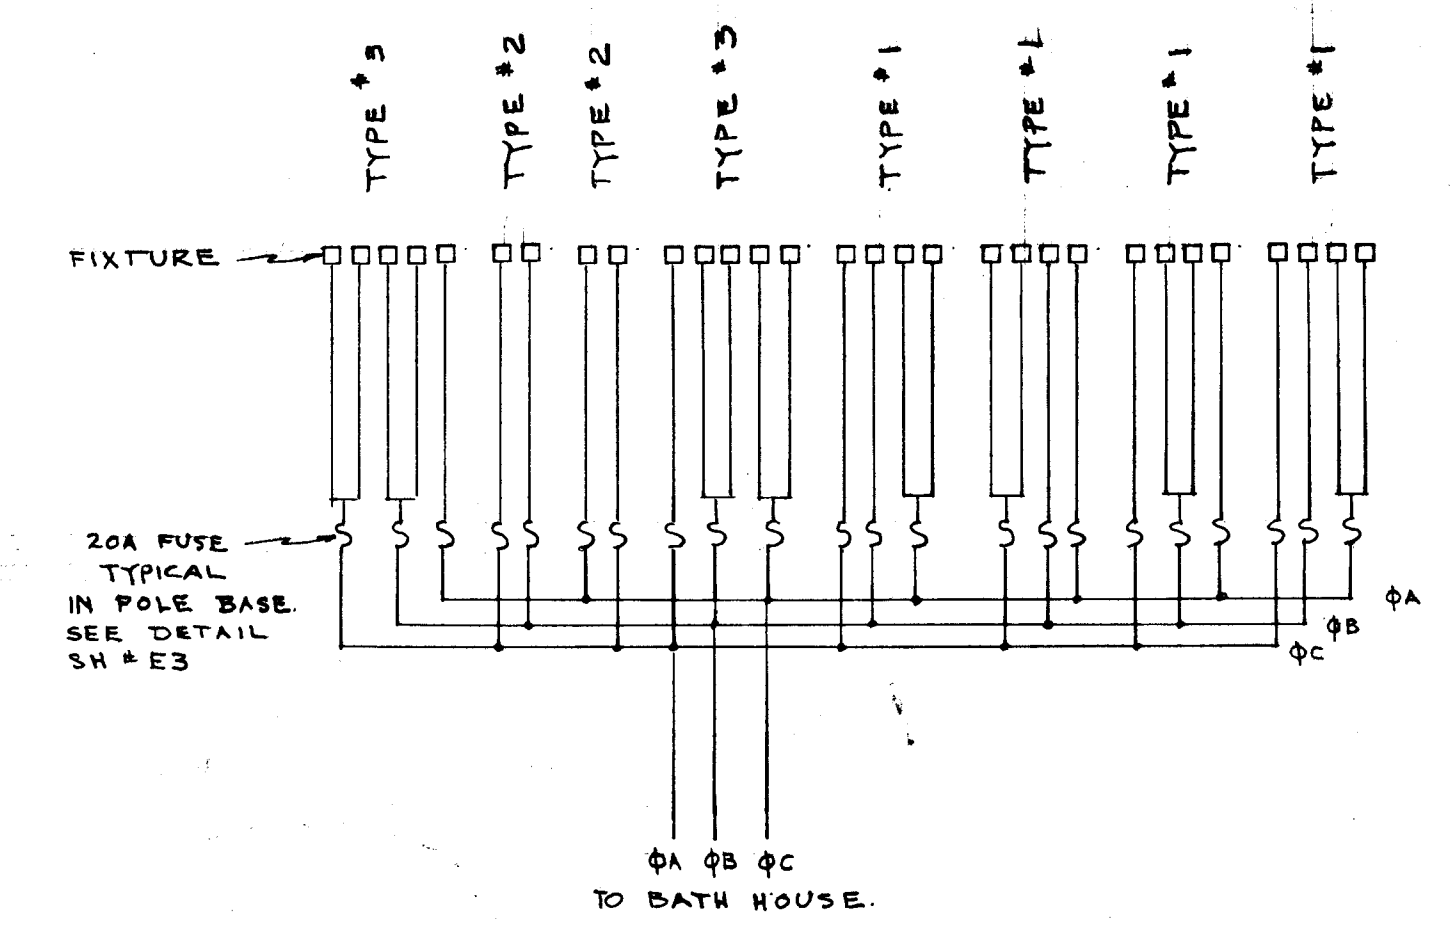


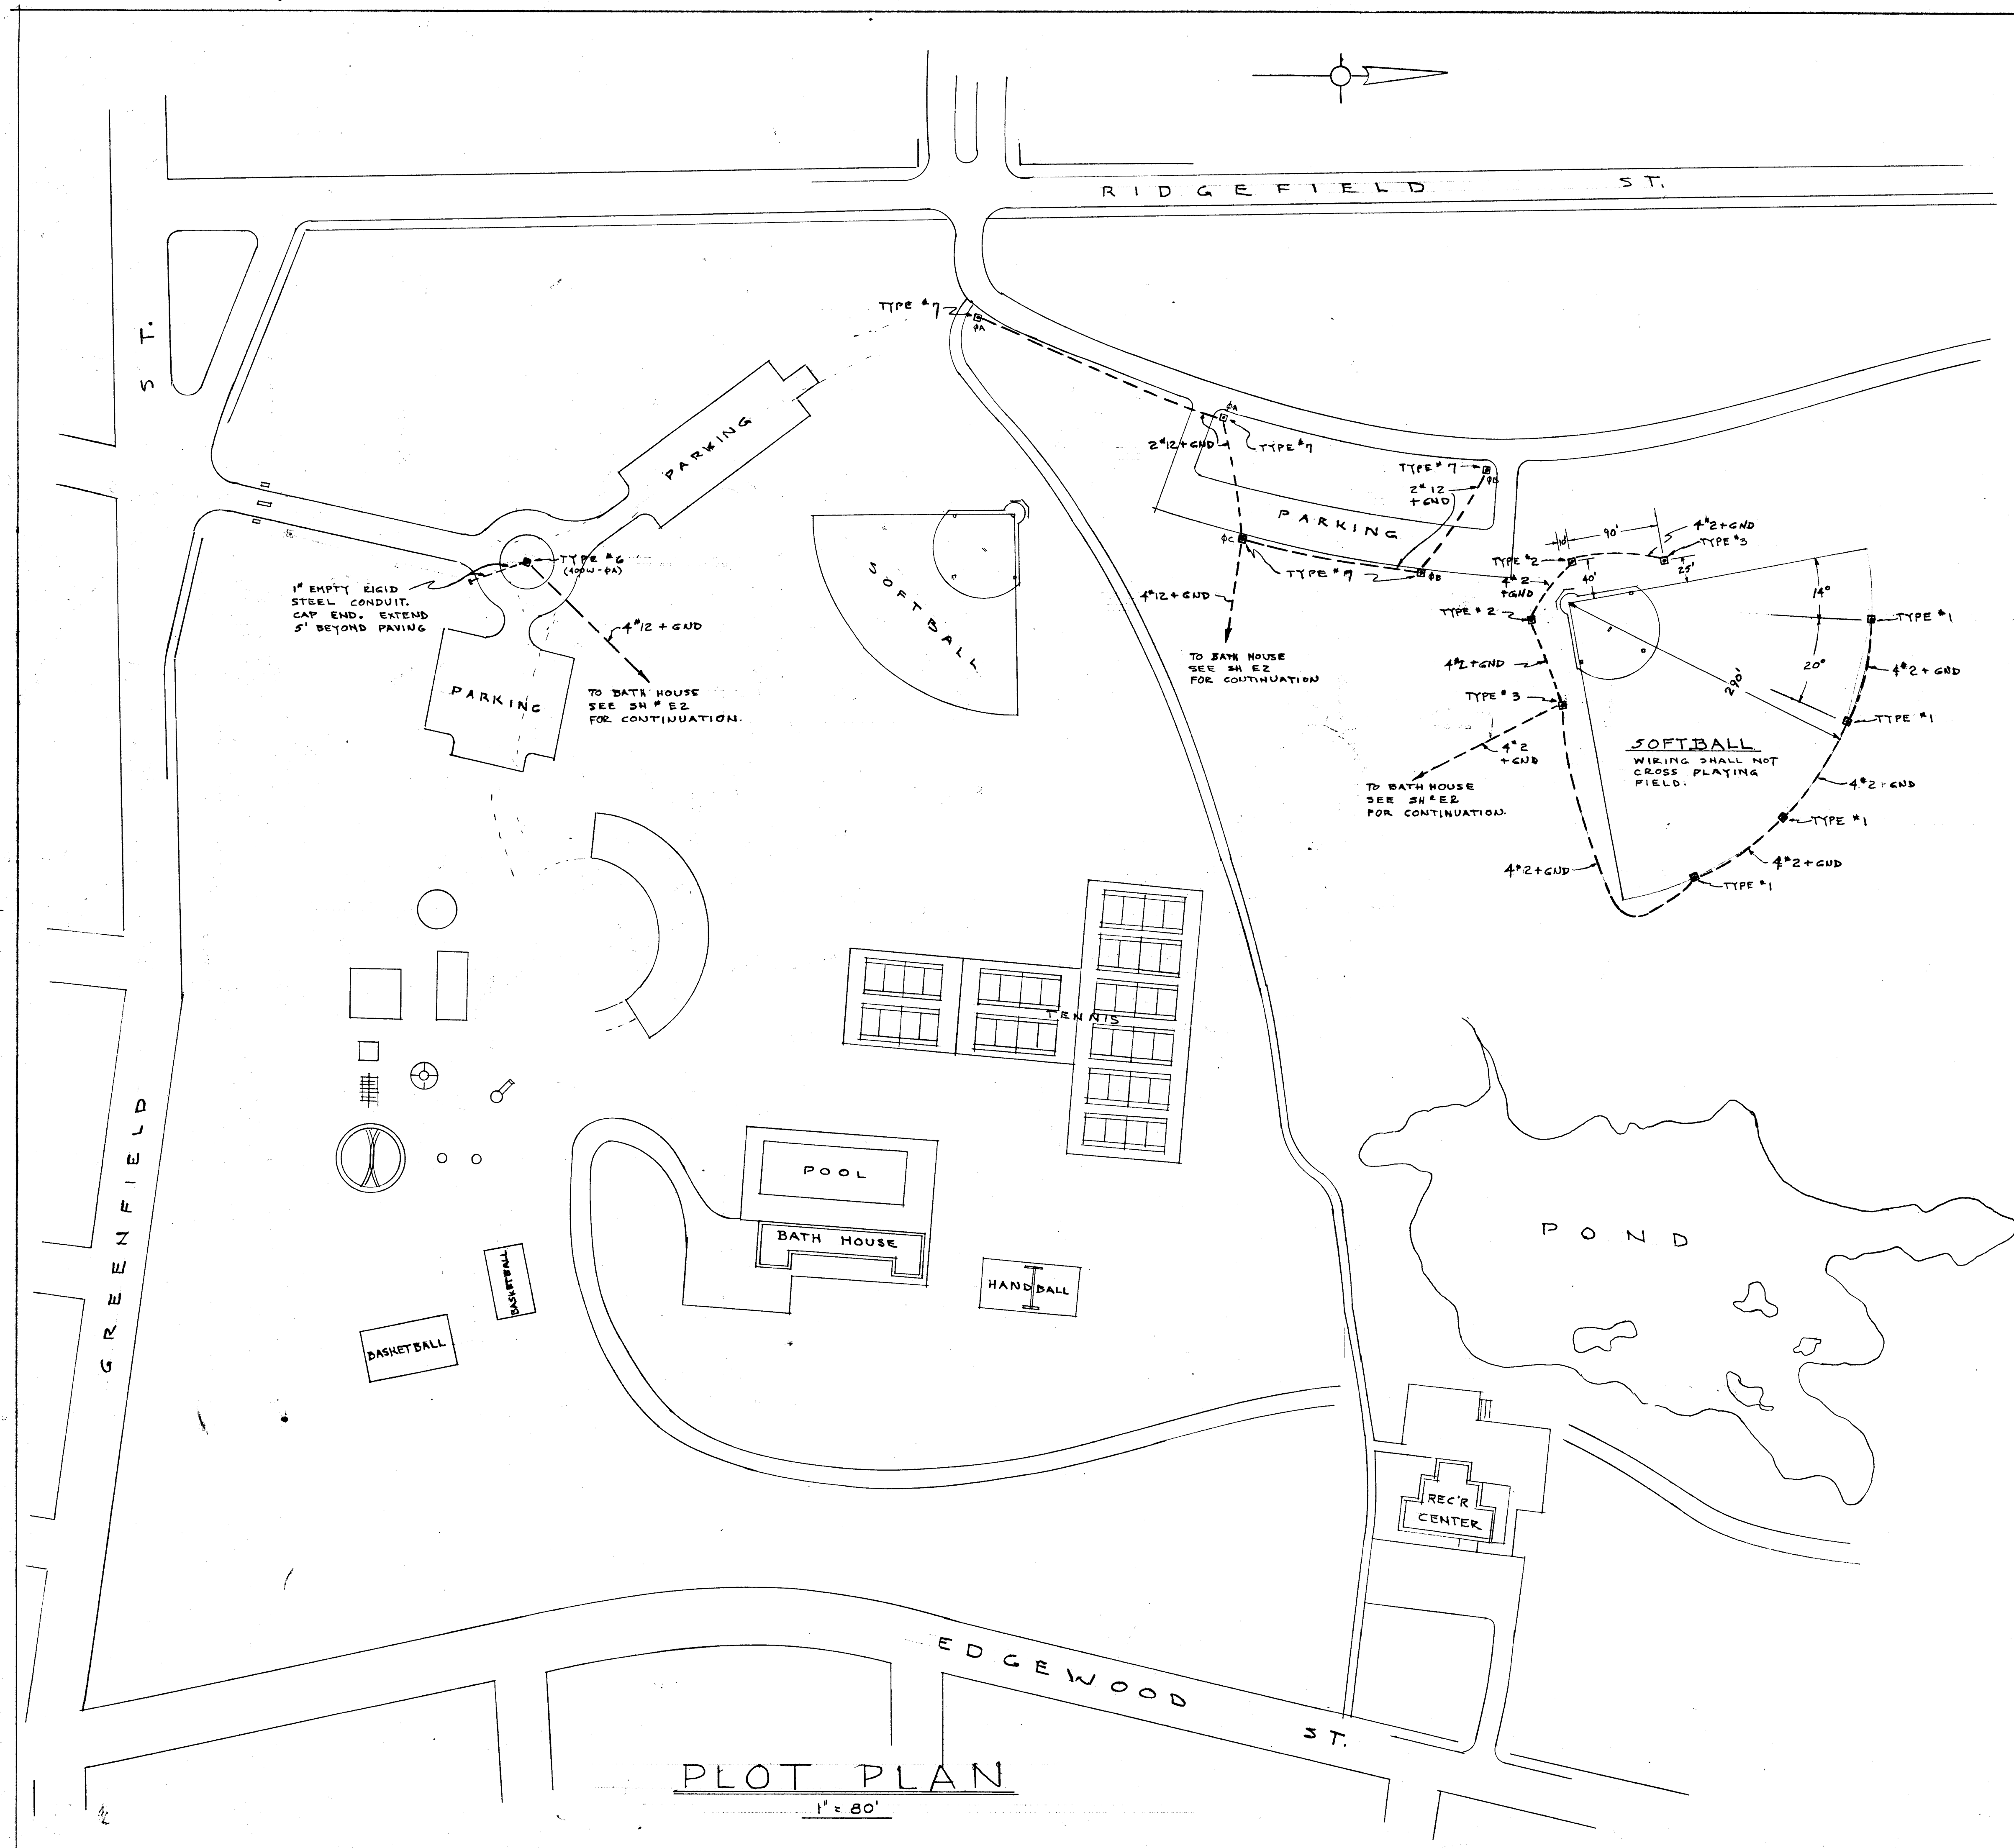

NOTE: NEUTRAL NOT SHOWN.

WIRING DIAGRAM - SOFTBALL

NO. SCALE

- NOTES:**
1. FOR TENNIS & BASKETBALL LIGHTING SEE SHEET - E-2.
 2. WIRING UNDER PAVING TO BE RUN IN PVC TYPE 40 PLASTIC CONDUIT - 2 INCH MINIMUM. EXTEND 5 FEET BEYOND PAVING.

VERIFY EXISTING
CONDITIONS AND
DIMENSIONS

CITY OF HARTFORD, CONNECTICUT DEPARTMENT OF PUBLIC WORKS BUREAU OF PUBLIC BUILDINGS		
SPORTS LIGHTING KENEY WOODLAND AREA KENEY PARK HARTFORD CONNECTICUT		
SUBMITTED <i>R. C. Benson</i>	RECOMMENDED <i>Walter H. Paul</i>	APPROVED <i>George C. Hopper</i>
DRAWN RCB	SCALE	DAYBOOK NO. 010577-A
CHECKED RCB		DATE SEPT. 3, 1976