

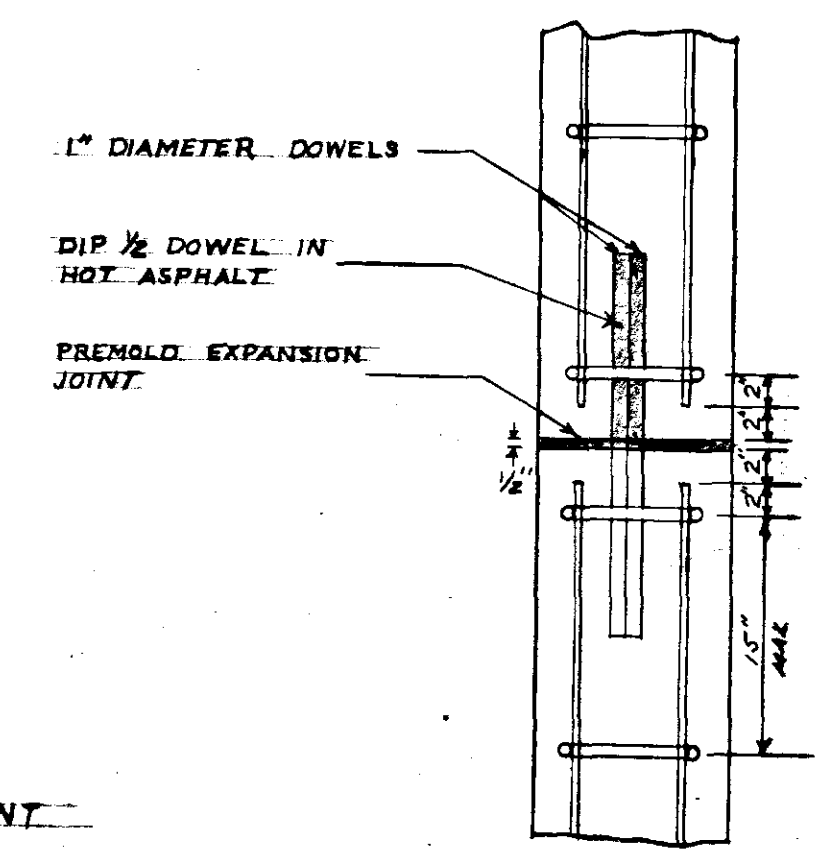
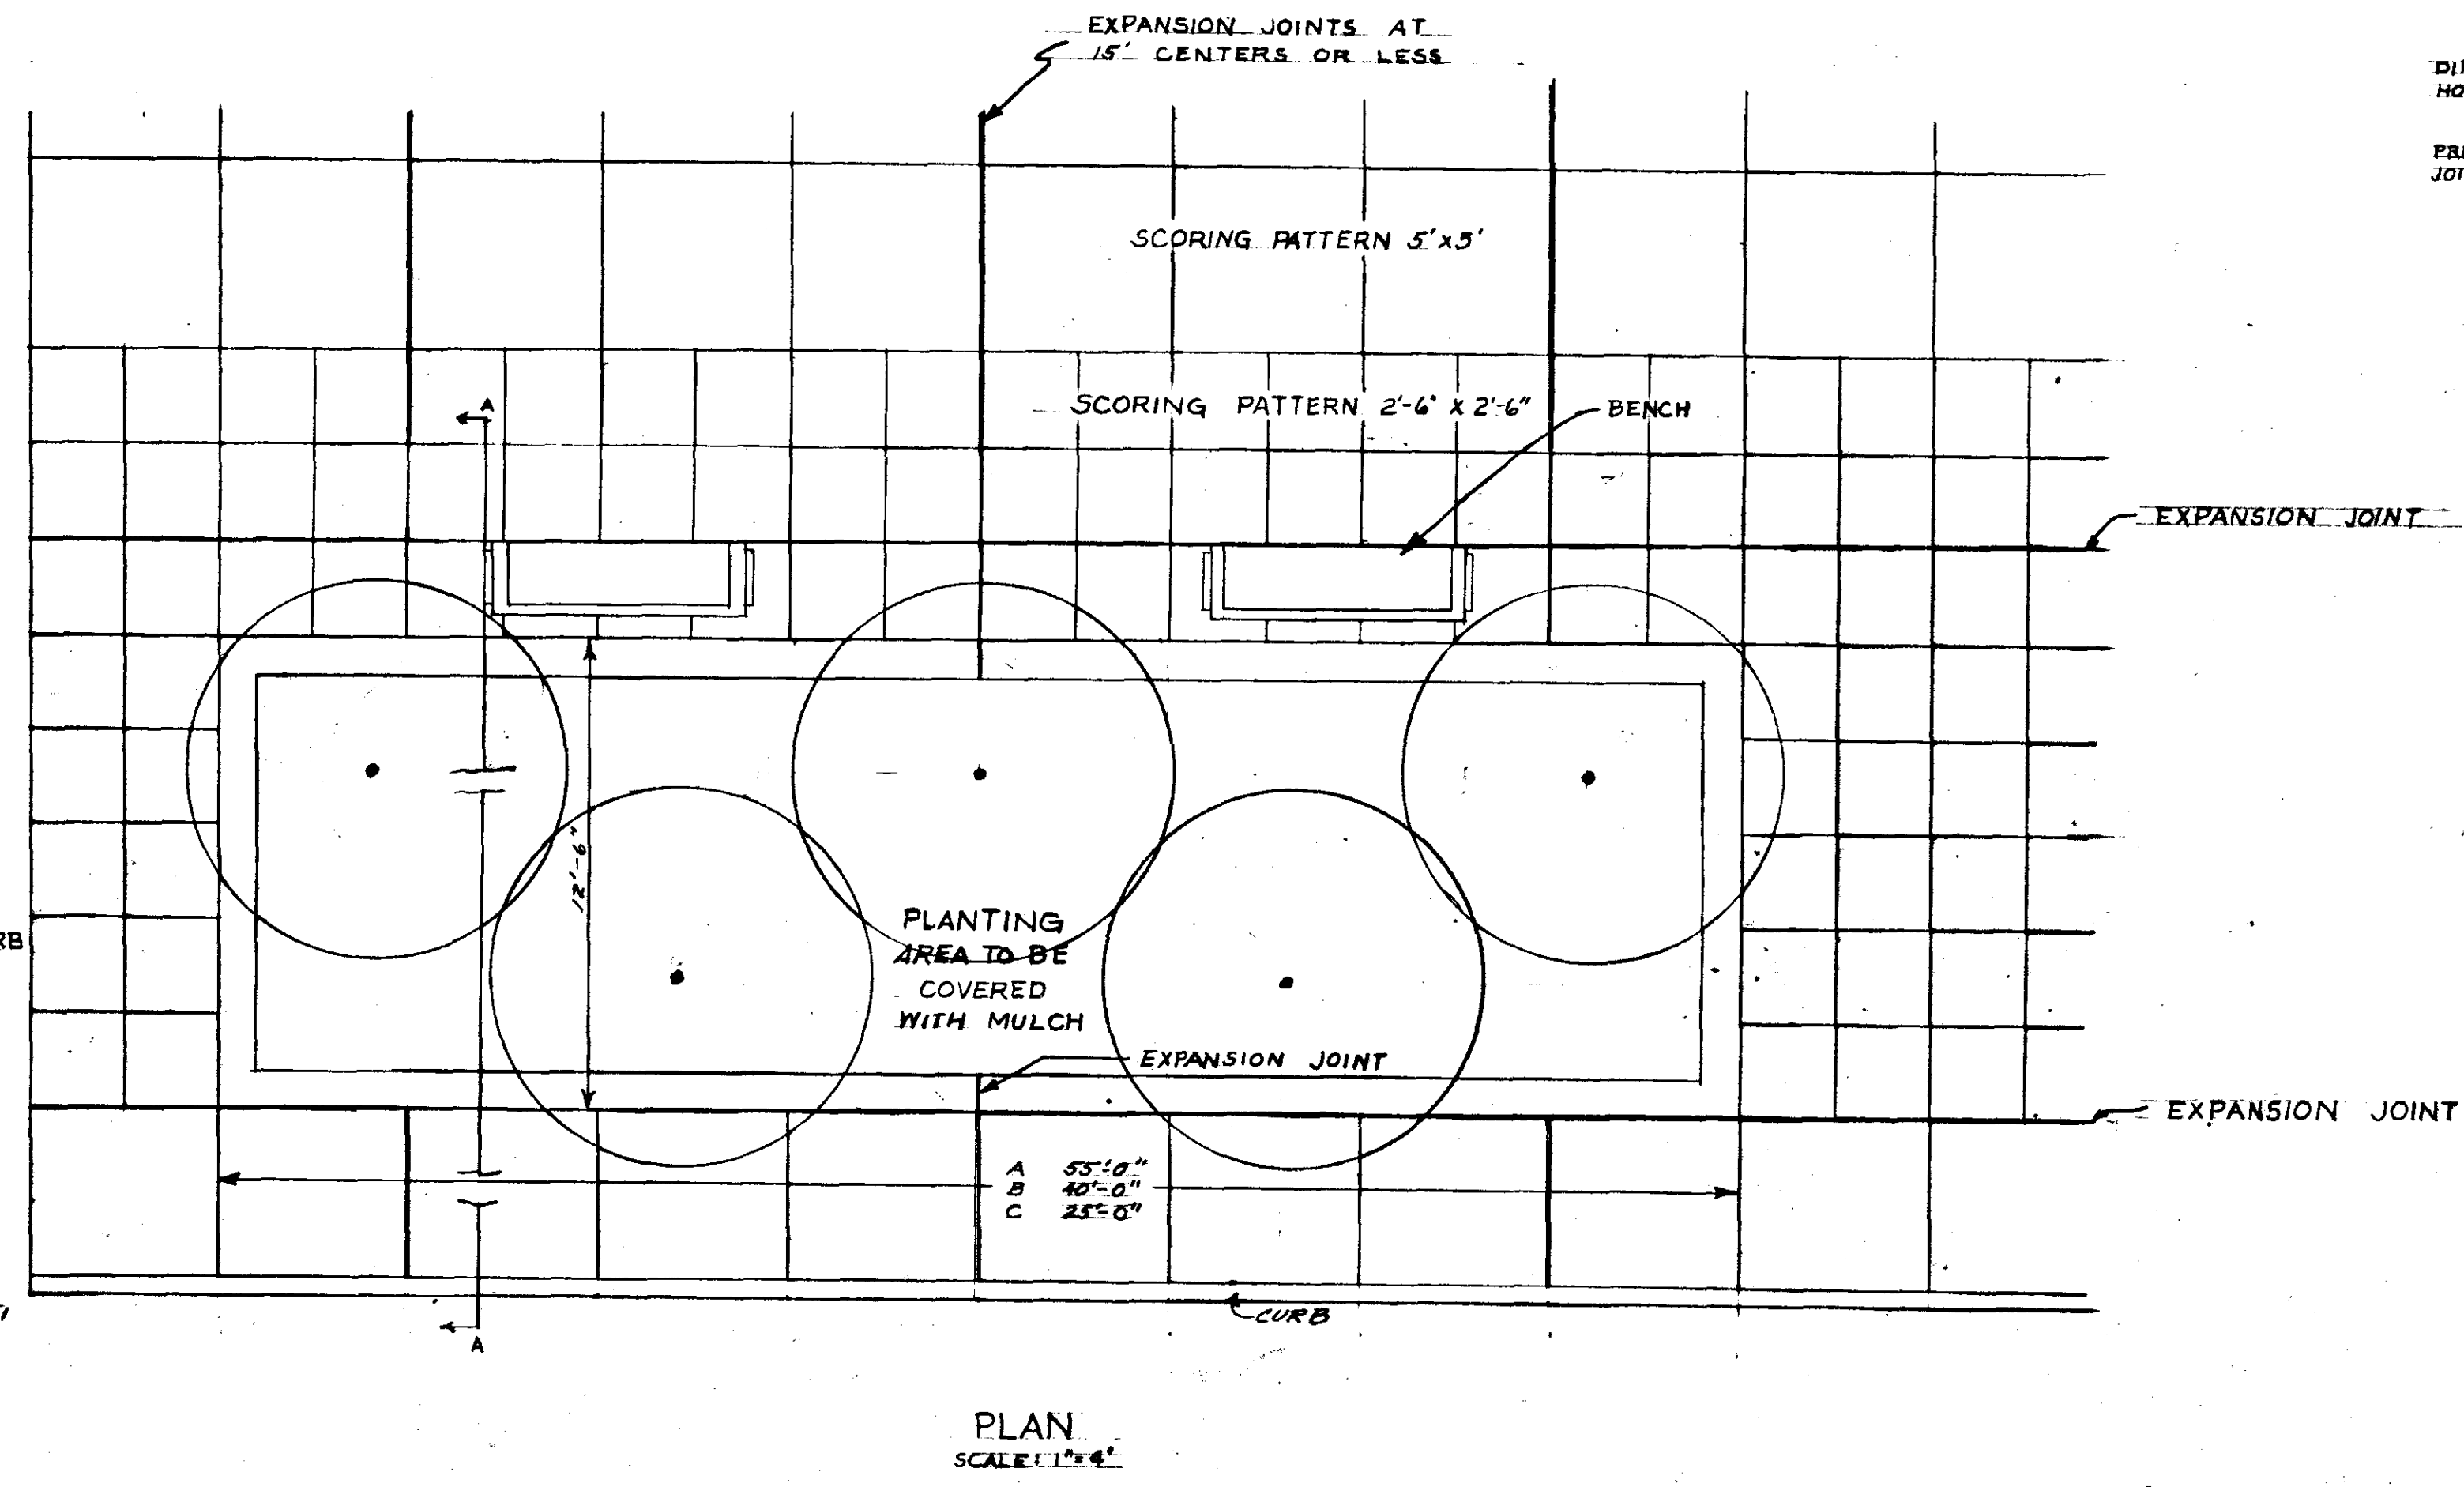


EXISTING SIDEWALKS TO BE REMOVED  
BETWEEN BUILDINGS & CURBS. NEW CONCRETE  
SIDEWALK TO BE INSTALLED AS PER  
CITY SPEC'S. EXISTING DRIVEWAYS  
TO REMAIN.

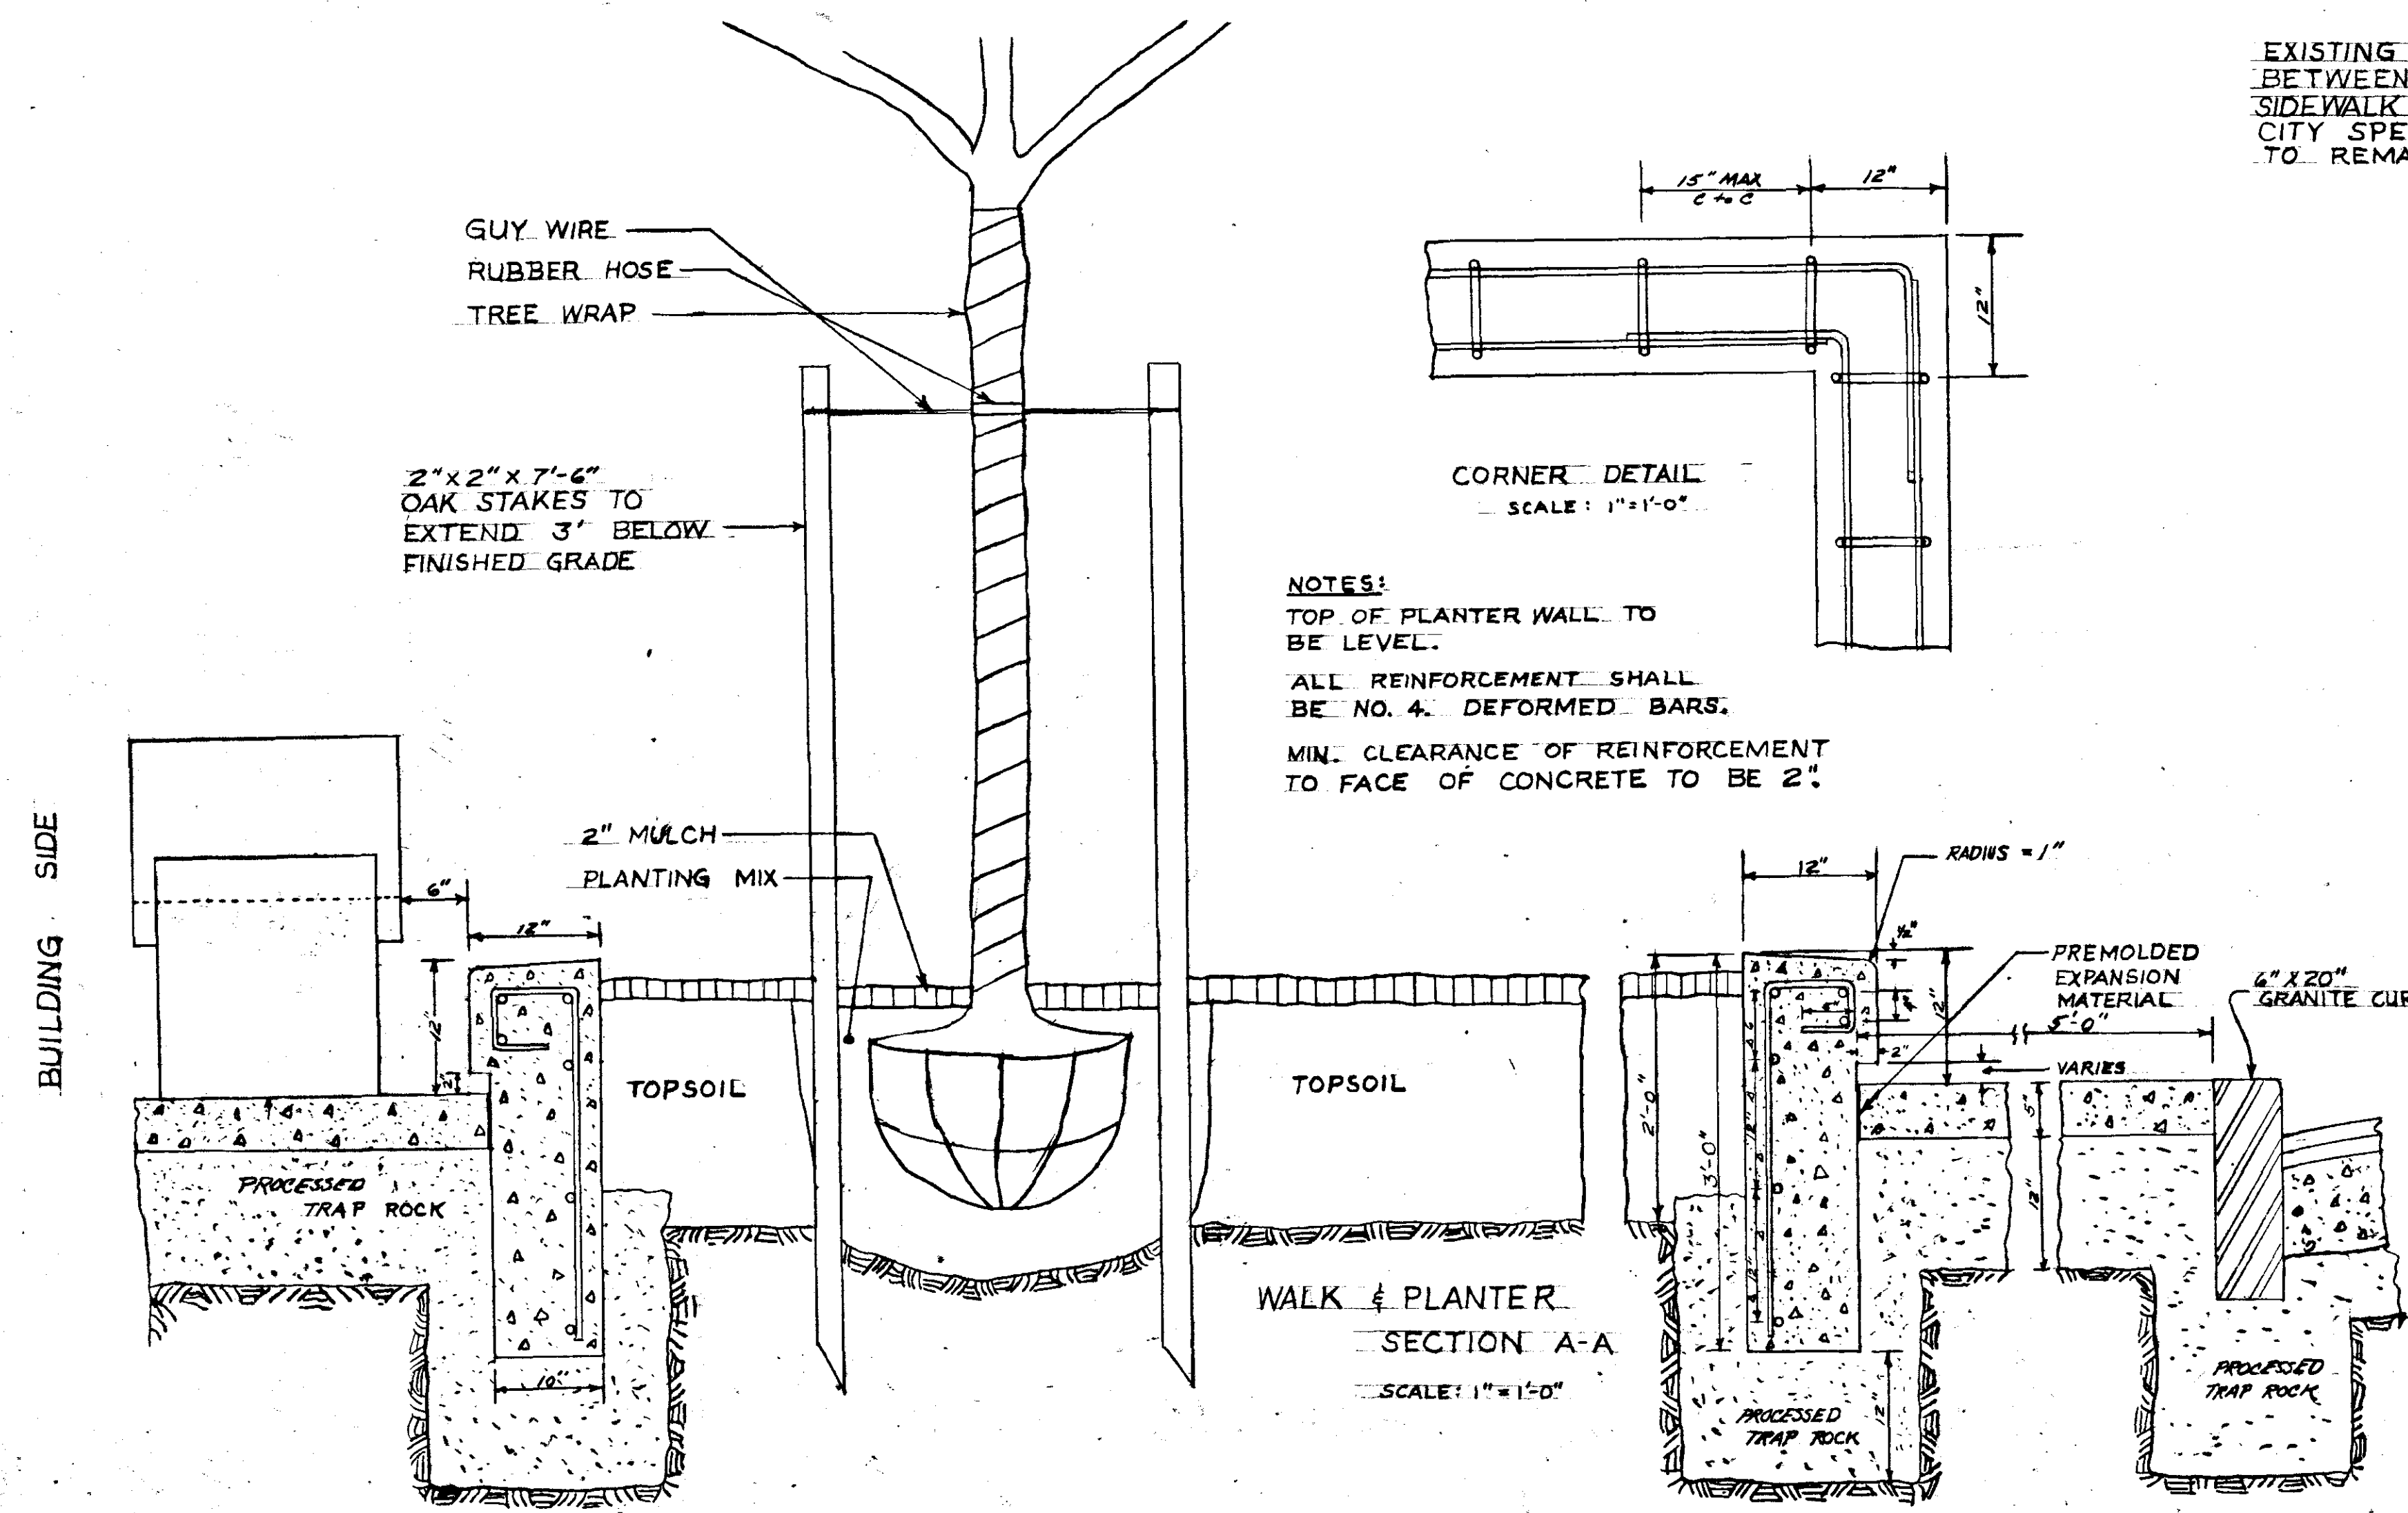


**TRANSVERSE JOINTS**  
PLACE 24" DOWELS  
2' ON CENTER MIN  
1' FROM EDGE

**LONGITUDINAL JOINTS**  
PLACE 12" DOWELS  
2' ON CENTER

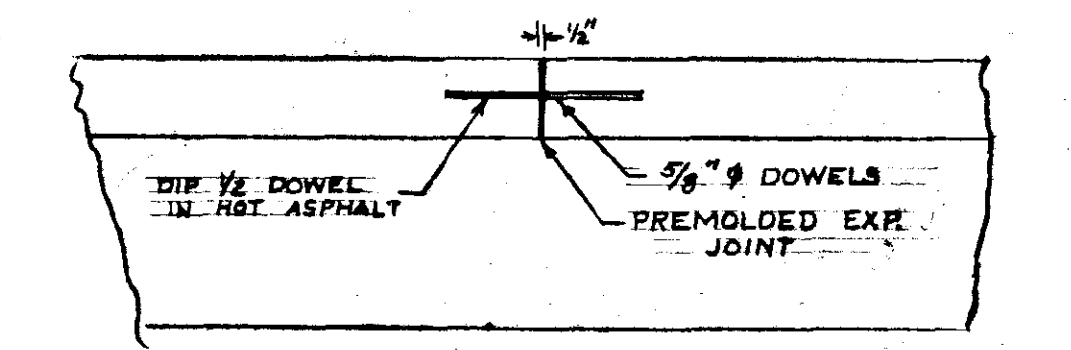

SEAL EXPANSION JOINT WITH GRAY COLORED THOROSPAN HEAVY AS MANUFACTURED BY STANDARD DRY WALL PRODUCTS INC. AND INSTALLED AS SPECIFIED AT RIGHT.

1" DIAMETER, 24" LONG DOWELS (THREE PER JOINT SPACED AS SHOWN)

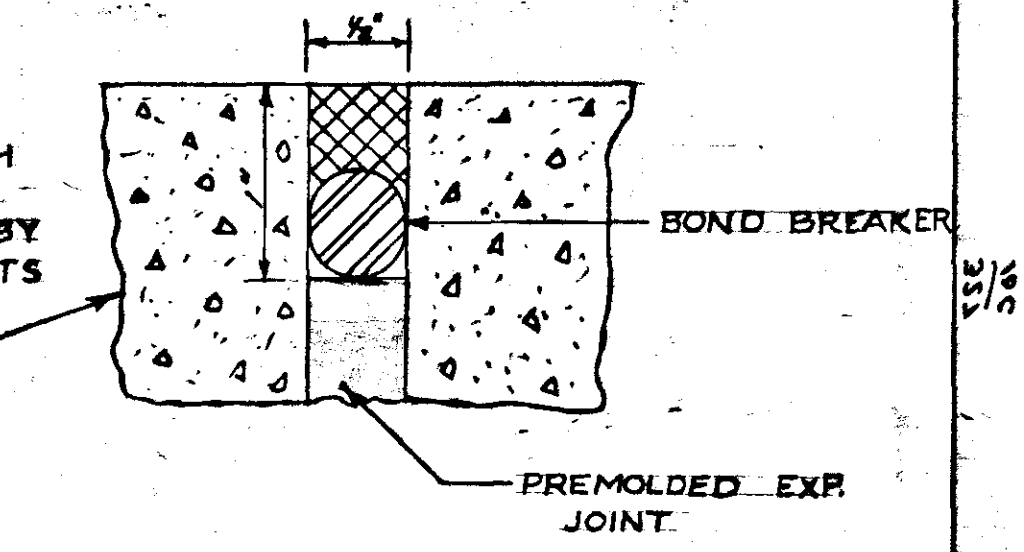

**NOTE:**  
ALL CONCRETE SHALL HAVE A COMPRESSIVE STRENGTH OF 4000 P.S.I. AT 28 DAYS AND BE AN APPROVED CITY OF HARTFORD SIDE WALK CONCRETE MIX.

|                                                                                               |                     |                                      |
|-----------------------------------------------------------------------------------------------|---------------------|--------------------------------------|
| CITY OF HARTFORD, CONNECTICUT<br>DEPARTMENT OF PUBLIC WORKS<br>BUREAU OF ENGINEERING SERVICES |                     |                                      |
| PUBLIC AREA IMPROVEMENTS<br>ALBANY AVE.                                                       |                     |                                      |
| SUBMITTED                                                                                     | RECOMMENDED         | APPROVED                             |
| DIVISION ENGINEER                                                                             | CHIEF OF ENG. SERV. | ASST. DIR. & CIV. ENG.               |
| DRAWN <i>WJW</i>                                                                              | SCALE AS NOTED      | DAYBOOK NO. 010554-C<br>SHEET 3 OF 3 |
| CHECKED                                                                                       |                     | DATE MARCH 1976                      |