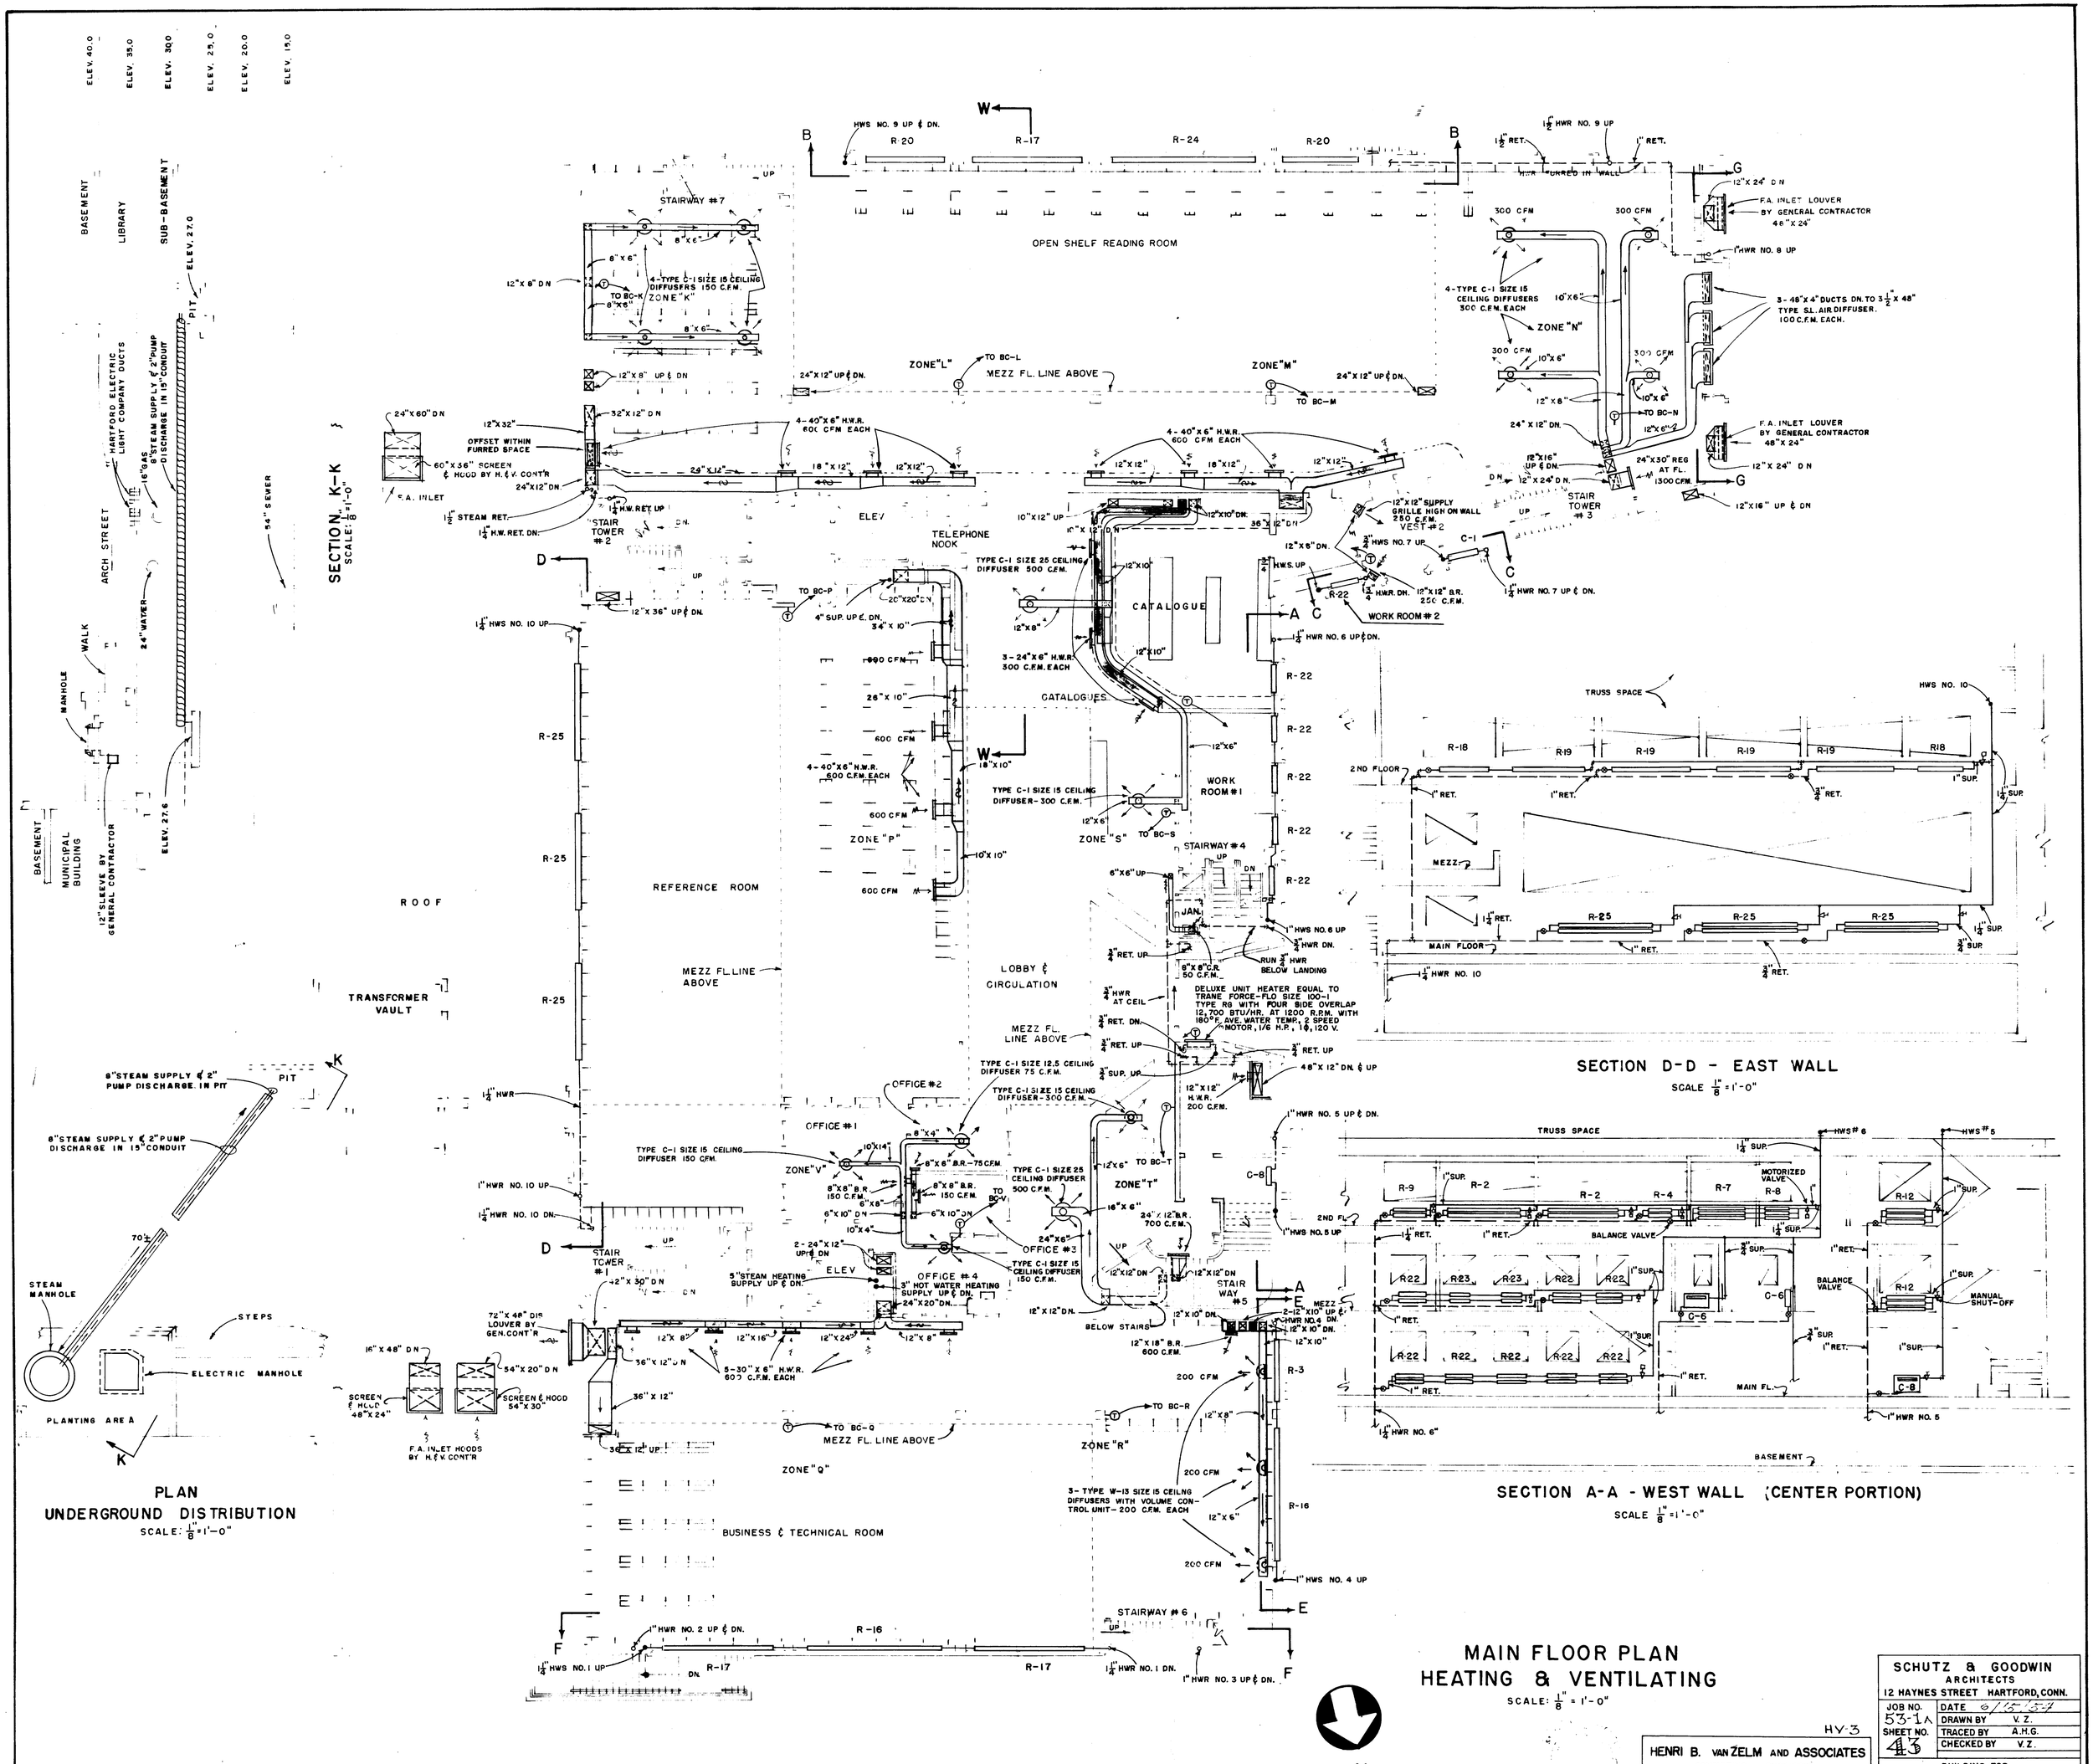
SECTION K-K
SCALE: 1/8" = 1'-0"
ELEV. 40.0
ELEV. 35.0
ELEV. 30.0
ELEV. 25.0
ELEV. 20.0
ELEV. 15.0
BASEMENT
LIBRARY
SUB-BASEMENT
ELEV. 27.0
PIT
HARTFORD ELECTRIC LIGHT COMPANY DUCTS
16" GAS
8" STEAM SUPPLY & 2" PUMP DISCHARGE IN 15" CONDUIT
ARCH STREET
24" WATER
54" SEWER
WALK
MANHOLE
BASEMENT
MUNICIPAL BUILDING
12" SLEEVE BY GENERAL CONTRACTOR
ELEV. 27.6
ROOF
TRANSFORMER VAULT
PLAN
UNDERGROUND DISTRIBUTION
SCALE: 1/8" = 1'-0"
8" STEAM SUPPLY & 2" PUMP DISCHARGE IN PIT
8" STEAM SUPPLY & 2" PUMP DISCHARGE IN 15" CONDUIT
STEAM MANHOLE
ELECTRIC MANHOLE
STEPS
PLANTING AREA
OPEN SHELF READING ROOM
STAIRWAY #7
4-TYPE C-1 SIZE 15 CEILING DIFFUSERS 150 C.F.M.
ZONE "K"
ZONE "L"
ZONE "M"
MEZZ FL. LINE ABOVE
4-40" X 6" H.W.R. 600 C.F.M. EACH
F.A. INLET
STAIR TOWER #2
ELEV
TELEPHONE NOOK
CATALOGUE
CATALOGUES
WORK ROOM #1
WORK ROOM #2
VEST #2
STAIR TOWER #3
F.A. INLET LOUVER BY GENERAL CONTRACTOR 48" X 24"
12" X 24" D.N.
12" X 16" UP & DN
REFERENCE ROOM
ZONE "P"
ZONE "S"
STAIRWAY #4
JAN.
LOBBY & CIRCULATION
DELUXE UNIT HEATER EQUAL TO TRANE FORCE-FLO SIZE 100-1 TYPE RG WITH FOUR SIDE OVERLAP 12,700 BTU/HR. AT 1200 R.P.M. WITH 180° F. AVE. WATER TEMP., 2 SPEED MOTOR, 1/6 H.P., 1Φ, 120 V.
OFFICE #1
OFFICE #2
OFFICE #3
OFFICE #4
ZONE "V"
ZONE "T"
ZONE "Q"
ZONE "R"
STAIRWAY #5
STAIRWAY #6
BUSINESS & TECHNICAL ROOM
BELOW STAIRS
MEZZ FL. LINE ABOVE
SECTION D-D - EAST WALL
SCALE 1/8" = 1'-0"
TRUSS SPACE
2ND FLOOR
MEZZ.
MAIN FLOOR
SECTION A-A - WEST WALL (CENTER PORTION)
SCALE 1/8" = 1'-0"
MAIN FLOOR PLAN
HEATING & VENTILATING
SCALE: 1/8" = 1'-0"
N
HENRI B. VAN ZELM AND ASSOCIATES
CONSULTING ENGINEERS
197 ASYLUM STREET
HARTFORD, CONNECTICUT
SCHUTZ & GOODWIN
ARCHITECTS
12 HAYNES STREET HARTFORD, CONN.
JOB NO. 53-1A
SHEET NO. 43
DATE 6/15/54
DRAWN BY V.Z.
TRACED BY A.H.G.
CHECKED BY V.Z.
BUILDING FOR
THE HARTFORD PUBLIC LIBRARY
CITY OF HARTFORD - OWNER
HV-3