



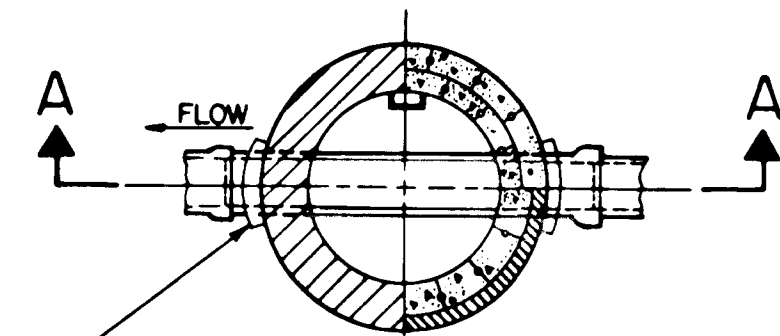

SECTION C-C

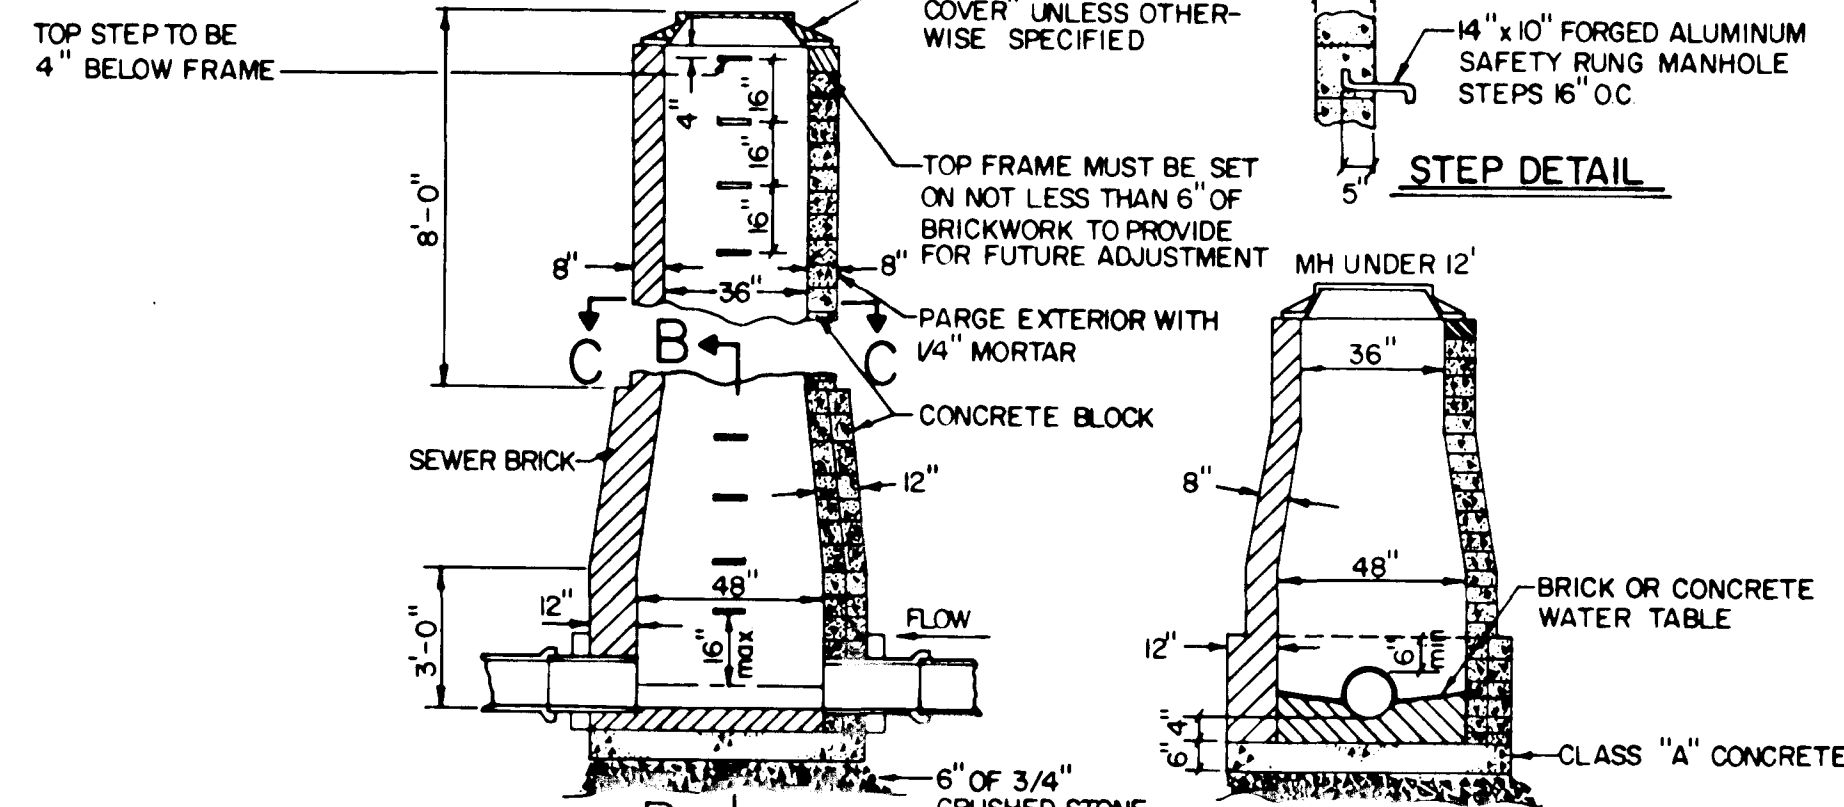


SECTION A-A


SECTION B-B

CONCRETE BLOCK DETAIL


TYPE 1 MANHOLE

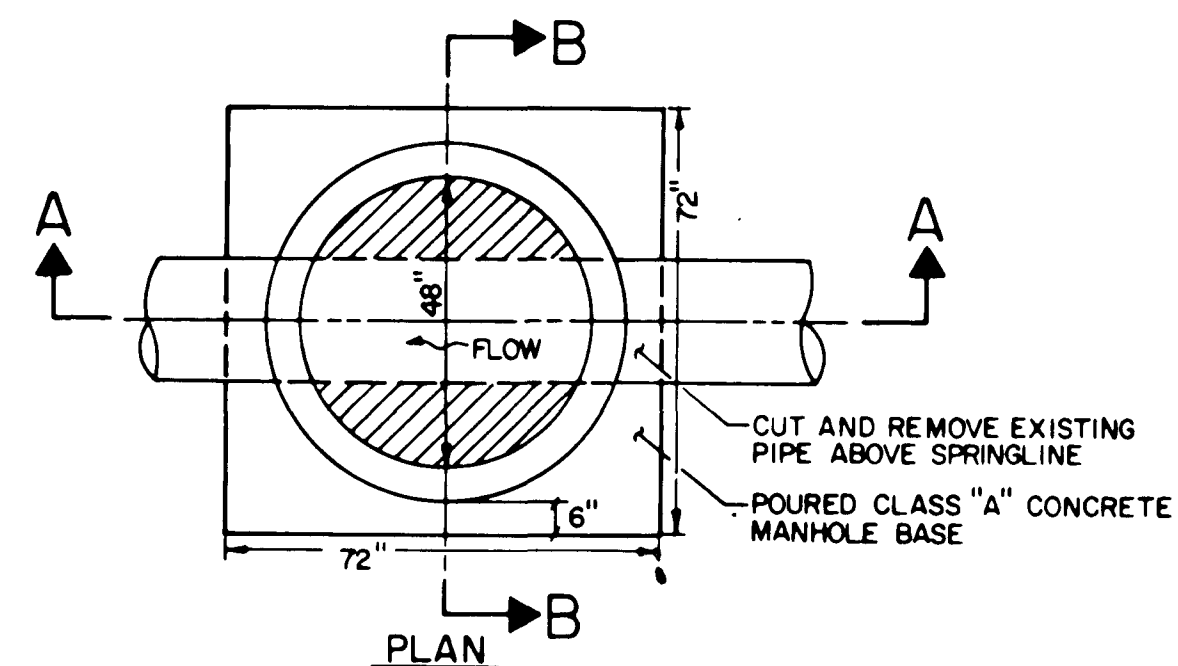

SPECIAL MANHOLE DETAIL

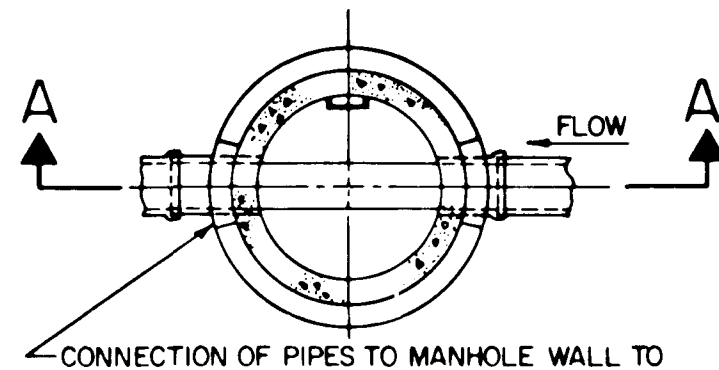

SECTION C-C

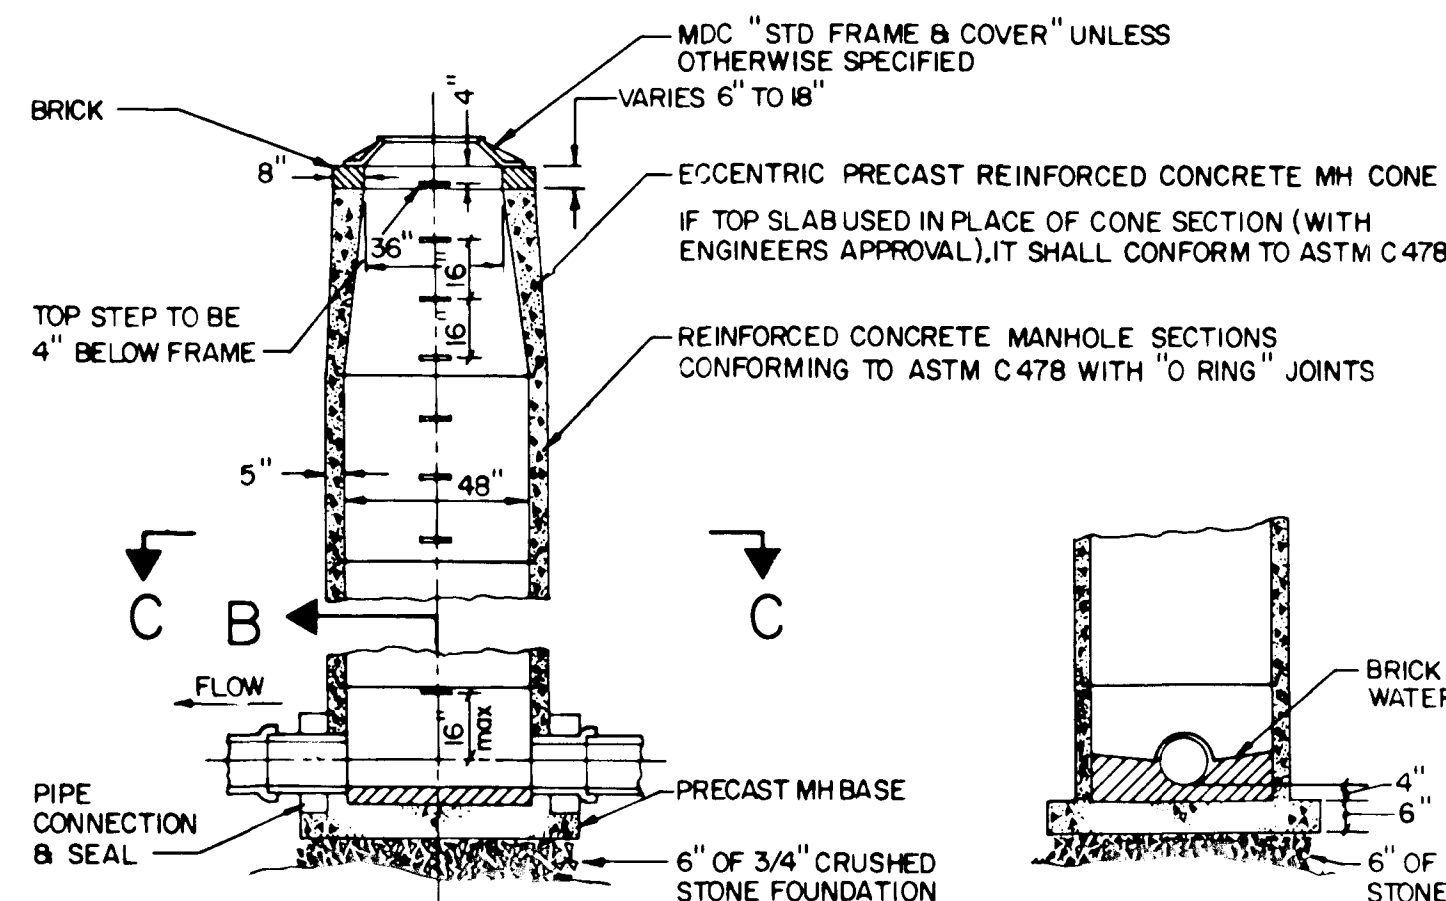


SECTION A-A

SECTION B-B


- MAXIMUM SIZE OF PIPE TO BE INSTALLED IN A TYPE 2 MANHOLE TO BE 18"
- MAXIMUM DEPTH OF RC PIPE MANHOLES WITH 5" THICK WALL IS 30 FT
- RUBBER GASKETS USED FOR "O-RING" JOINTS SHALL CONFORM TO ASTM SPEC C443
- ALL PRECAST MANHOLE BASES SHALL COMPLY WITH THE "MINIMUM REQUIREMENTS FOR 48" DIAMETER PRECAST MANHOLE BASE"

TYPE 2 MANHOLE


TYPICAL PRECAST MANHOLE

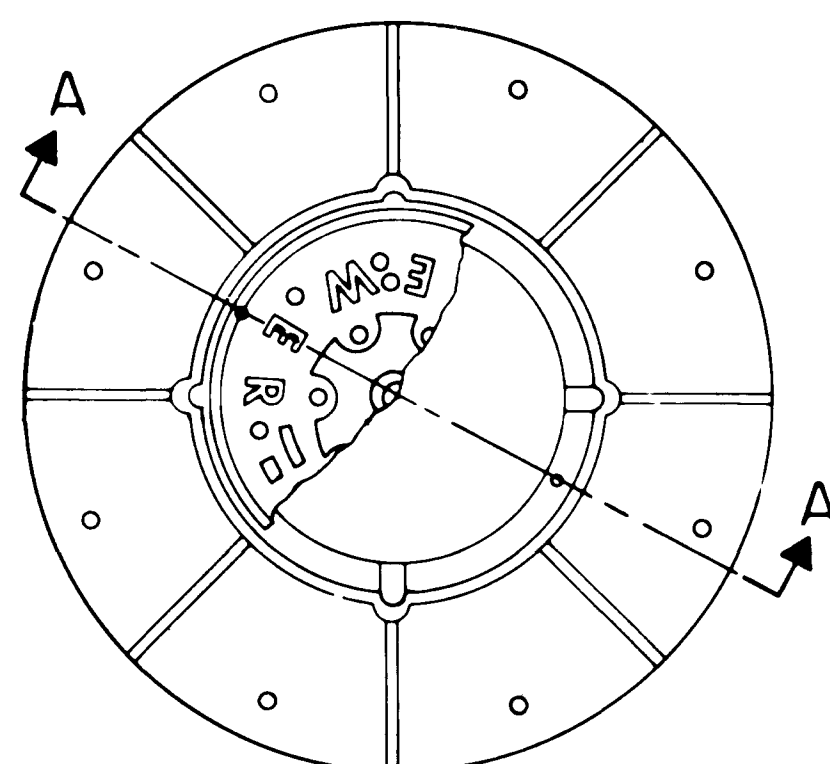

DETAIL AS SHOWN IS FOR STANDARD FRAME & COVER SERIAL NO 12321, OR SPECIAL FRAME & COVER SERIAL NO 12738A, AS REQUIRED IN CONTRACT

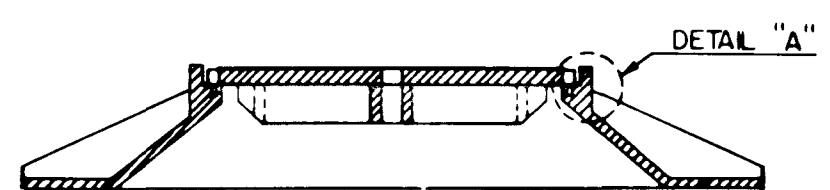


SECTION A-A

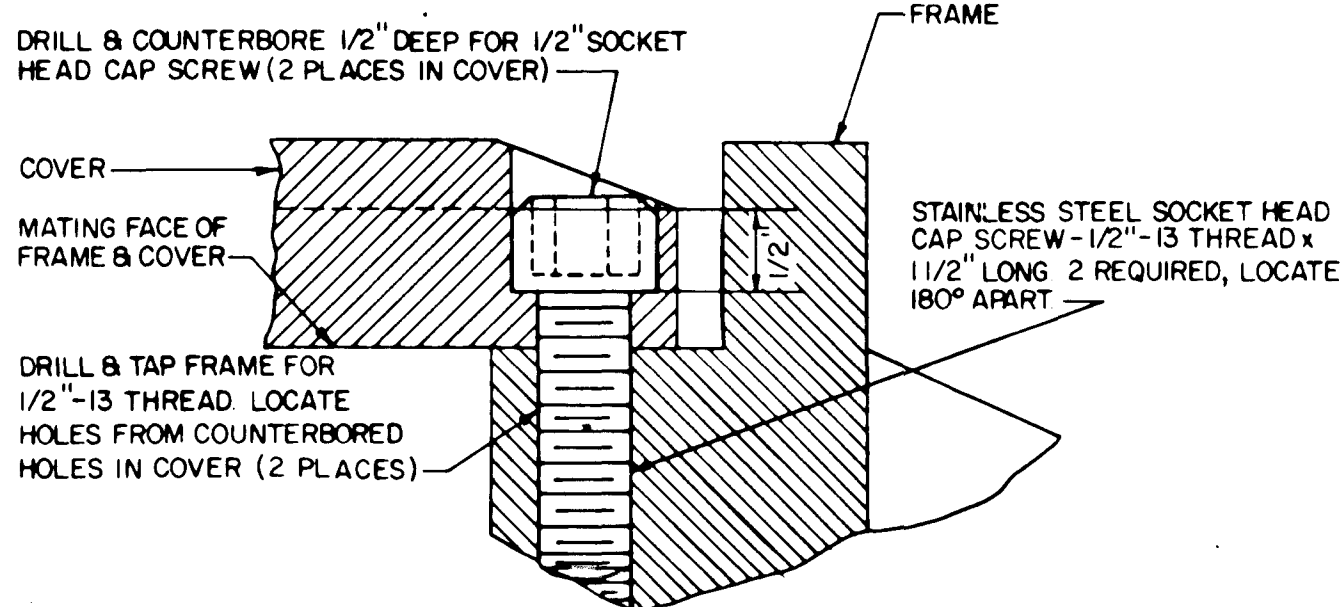


DETAIL "A"

SECURITY BOLTING OF MANHOLE COVER

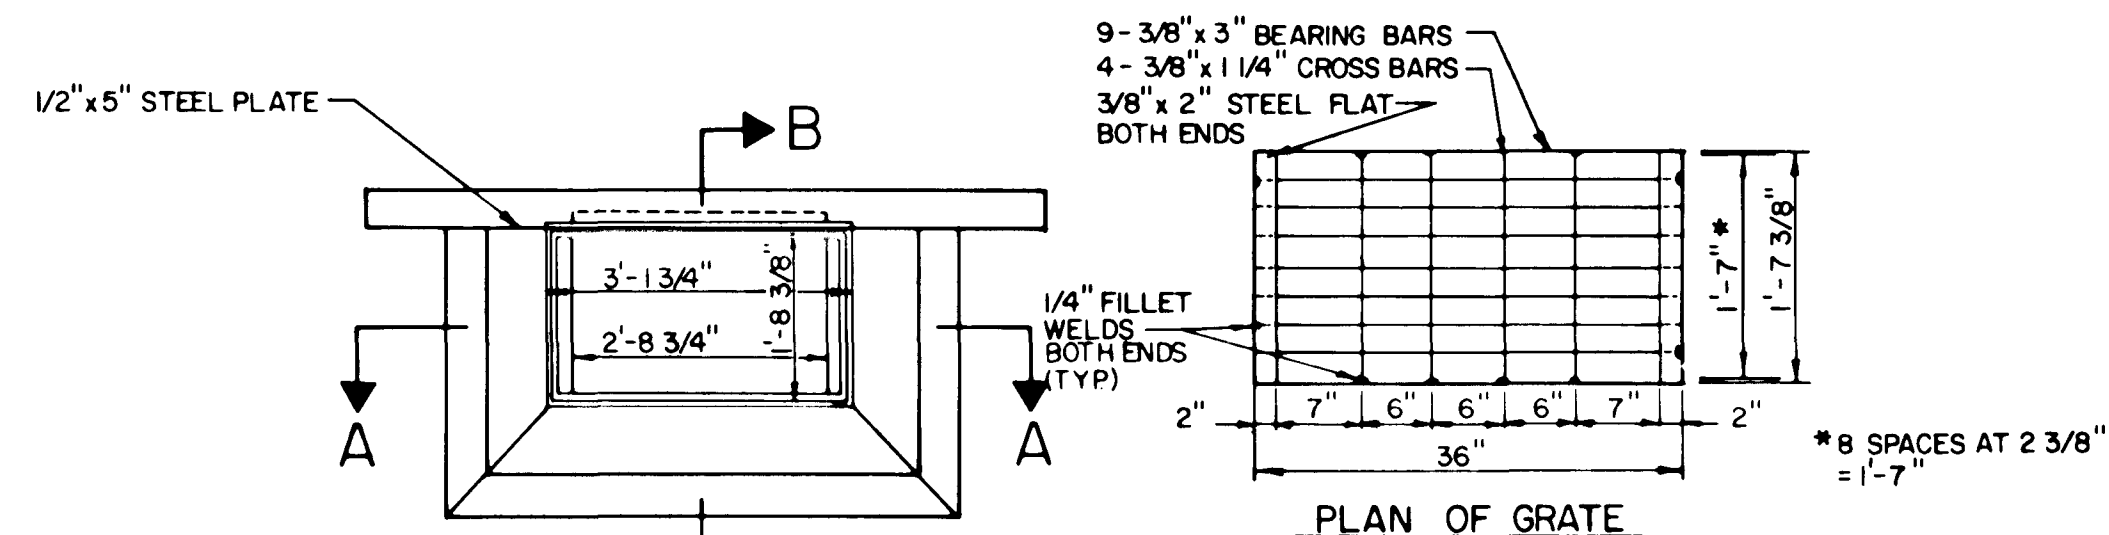

PLAN

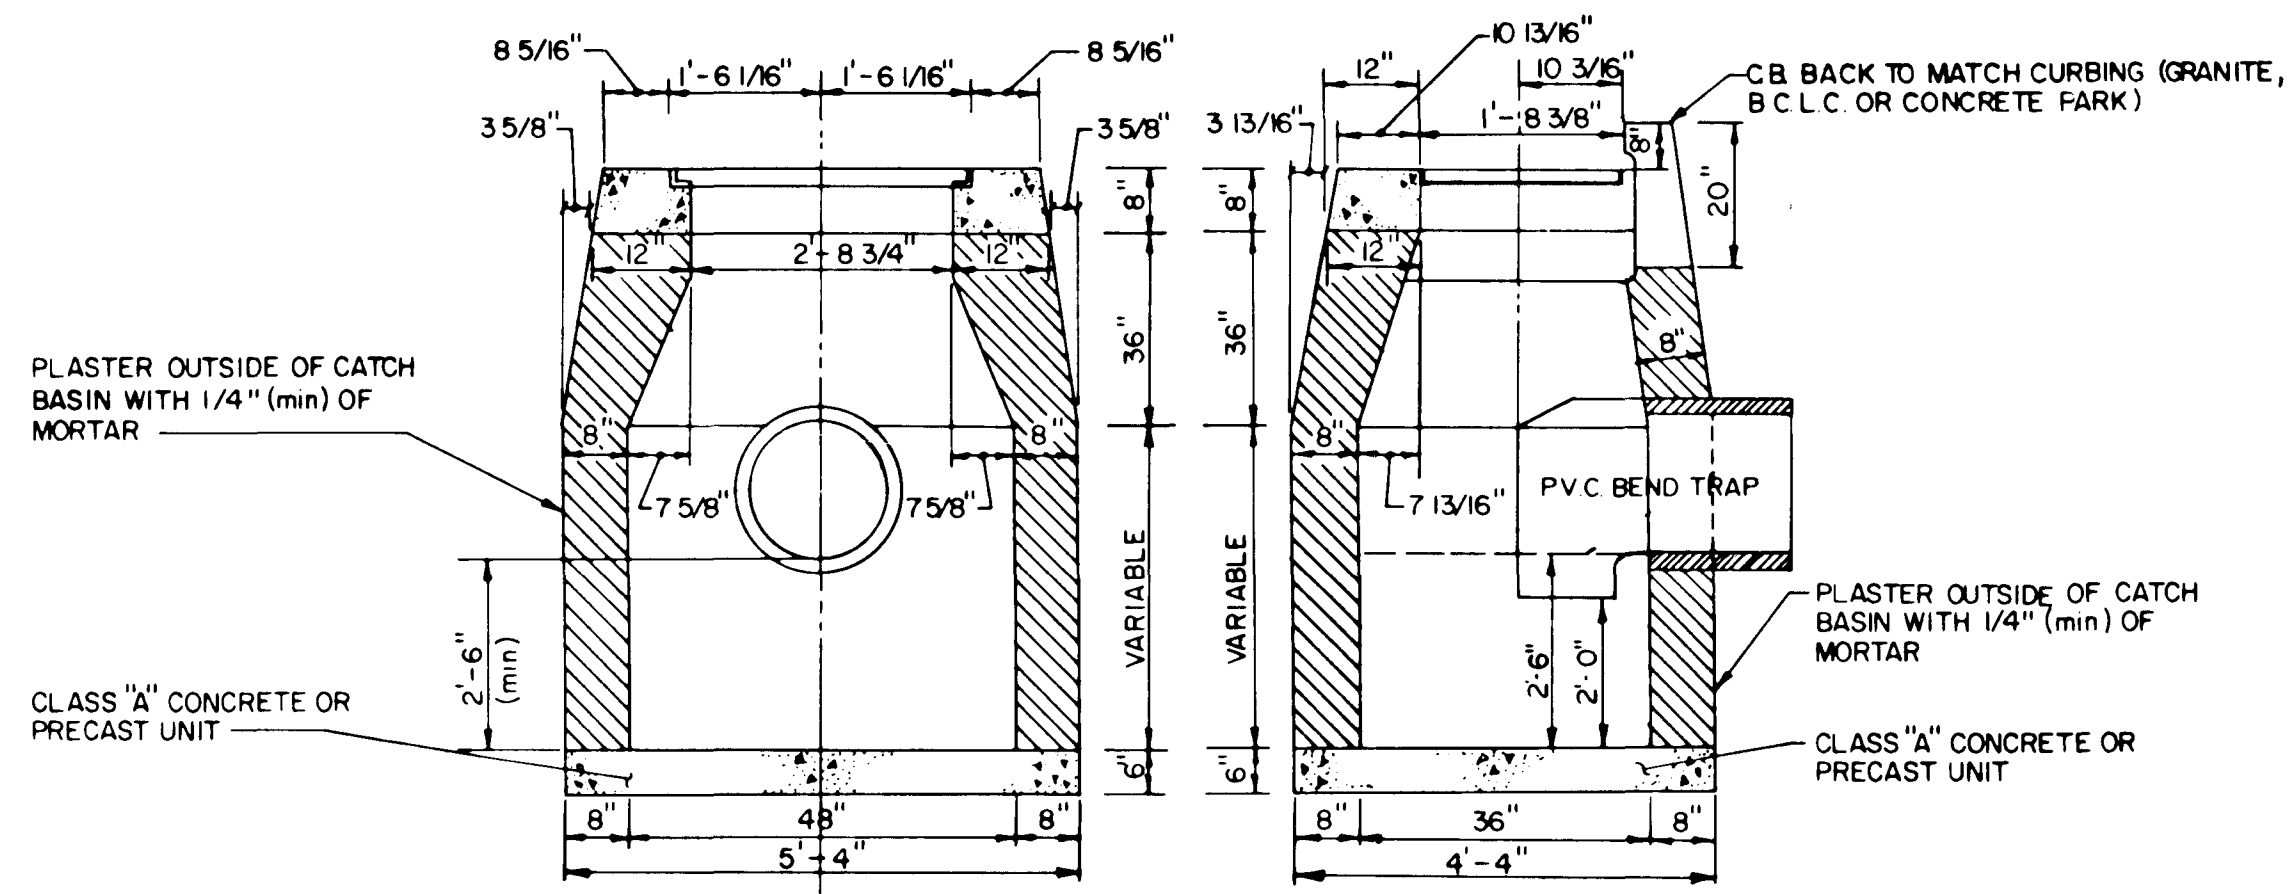


SECTION A-A


SECTION B-B

NOTE: SEE SEPARATE DETAIL FOR GRANITE CURB AND TYPE "C-L" CATCH BASIN INLETS

HARTFORD TYPE "C" CATCH BASIN INLETS

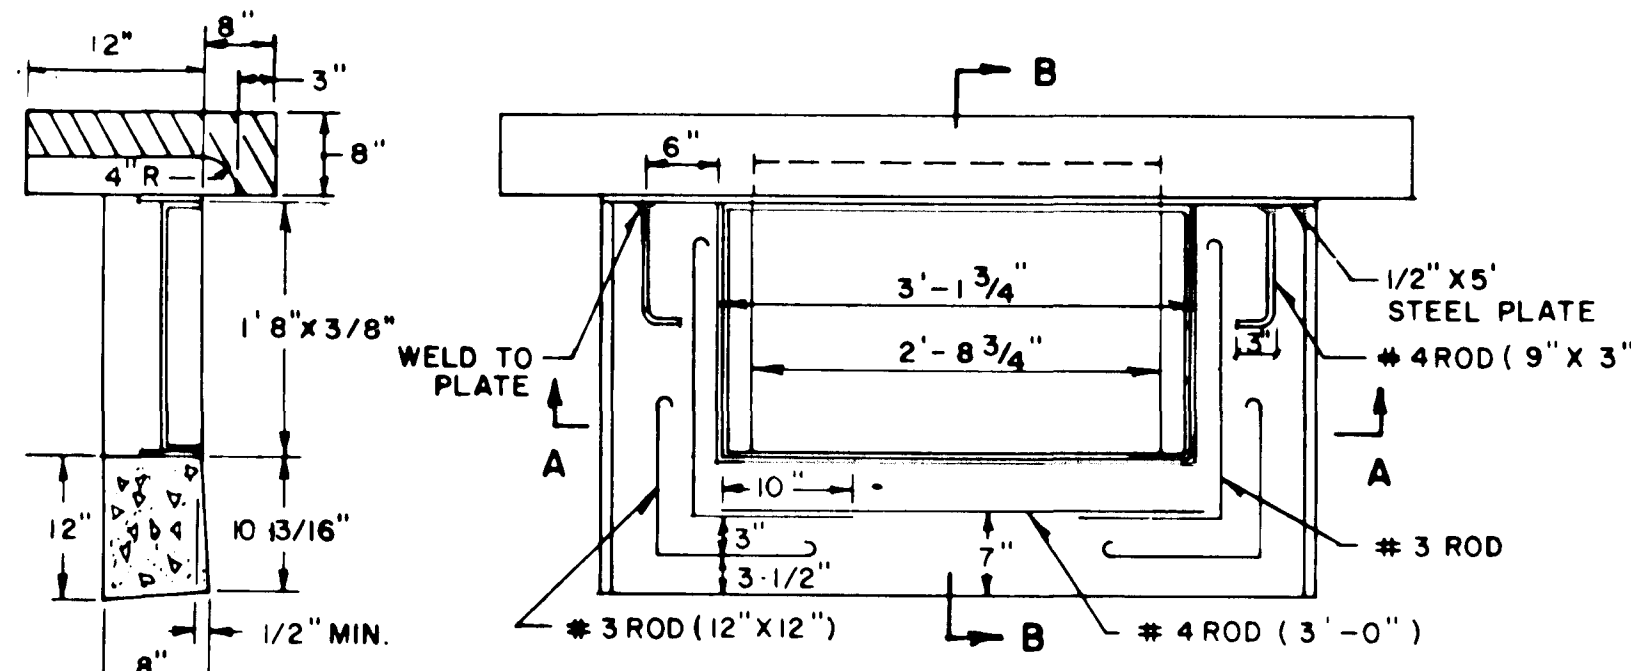

SECTION B-B

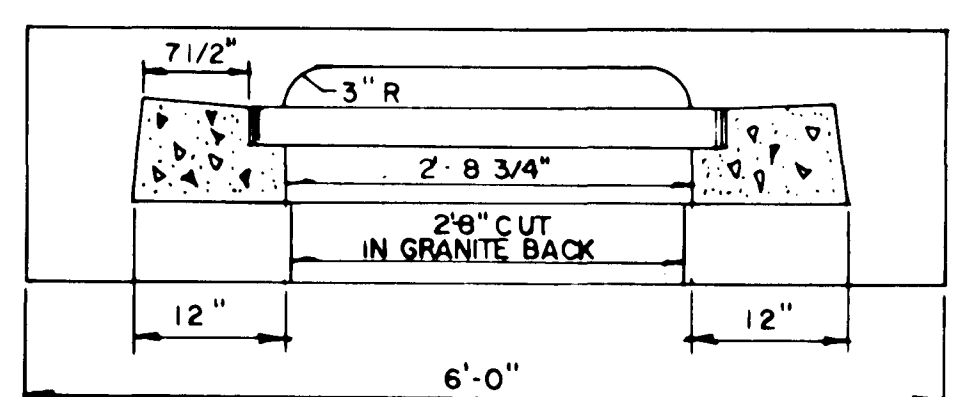

SECTION A-A

GRANITE CURB CATCH BASIN INLET

CONTRACT NO. E 88-07 AREA 11

MISCELLANEOUS DETAILS

THE CITY OF
HARTFORD, CONNECTICUT

PURCELL
ASSOCIATES

DESIGNED: A.M.	DATE: MARCH 23, 1988
DRAWN: T.N.S.	SCALE: N.T.S.
CHECKED: P.L.	
APPROVED: R.C.G.	

SHEET NO.
7 OF 48
DAY BOOK NO.
01113