

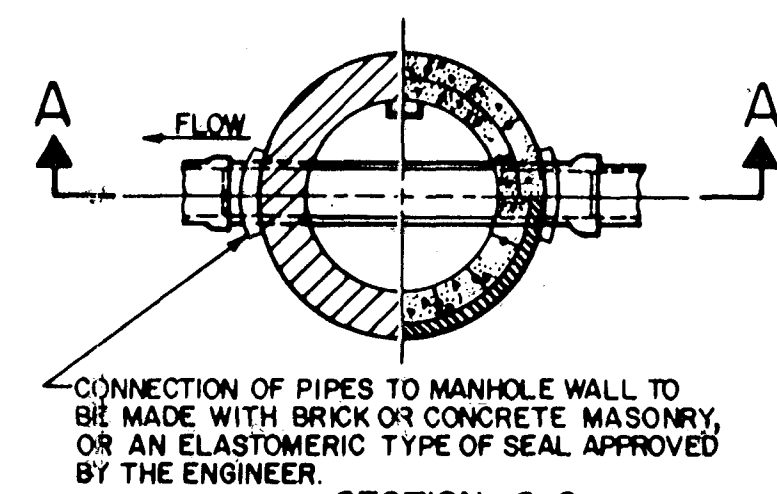


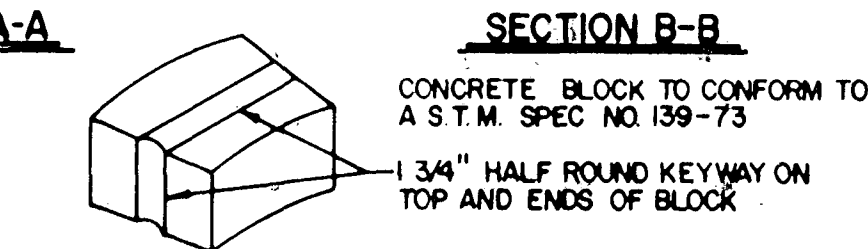


SECTION C-C

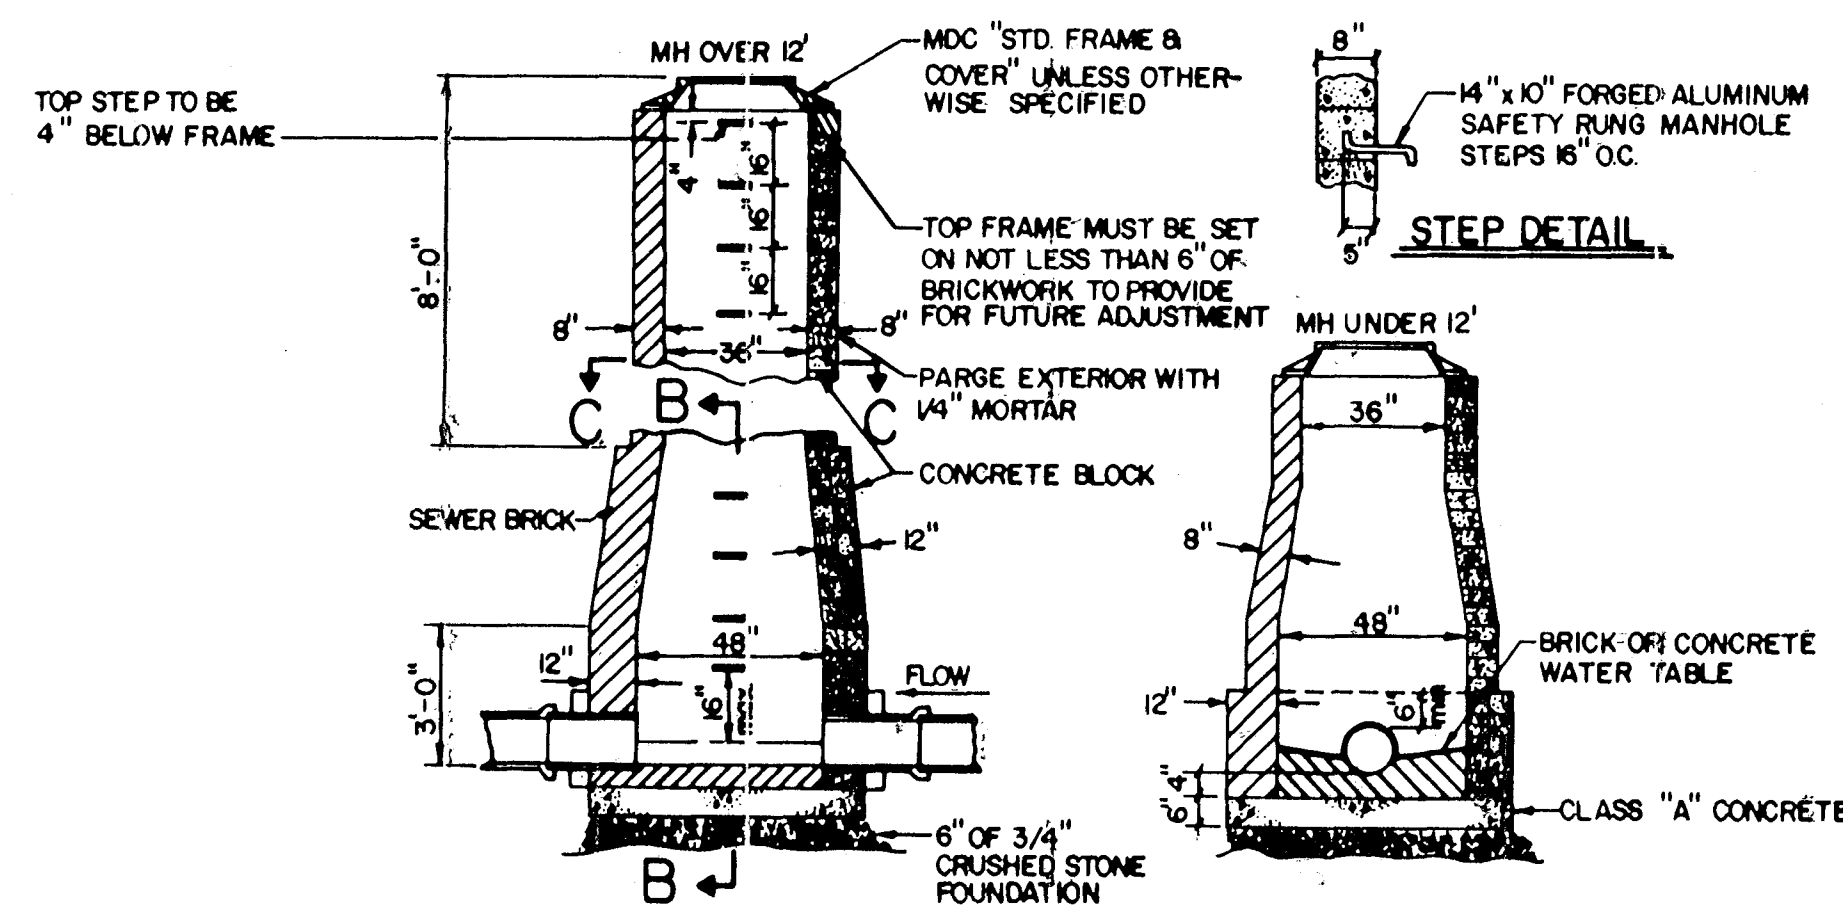


CONCRETE BLOCK DETAIL

TYPE 1 MANHOLE

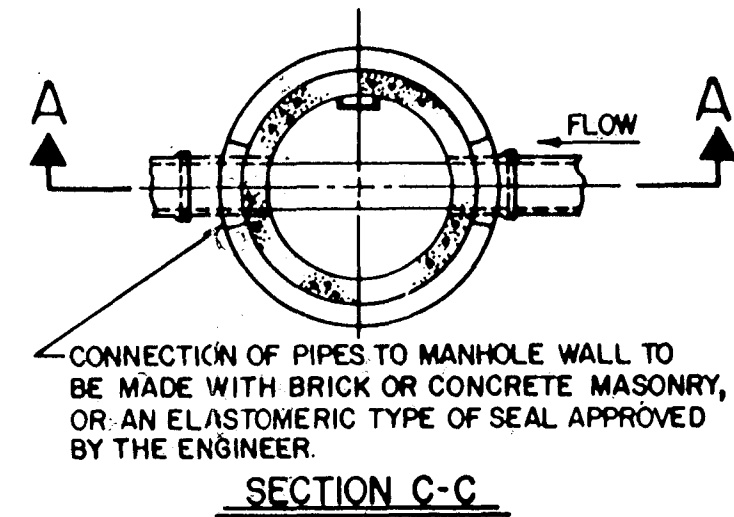


SECTION C-C

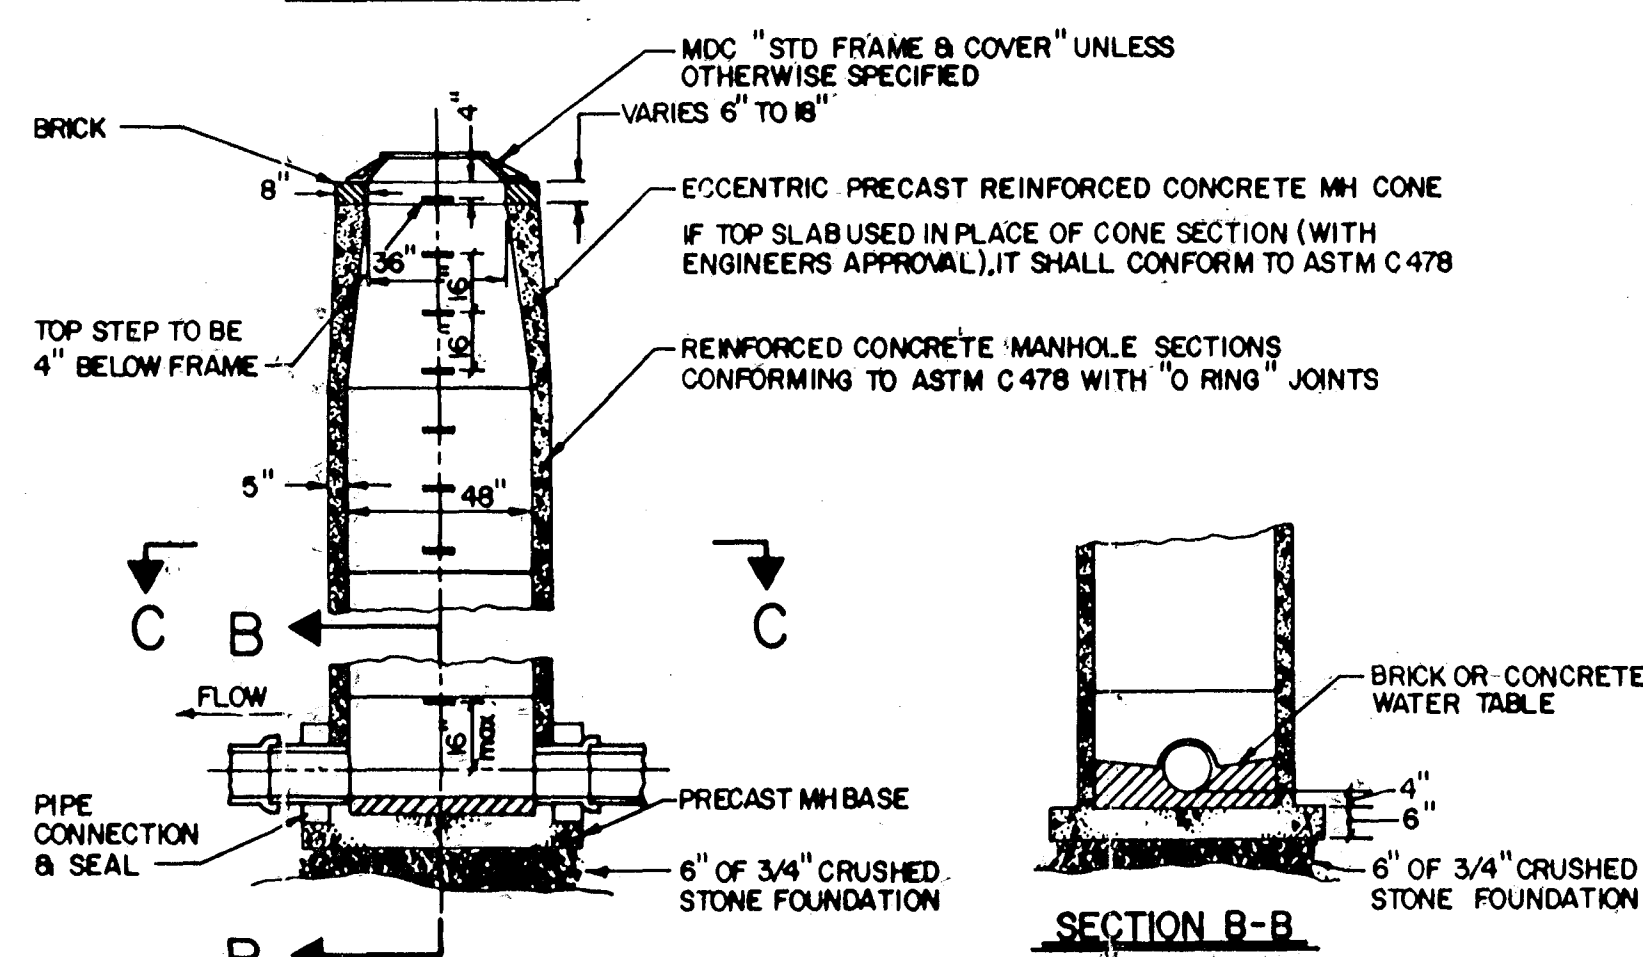


- MAXIMUM SIZE OF PIPE TO BE INSTALLED IN A TYPE 2 MANHOLE TO BE 18"
- MAXIMUM DEPTH OF R.C. PIPE MANHOLES WITH 5" THICK WALL IS 30 FT.
- RUBBER GASKETS USED FOR "O-RING" JOINTS SHALL CONFORM TO ASTM SPEC C443
- ALL PRECAST MANHOLE BASES SHALL COMPLY WITH THE MINIMUM REQUIREMENTS FOR 48" DIAMETER PRECAST MANHOLE BASE

TYPE 2 MANHOLE
TYPICAL PRECAST MANHOLE

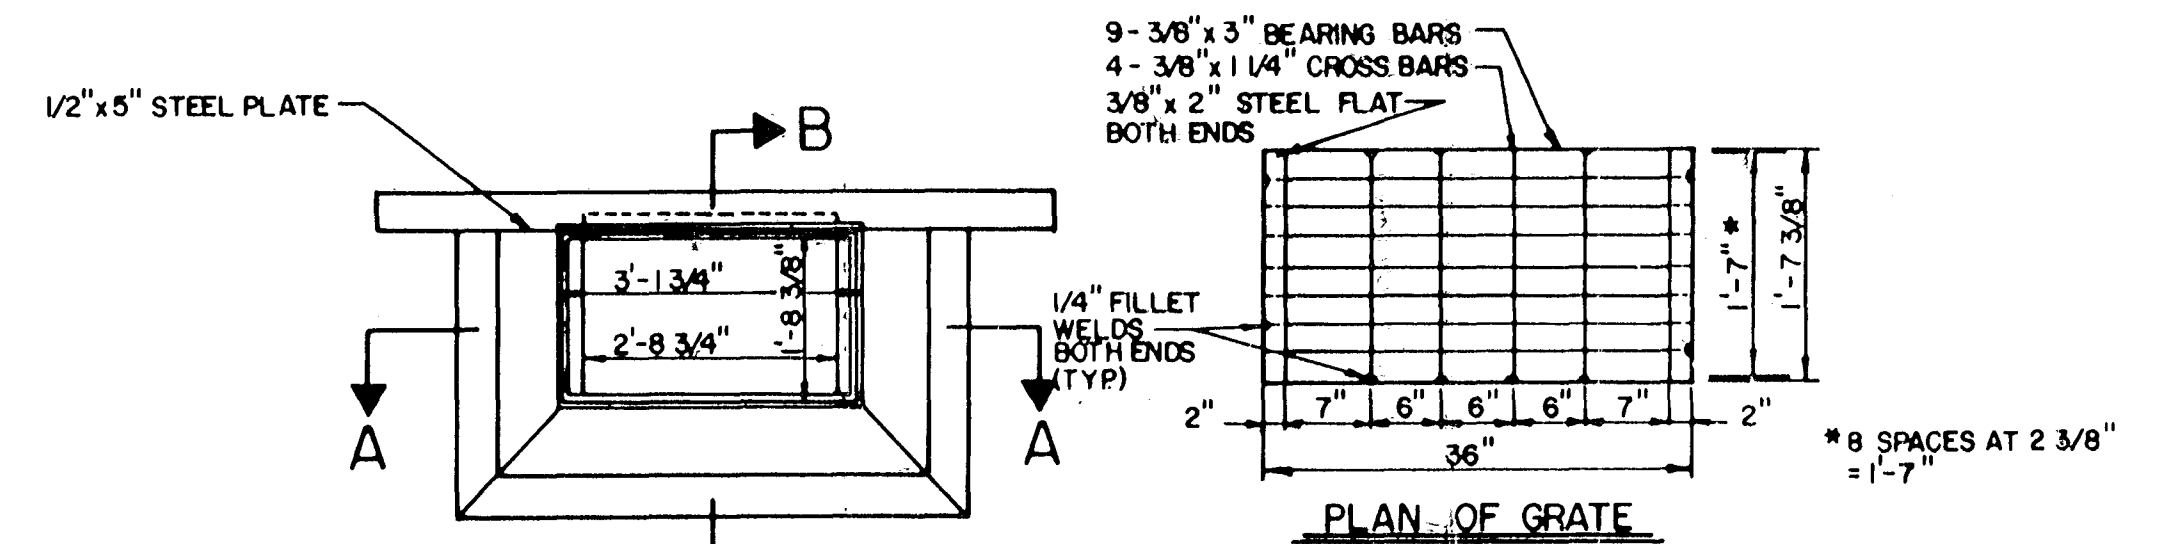

PLAN


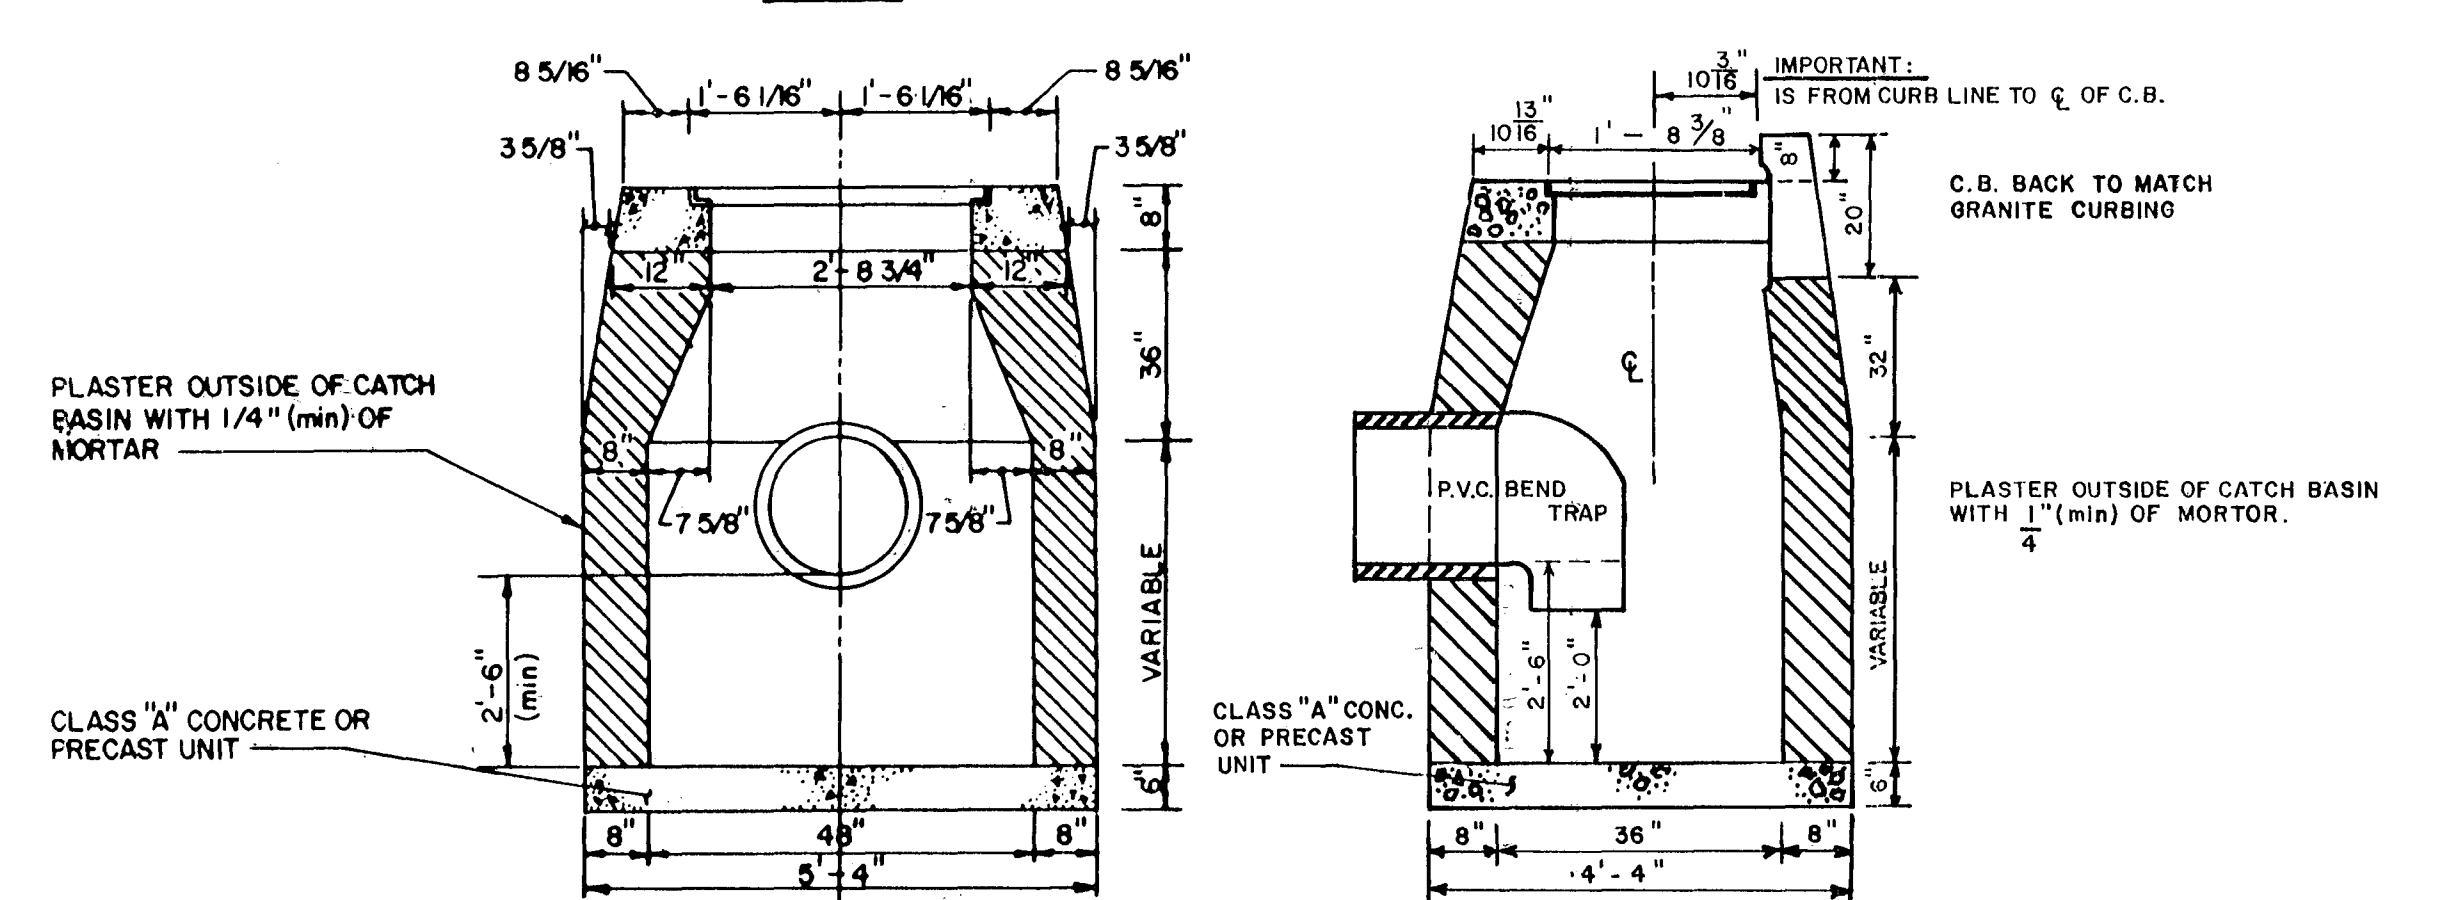


SECTION A-A


SECTION B-B

NOTE: SEE SEPARATE DETAIL FOR GRANITE CURB AND TYPE "C-L" CATCH BASIN INLETS

HARTFORD TYPE "C" CATCH BASIN INLETS

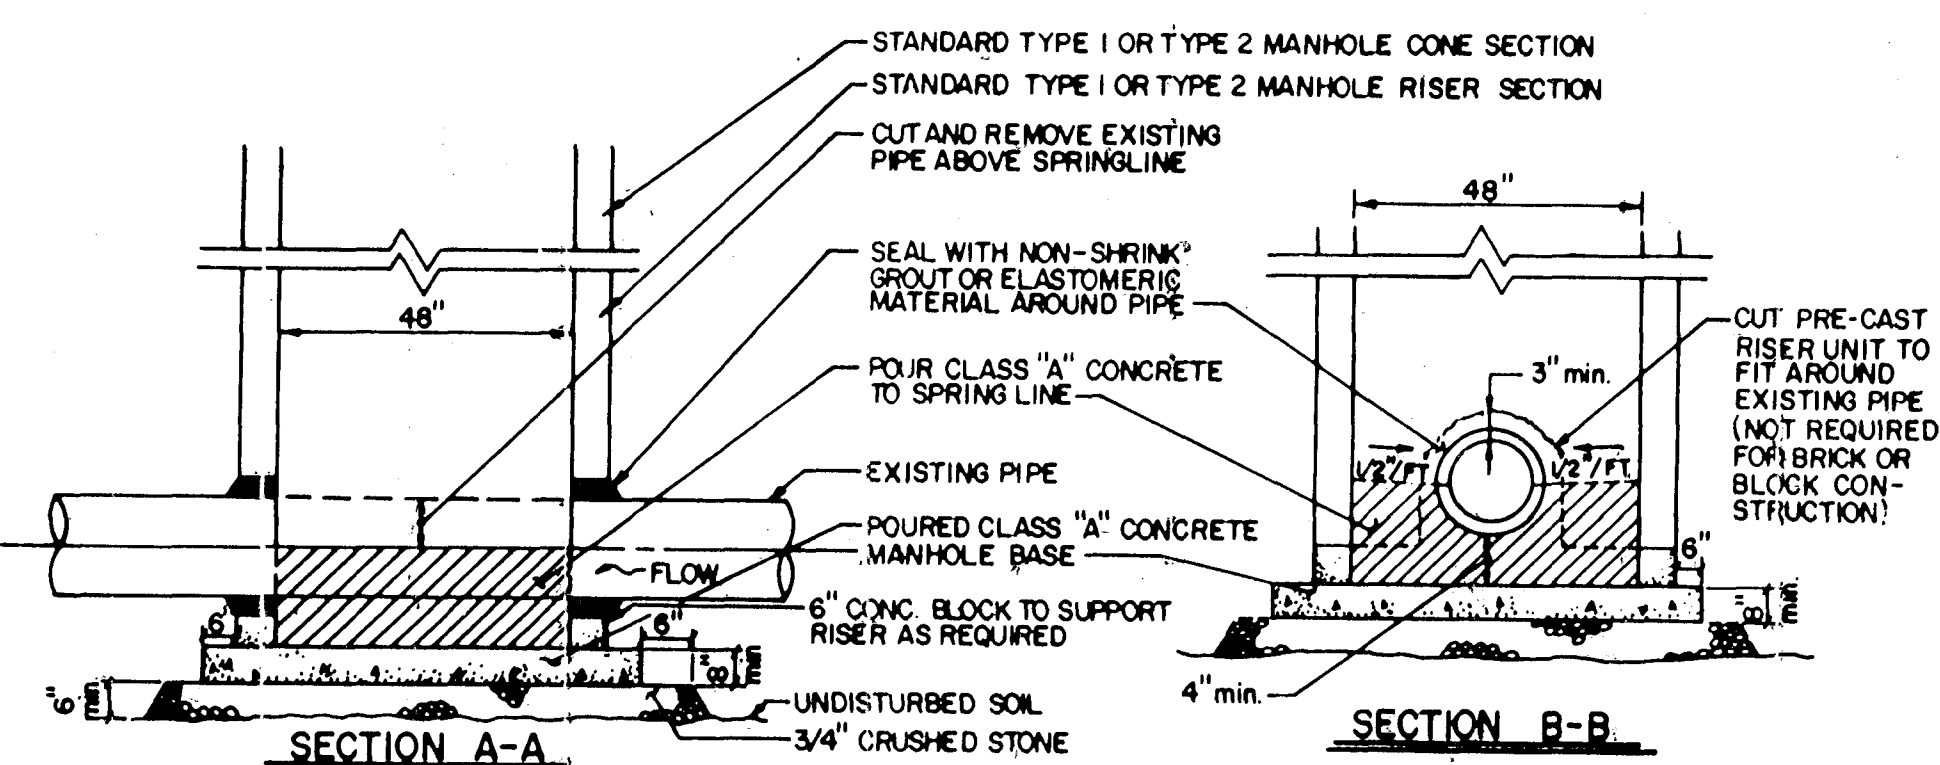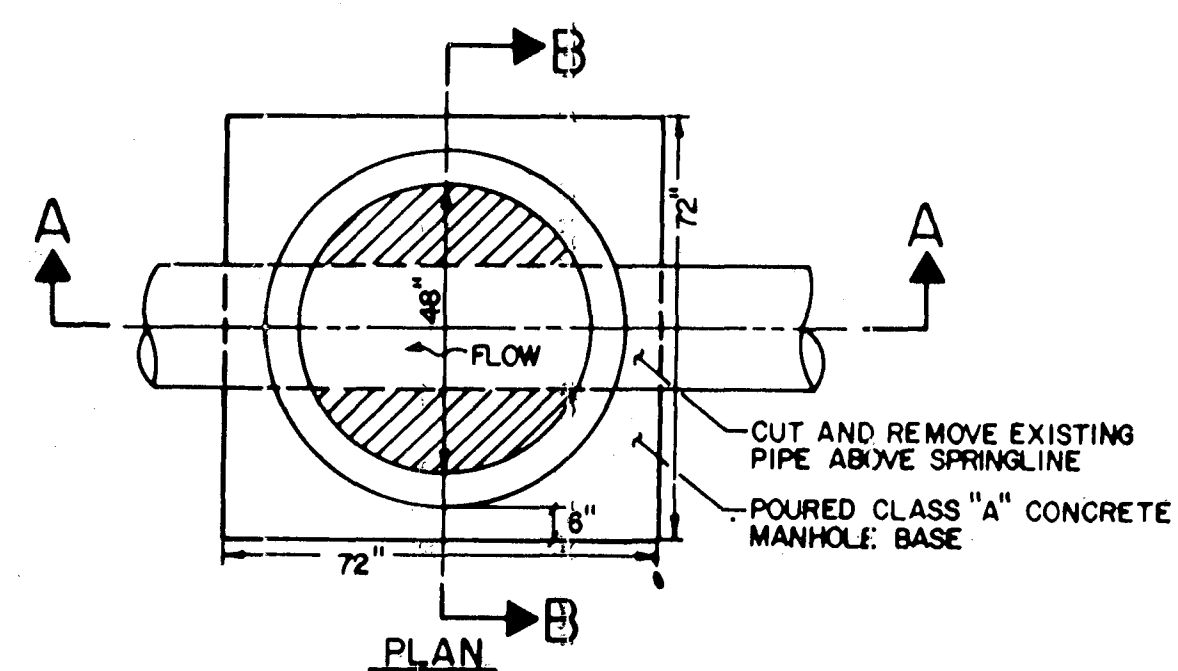

SPECIAL MANHOLE DETAIL

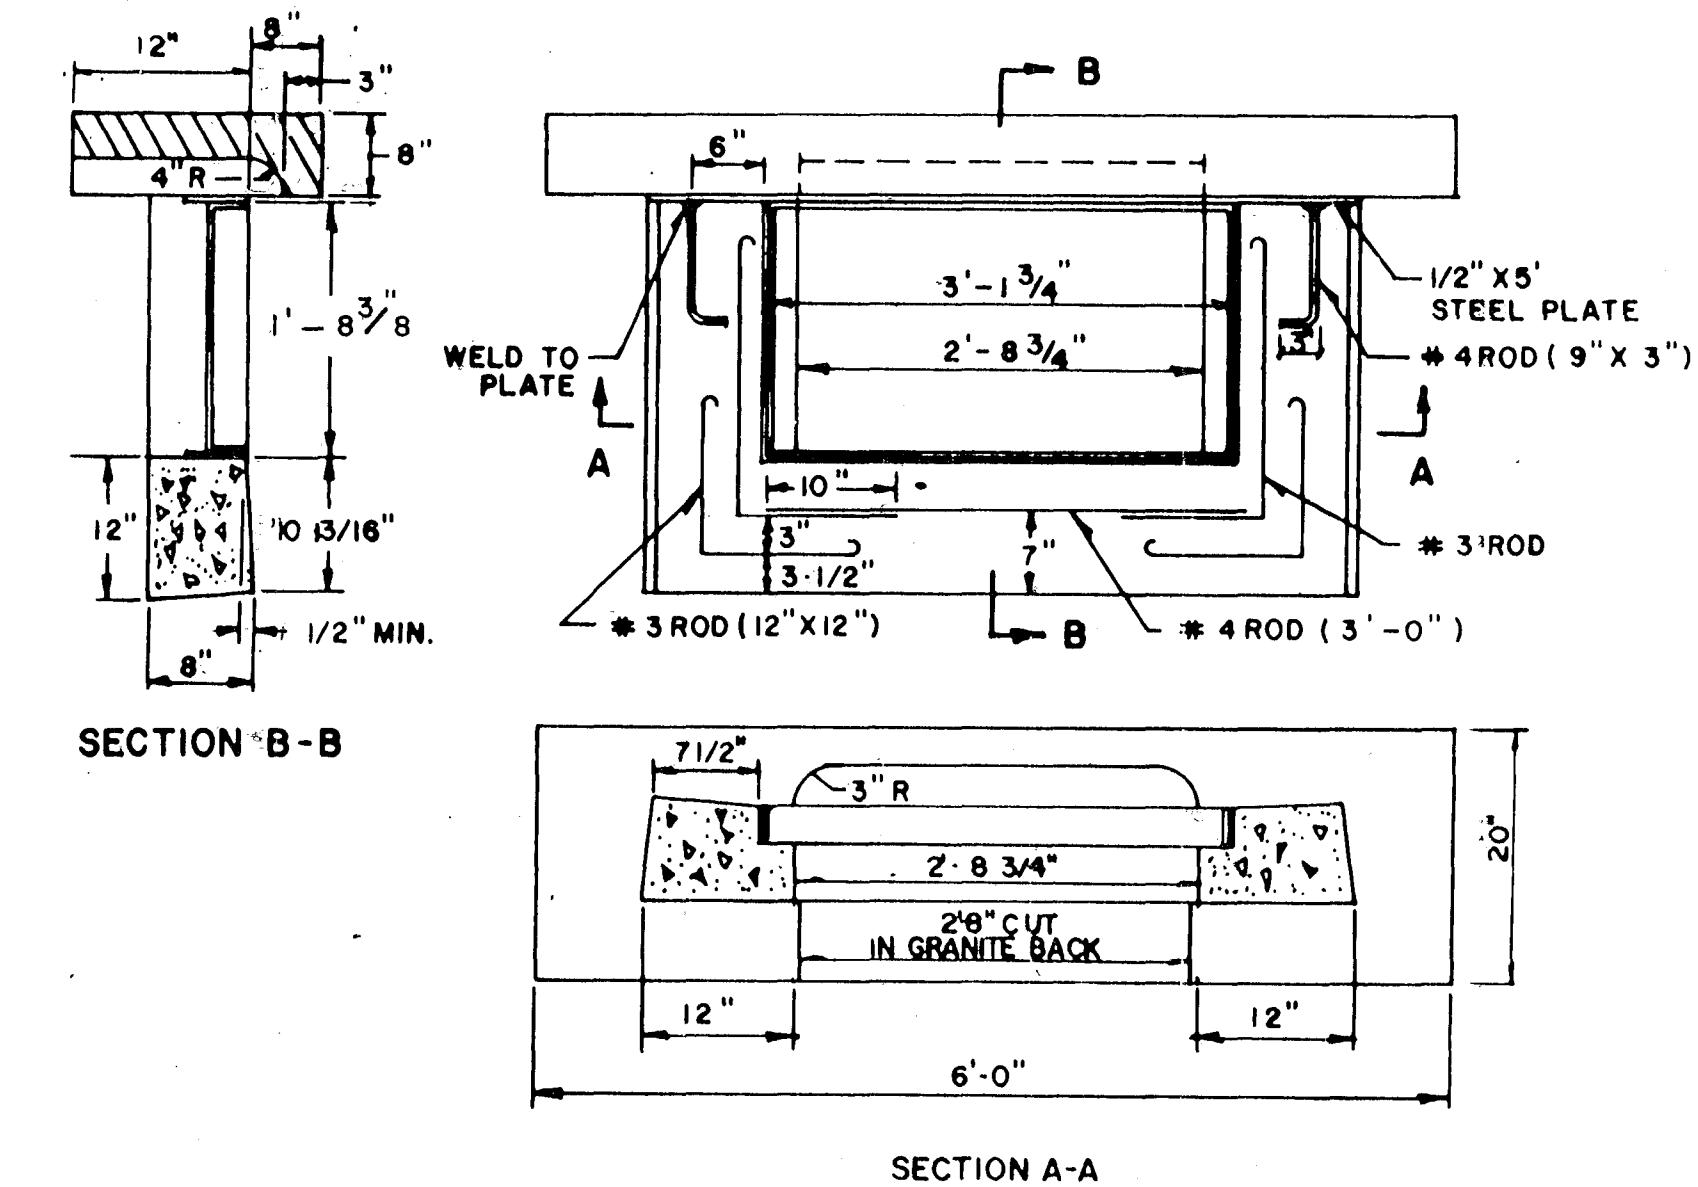

GRANITE CURB CATCH BASIN INLET

CITY OF HARTFORD, CONNECTICUT DEPARTMENT OF PUBLIC WORKS BUREAU OF ENGINEERING SERVICES		
STANDARD DETAILS SHEET III		
SUBMITTED PROJECT ENGINEER John J. Bartoli	RECOMMENDED APPROVED CITY ENGINEER William R. Reed	APPROVED DATE NOVEMBER 1989
SHEET 6 OF 12	SCALE NOT TO SCALE	DAYBOOK NO.