


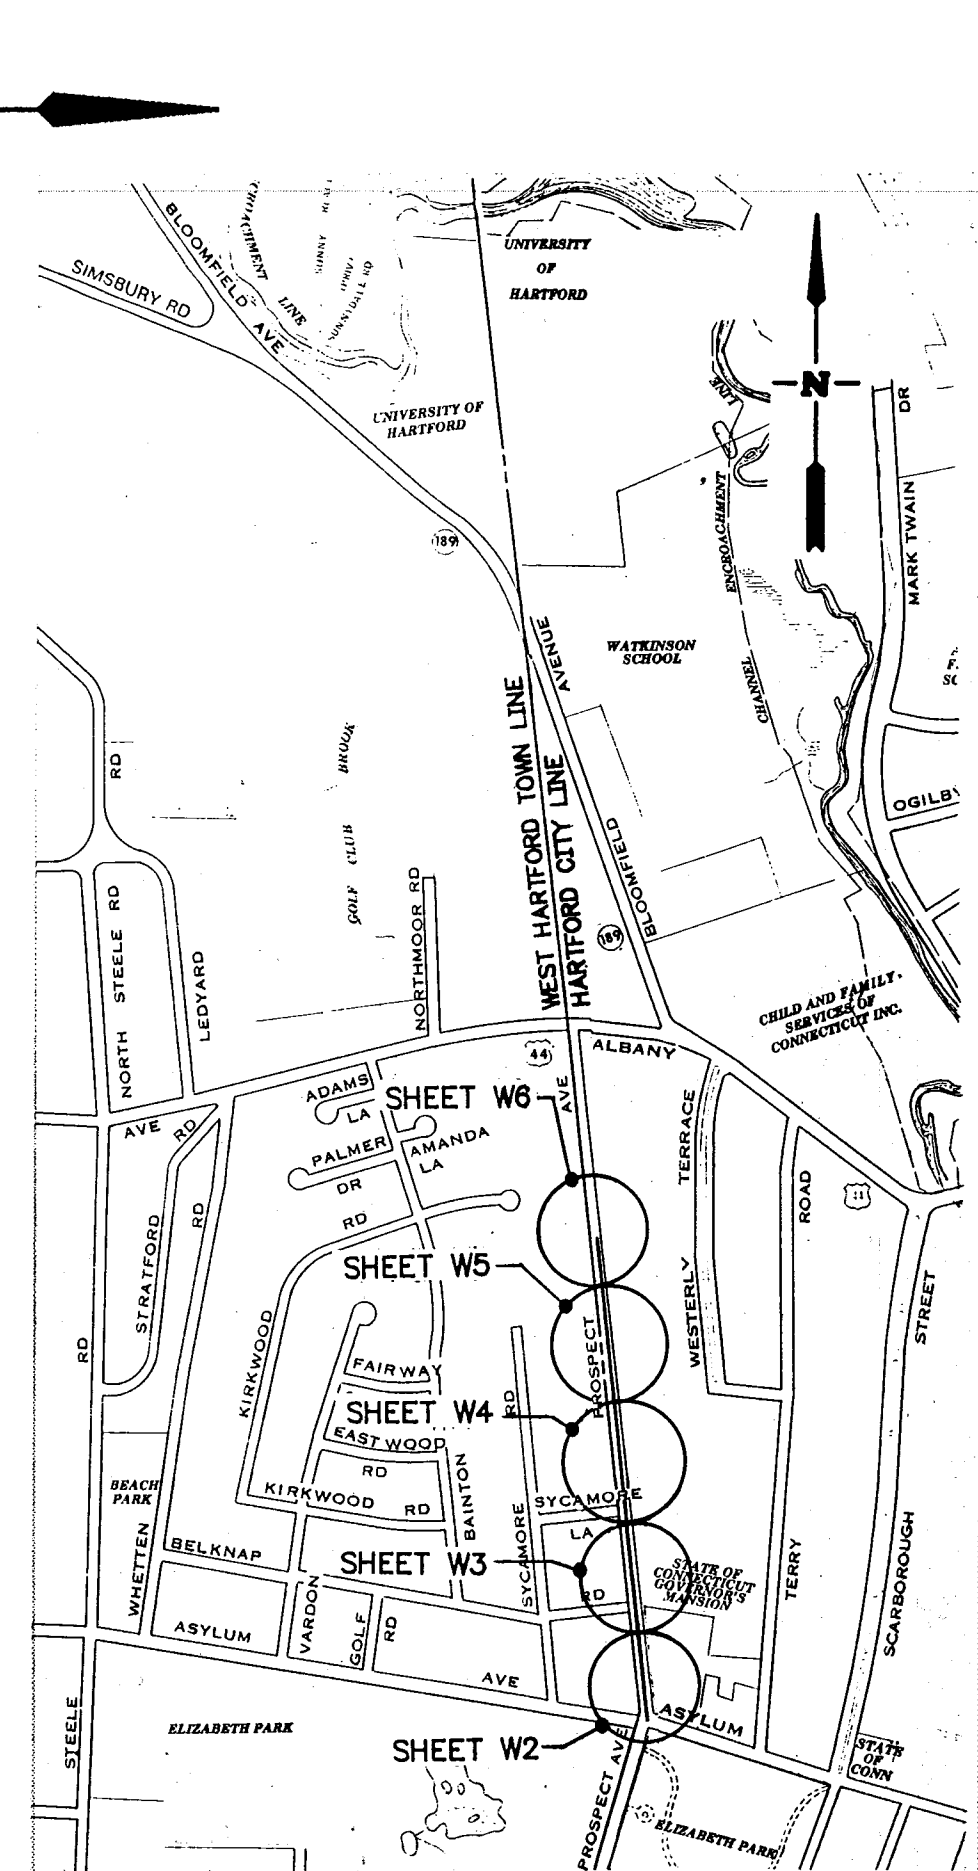

MATCH LINE STA. 5+00
SEE SHEET NO. W3

PLAN

8" x 4" TEE(MJ)
 4" D.I. PIPE
 4" GATE VALVE (MJ)(RH)
 TEMP. CAP(MJ)
 4" TRANSITION SLEEVE (MJ) OR SOLID SLEEVE (MJ)
 4" D.I. PIPE
 EXIST. 4" C.I. W.S.
 4" x 24" MJxMJ OFFSET
 16" ±
 8" WATER
 MAIN
 EXIST. MAIN
 18"
 2'

CROSS SECTION

8" x 16" x 8" CONCRETE ANCHOR
 INSTALLED AT TIME OF MAIN PIPE INSTALLATION
 RESTRAIN PIPE BACK TO TEE
 EXIST. GATE VALVE OR TAPPING VALVE
 DISTRICT TO ABANDON 4" SERVICE

CROSS SECTION

"CALL BEFORE YOU DIG" - THE CONTRACTOR IS HEREBY REMINDED THAT THE CONNECTICUT GENERAL STATUTES REQUIRES NOTICE TO UTILITY COMPANIES OF PENDING EXCAVATION AT OR NEAR PUBLIC UTILITIES - THE CONTRACTOR SHALL CALL 1-800-922-4455 AT LEAST 48 HOURS PRIOR TO BEGINNING EXCAVATION.

"UTILITY IDENTIFICATION TAPE" AFTER PLACING APPROXIMATELY 2.0 FEET OF BACKFILL MATERIAL OVER ALL UTILITY PIPING THE CONTRACTOR SHALL PLACE A FOUR INCH WIDE STRIP OF DURABLE, COLOR CODED (BLUE FOR WATER AND GREEN FOR SANITARY & STORM SEWERS) UNDERGROUND LOCATION TAPE IMPRINTED WITH AN APPROPRIATE WARNING INDICATING THE PRESENCE OF THE BURIED UTILITY CONDUIT.

RECONNECT EXISTING COPPER WATER SERVICES FOR HOUSE #S 995,1033,1034,1049,1060,1093,1100,
1109,1136,1144 TO 8" WATER MAIN, SEE PLAN FOR LOCATIONS

ALL JOINTS WITHIN THE SHADED () AREA SHALL BE RESTRAINED WITH RETAINER GLANDS.

MDC CODE: "PROSPECT AVE. WATER MAIN REPLACEMENT" -
HARTFORD

THE METROPOLITAN DISTRICT

SHEET
W2
OF 6 SHEETS

IN

SCALE: 1"=20' HOR., 1"=10' VERT.

DRAWN	CMM	CHECKED	SEN	DATE	SEPTEMBER 25, 1995
-------	-----	---------	-----	------	--------------------

PROJECT MANAGER <i>[Signature]</i> <i>P. J. [unclear]</i>	SERIAL NO:
APPROVED <i>[Signature]</i> <i>[unclear]</i>	

ACC # 6040 43

ACC.# 6949 63

