


GENERAL NOTES

- THE CONTRACTOR SHALL VISIT THE SITE AND CHECK ALL EXISTING CONDITIONS.
- ALL DIMENSIONS, LOCATIONS AND ELEVATIONS SHALL BE VERIFIED IN THE FIELD BY THE CONTRACTOR. ARCH STREET HAS DOUBLE THICKNESS OF SIDEWALKS AND CURBS ALONG THE NORTH SIDEWALK.
- RUST-PROOF STEEL ANCHOR UNIT WITH KOPPER'S SUPER SERVICE BLACK TUBES. COAT BANDS LAST STEEL PRIOR TO APPLICATION (SEE DWG. S-60).
- FOR STRUCTURAL DETAILS OF MANHOLES SEE DWG. S-60.

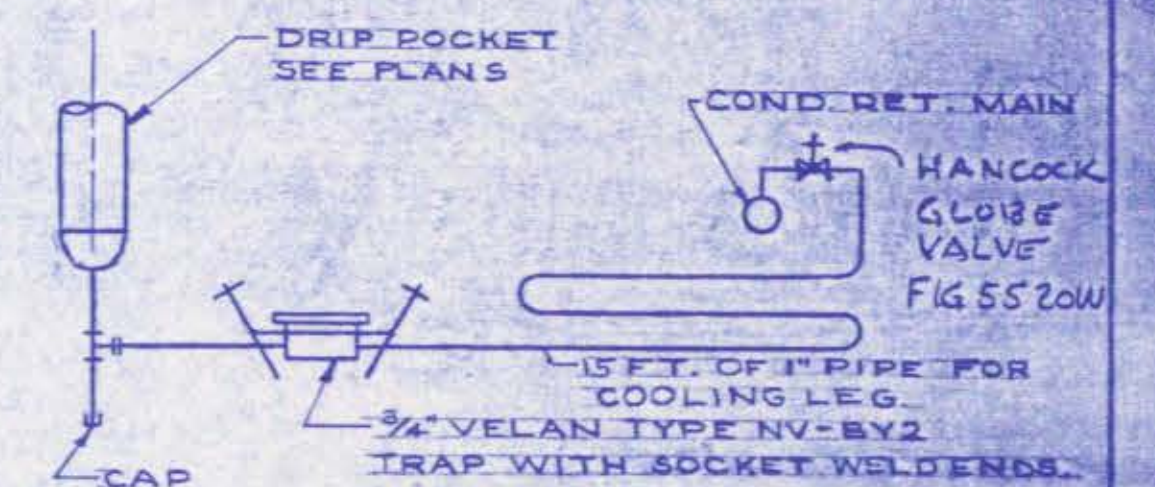


DRIP DETAIL
NO SCALE

MATERIALS	QUANTITY
1) 5' x 5' x 1/4" M.H.	2
2) TRENCH	275'
3) 50# 40 4" STEEL CONDUIT	255'
4) 50# 40 4" PVC CONDUIT	—
5) STEEL COUPLERS	6
6) PVC COUPLERS	—
7) 4" 10 9" TRENCH	—

REV	DATE	ISSUED FOR CONSTRUCTION	W2
1	4-14-66	ISSUED FOR CONSTRUCTION	W2





THE HARTFORD STEAM COMPANY

SEELYE STEVENSON VALLEY & KNECHT, INC. CONSULTING ENGINEERS 95 PARK AVENUE, NEW YORK 16, N.Y.	DRAWN BY A.J.G. CHECKED BY W.L. APPROVED BY W.L. APPROVED BY W.L.	CENTRAL HEATING AND REFRIGERATION PLANT DISTRIBUTION SYSTEM EXTENSION ARCH STREET SCALE DATE DWG. NO. M-60
---	--	---


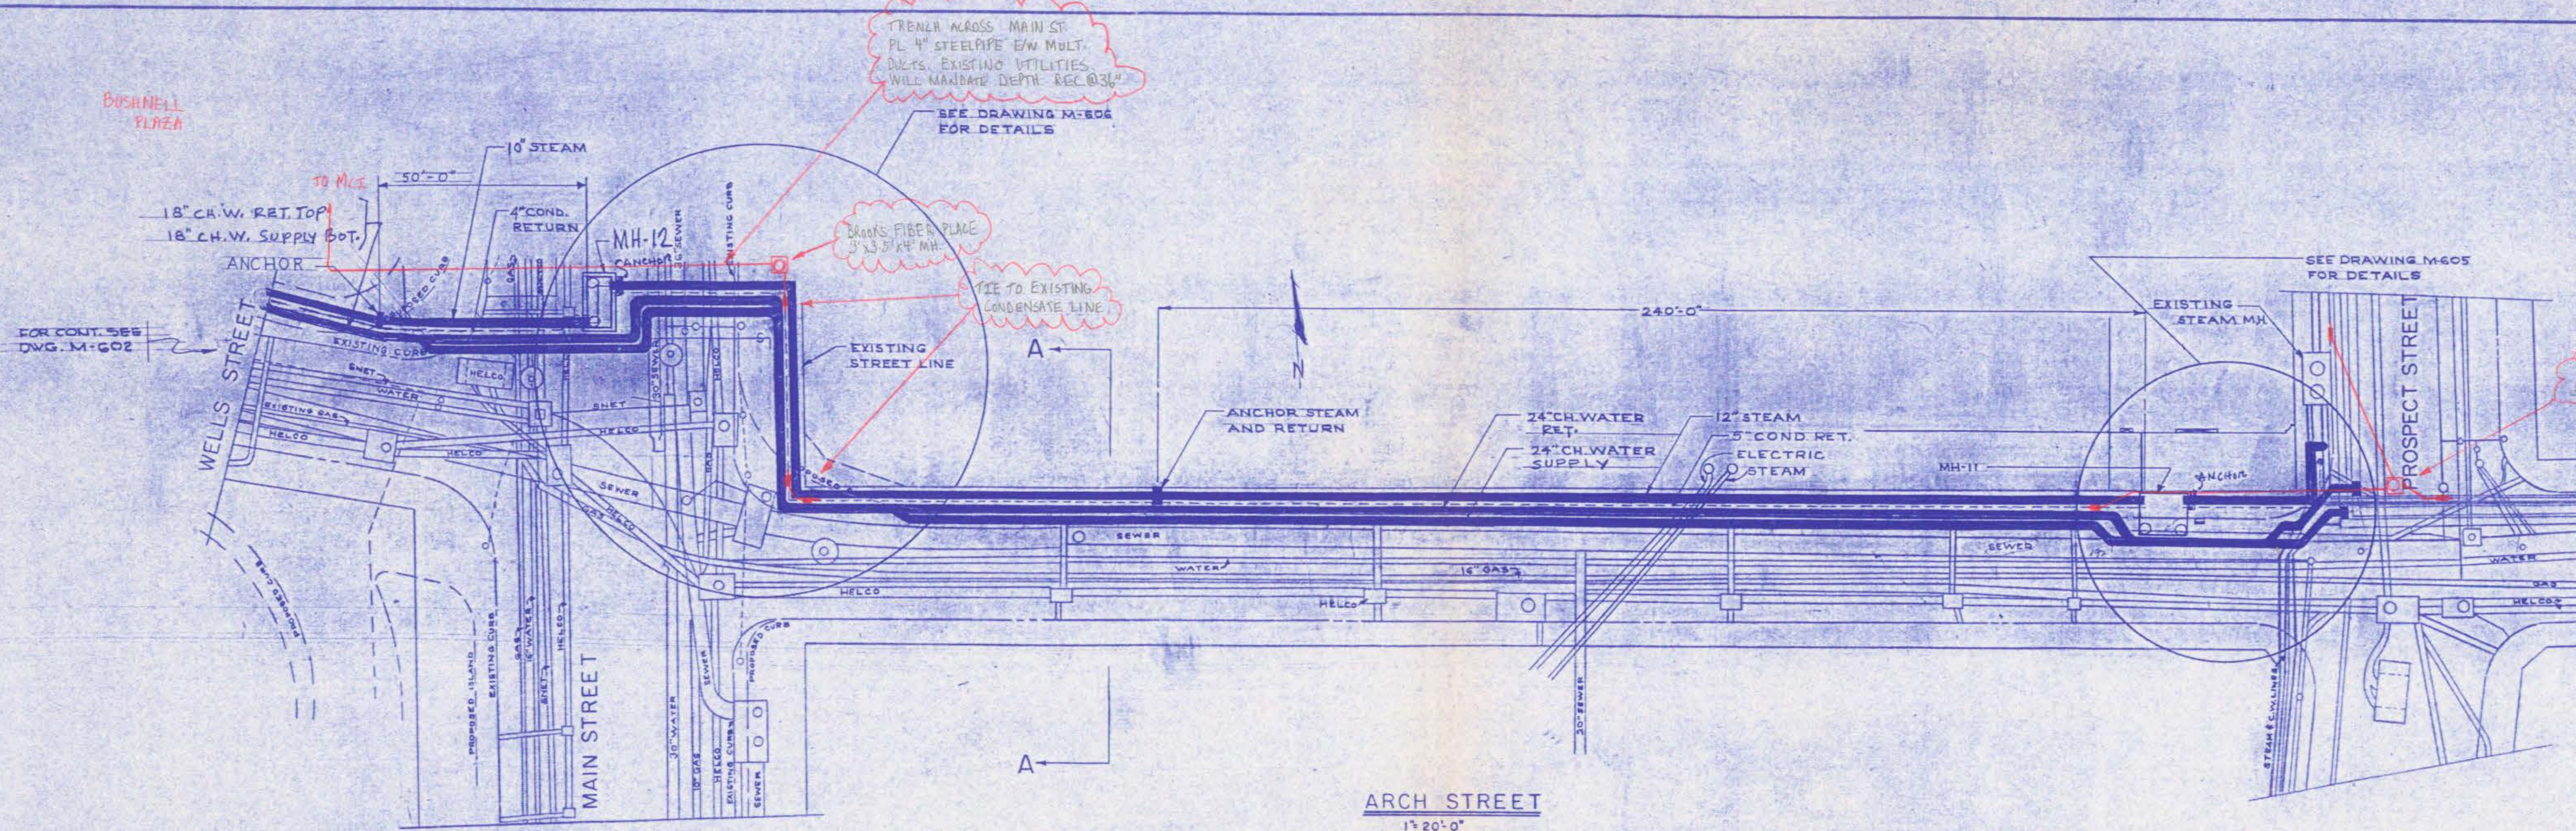


JOINT NO.	PIPE DIA.	TRAVERSE	ENDS	LOCATION	TYPE
EJ-1	12"	8"		MH-11	SLIP-TYPE**
EJ-2	5"	4"		MH-11	SLIP-TYPE**
EJ-3	10"	4"		MH-12	SLIP-TYPE**
EJ-4	4"	4"		MH-12	SLIP-TYPE**
EJ-5	10"	8"		CONDUIT	BELLOWS*
EJ-6-13	10"	1 1/2"		CONDUIT	BELLOWS*
EJ-14-22	4"	1/2"		CONDUIT	BELLOWS*

** YARWAY GUN PAKT ** ZALCA SELF-EQUALIZING

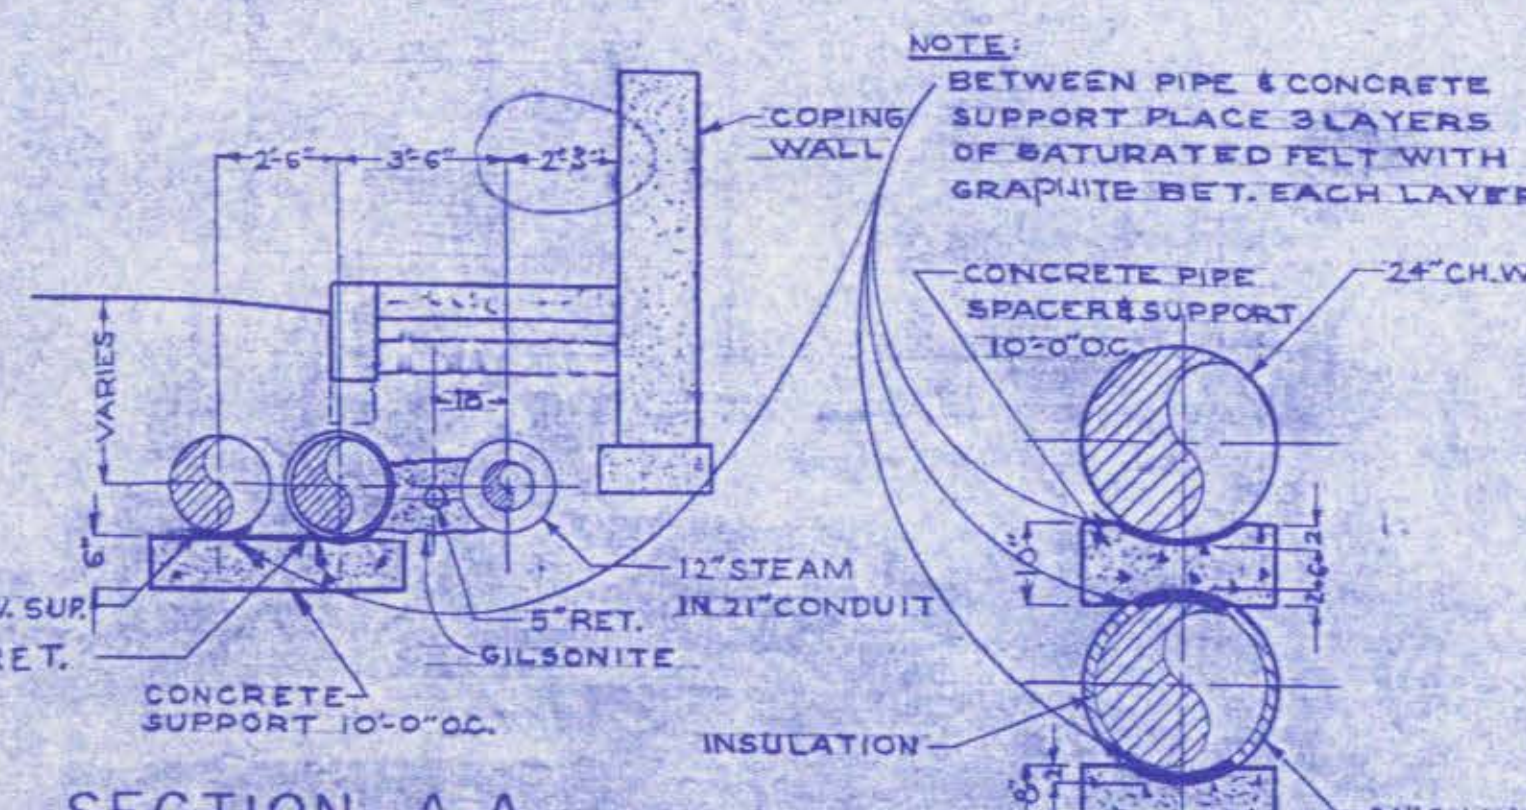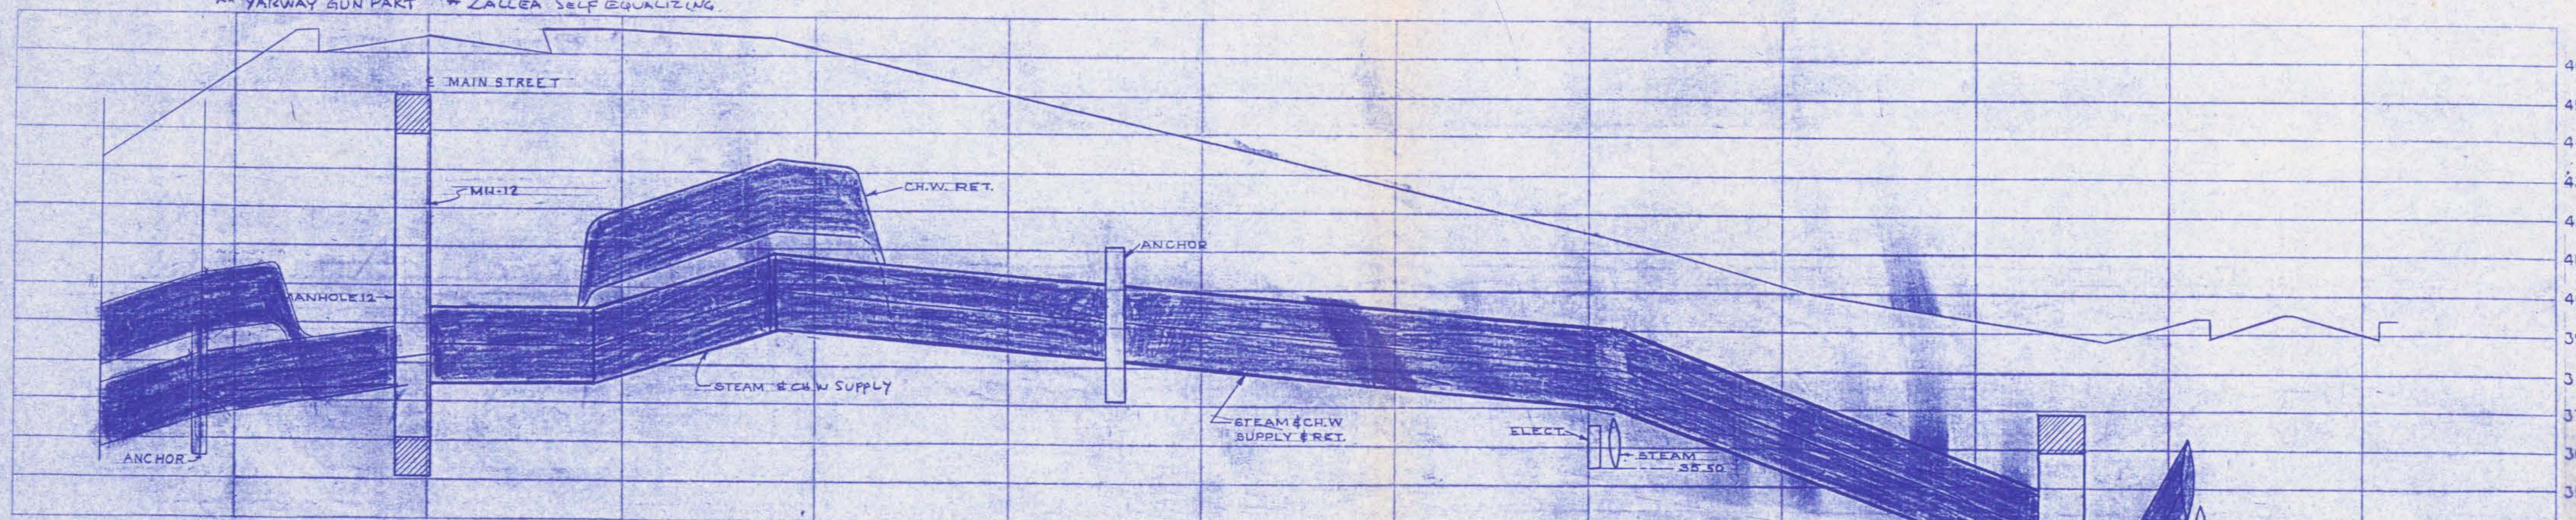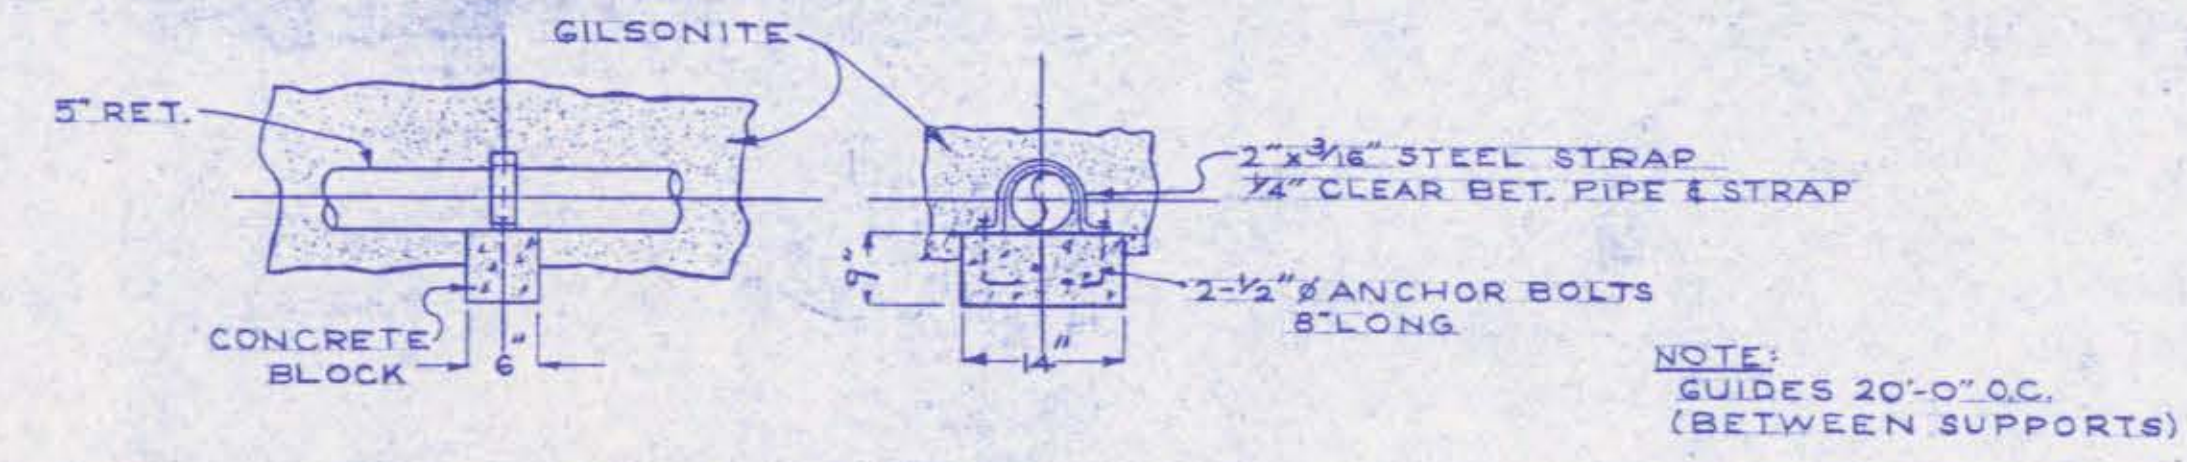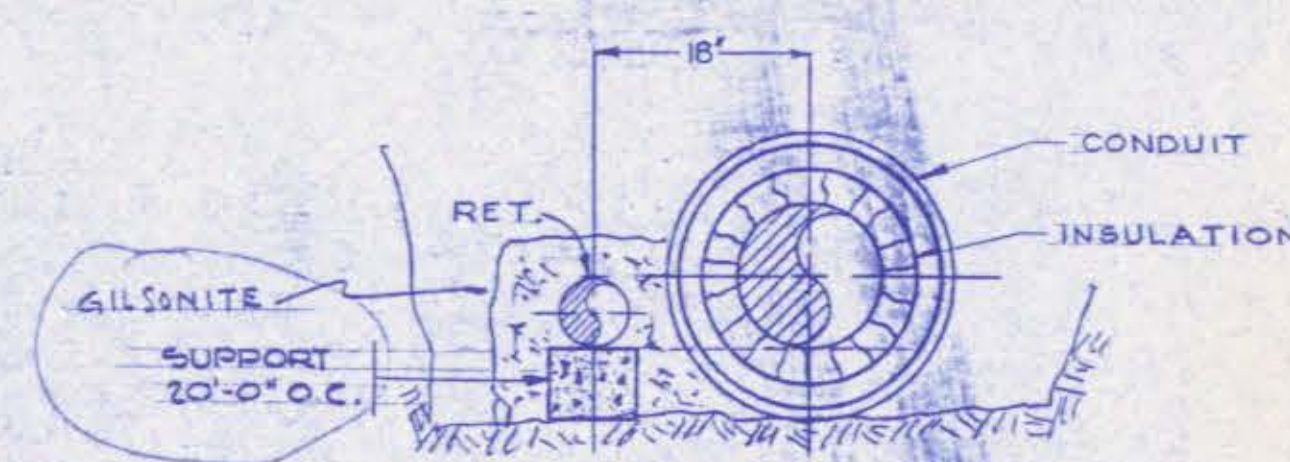

OVER & UNDER
TYPICAL DETAIL CHILLED WATER PIPE SUPPORTS
NO SCALE

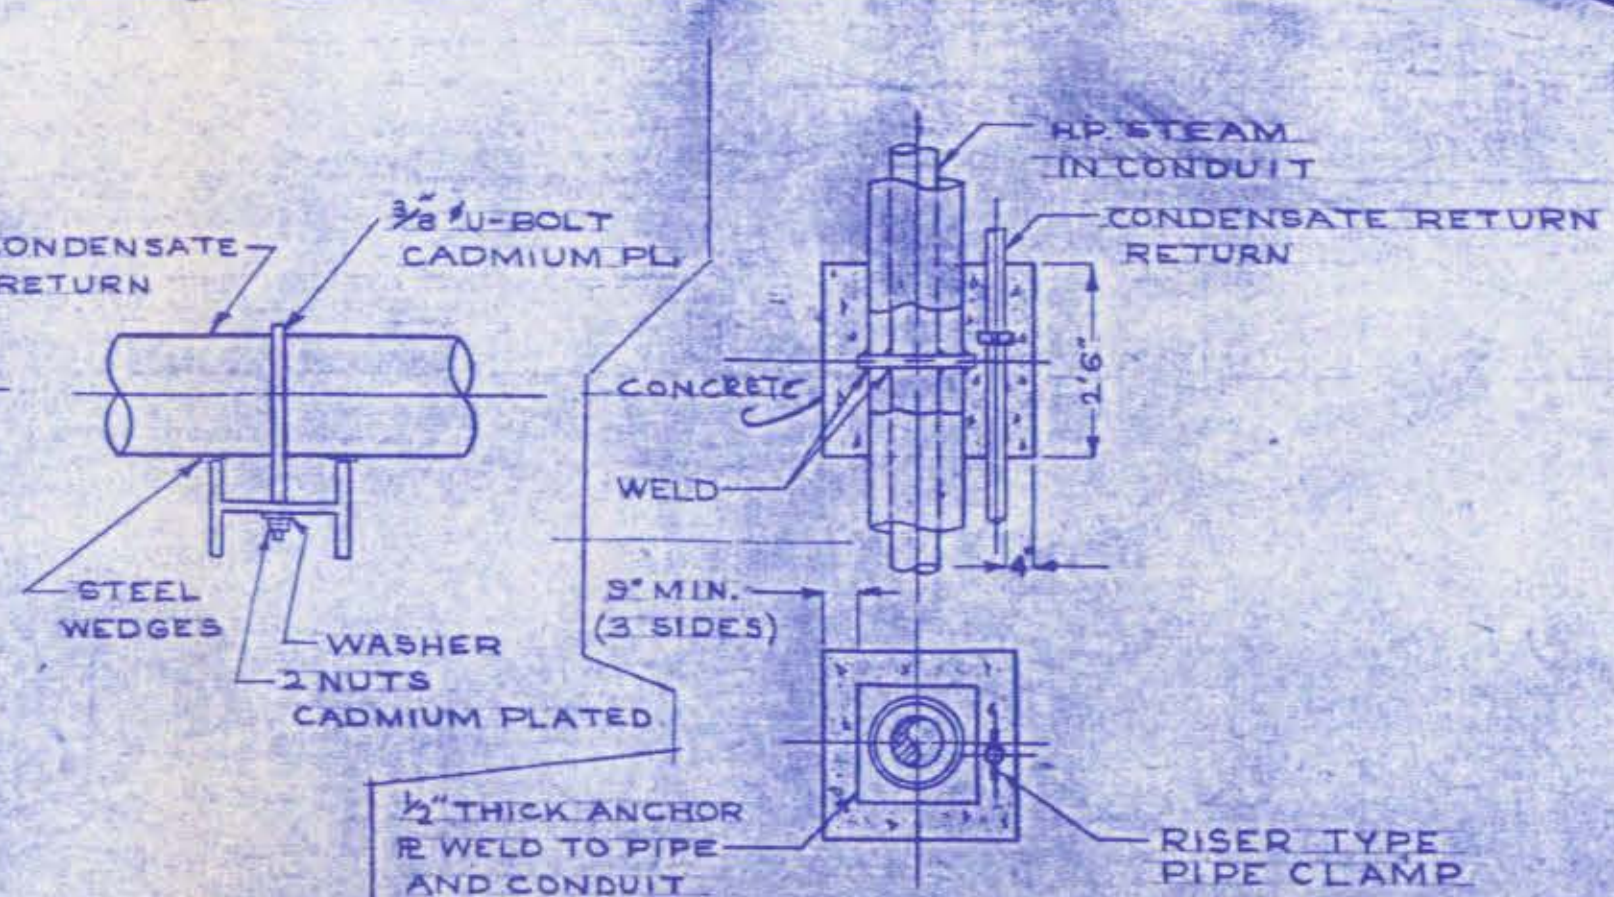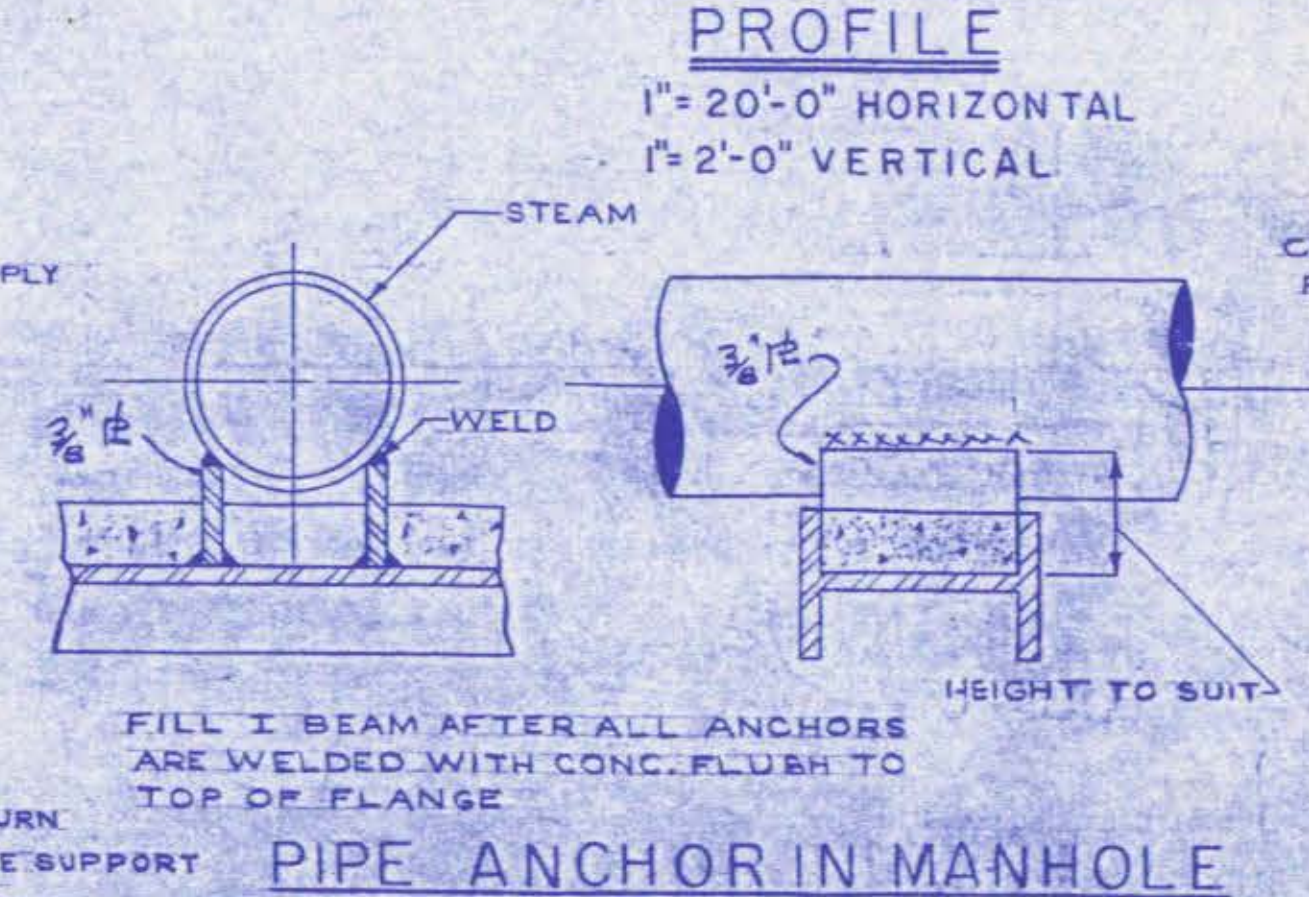

NOTED: 4-14-66